



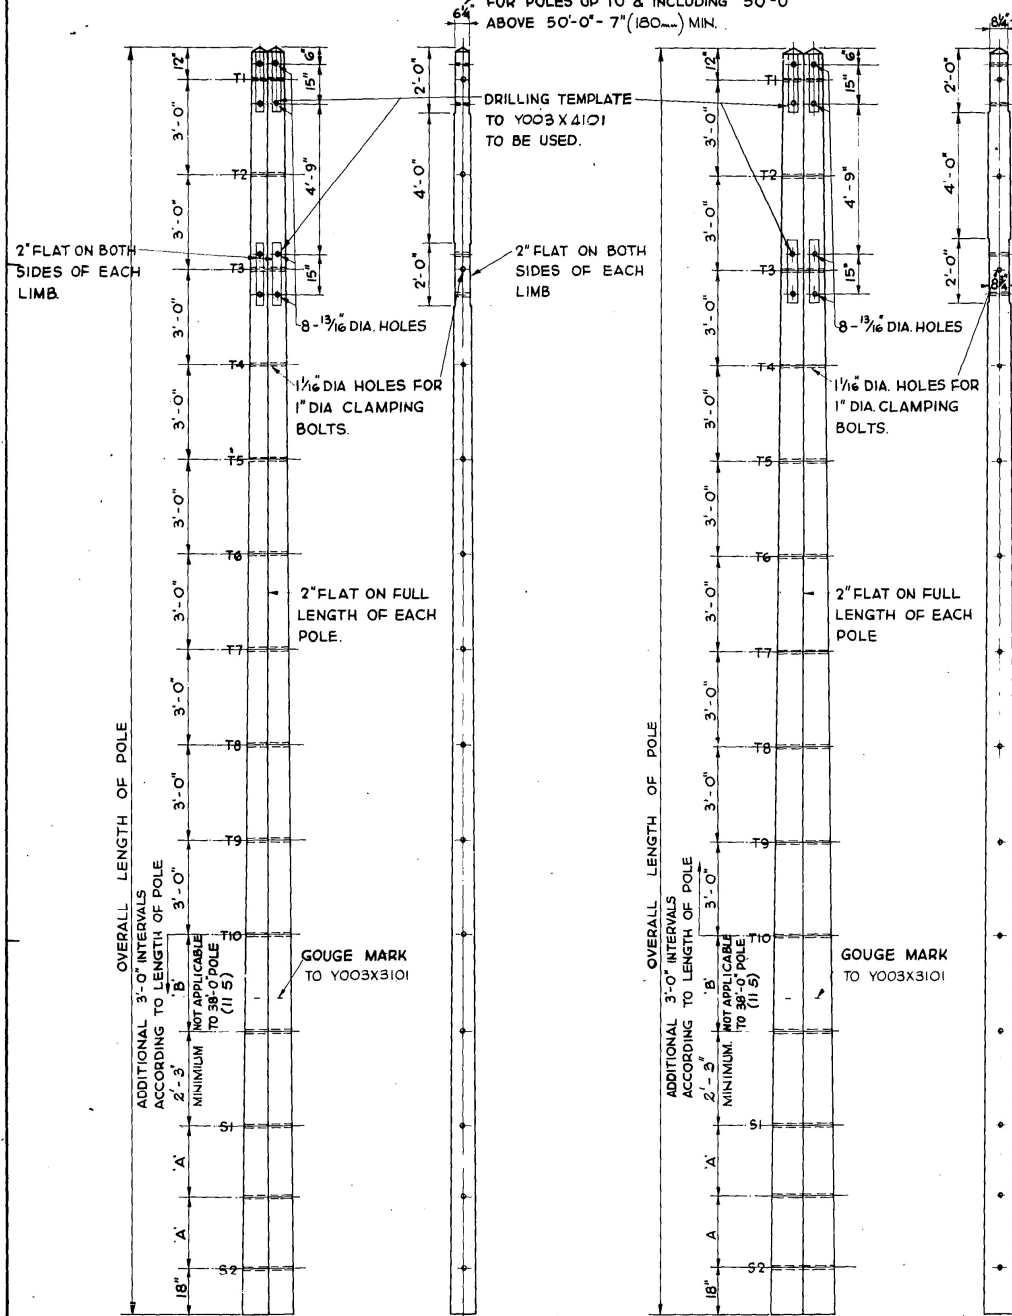


INTERMEDIATE POLE

TWO TWIN LIMBS (4 STICKS) REQUIRED
PER SUPPORT
(MEDIUM CLASS POLES)

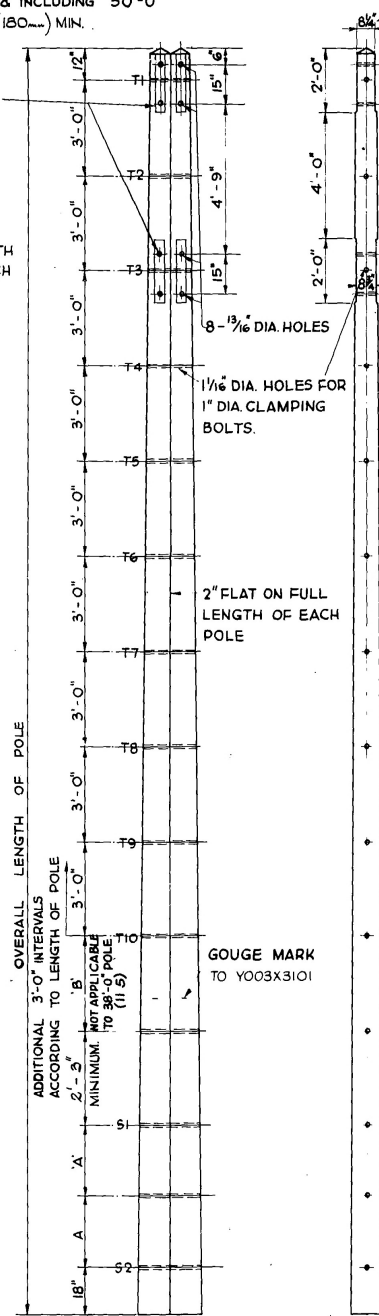

SECTION POLE

TWO TWIN LIMBS (4 STICKS) REQUIRED
PER SUPPORT
(STOUT CLASS POLES)

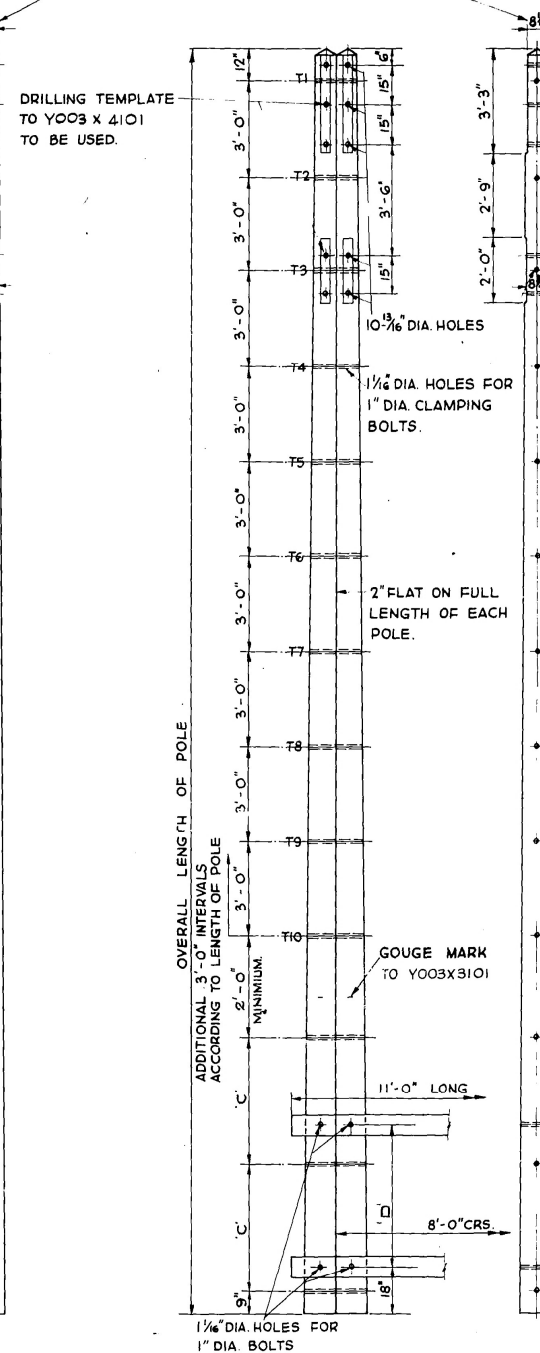

ANGLE POLE

TWO TWIN LIMBS (4 STICKS) REQUIRED
PER SUPPORT
(STOUT CLASS POLES)

POLE LENGTHS

POLE LENGTH METRES	FEET	INTER. & SECTION DIM. A'	DIM. B'	ANGLE DIM. C'	DIM. D'
11.5	38'-0"	2'-3"	3'-0"	3'-0"	4'-6"
12	40'-0"	2'-3"	3'-0"	4'-0"	4'-6"
13	42'-0"	2'-3"	4'-0"	3'-6"	4'-6"
14	45'-0"	2'-3"	4'-0"	3'-6"	4'-6"
15	50'-0"	2'-6"	3'-3"	4'-0"	5'-0"
16		2'-6"	4'-3"	4'-0"	5'-0"
17	55'-0"	2'-6"	4'-3"	4'-0"	5'-0"
18	60'-0"	2'-6"	3'-9"	3'-6"	5'-0"

POLE CLAMPING BOLTS

CLAMPING BOLTS ARE NOT REQUIRED FOR THE FOLLOWING HOLES, TO ALLOW FOR FITTING OF BRACING SETS & FOUNDATION BAULKS

POLE LENGTH METRES	FEET	HOLE NUMBERS INTER. SECT. & ANGLE	INTER. SECT.
11.5	38'-0"	T5 T7	S1 S2
12	40'-0"	T5 T7	S1 S2
13	42'-0"	T5 T7	S1 S2
14	45'-0"	T6 T8	S1 S2
15	50'-0"	T6 T8 T10	S1 S2
16		T6 T8 T10	S1 S2
17	55'-0"	T6 T8 T10	S1 S2
18	60'-0"	T6 T8 T10	S1 S2

8'x4'x11'-0" LONG CREOSOTED IMPORTED FIR FOUNDATION BAULKS & FIXING BOLTS TO BE SUPPLIED FOR ANGLE POLES ONLY DRILLED TO MATCH POLE HOLES ON POLE REFERENCE FACE POLE MATCHING NUMBERS TO BE INDICATED ON FOUNDATION BAULKS

MATERIALS

POLES TO BS1990 TO BE BOLTED TOGETHER BEFORE CREOSOTING POLE BOLT NUTS TO BE SLACKENED 2 FULL TURNS BEFORE CREOSOTING & FULLY TIGHTENED AFTER CREOSOTING TO BS913 BY THE RUEPING PROCESS BOLTS TO BS916 THREADED BS WHIT. & FITTED WITH 1 FULL NUT & 2-2 1/2 x 2 1/2 x 1/4" CURVED WASHERS. & GALVANISED TO BS 729

YORKSHIRE ELECTRICITY BOARD - HEAD OFFICE			
DRAWN	DATE	OVERHEAD LINES SPEC. CE/OM/DCI	
EN	17/12/82	POLE DETAILS	
TRACED	DATE		
MGB	11/1/83		
CHECKED	DATE		
APPROVED	DATE		
SCALE - 3/8" TO 1 FT		DRG No. Y003X 3104	
WHEN QUOTING THIS DRG No. PLEASE STATE LATEST LETTER OF ISSUE			

G	TABLES MODIFIED HEIGHT TO GOUGE MARK REMOVED MINIMUM DIMENSION 1/2" (12.7)	H	NOTES SCARFING & DRILLING TEMPLATES ADDED & POLE TOP DIA. MODIFIED	J	NOTES RE GALVANISING ADDED	K	DRG NO. Y003X 3104	L	GOUGE MARK (SEE DETAIL) REPLACED BY GOUGE MARK TO Y003X3101	M	DRILLING TEMPLATE DRG NO. AMENDED
A	ORIGINAL ISSUE	B	17/12/82	C	26/3/83	D	26/3/83	E	26/3/83	F	26/3/83