


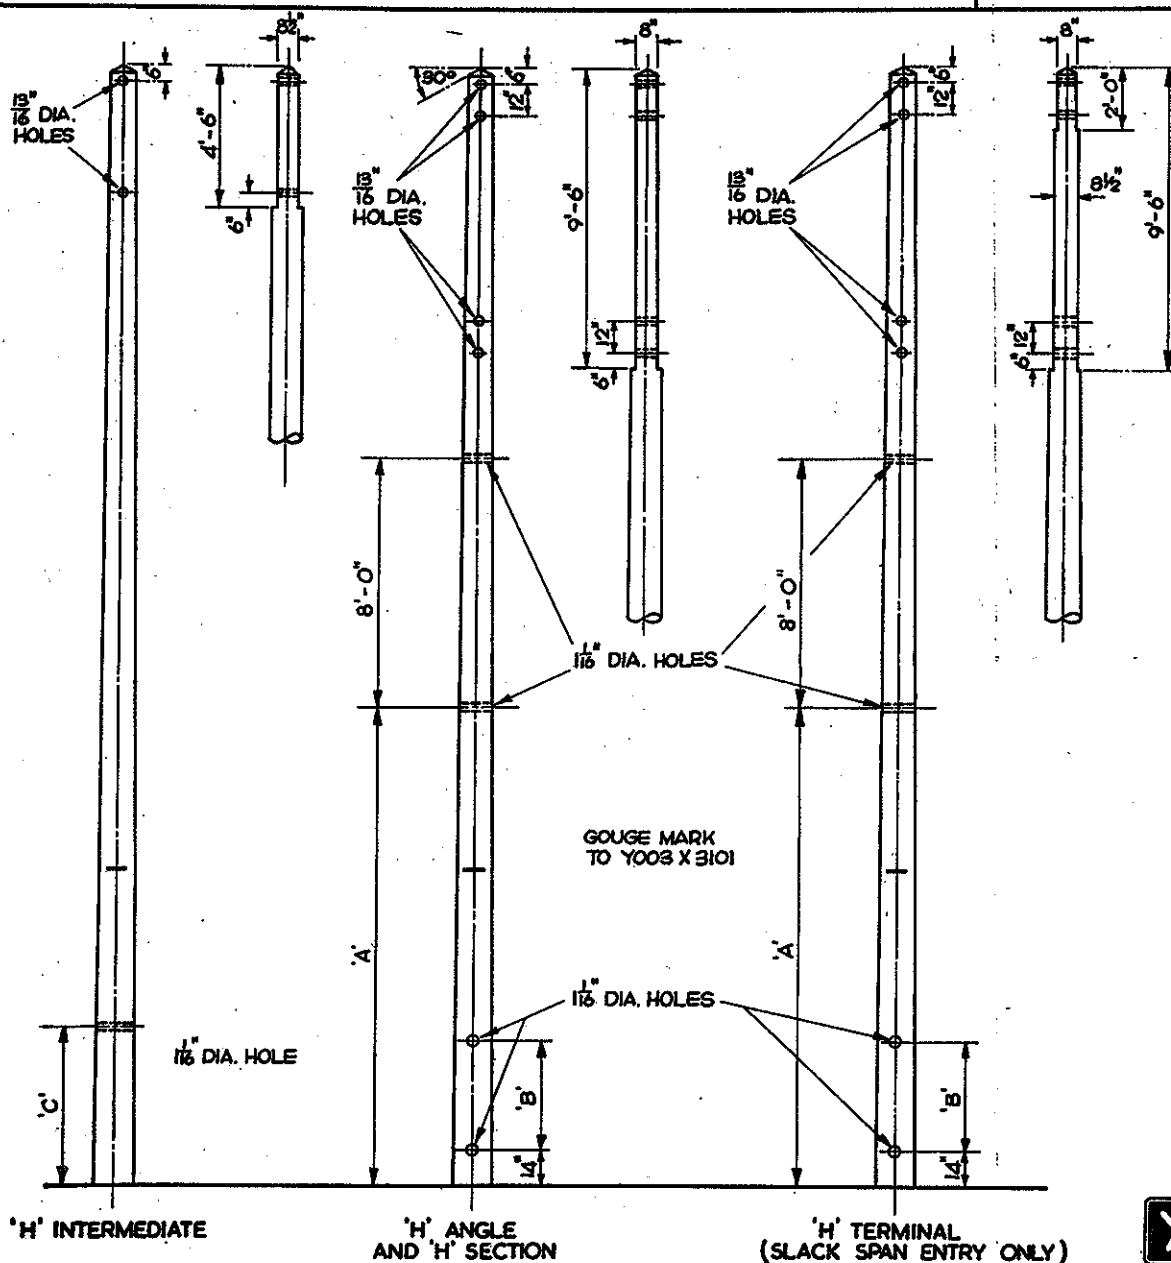

NOTES

- POLES TO BE STOUT CLASS TO B.S. 1990, CREOSOTED TO B.S. 913 BY THE RUEPING PROCESS AFTER ALL DRILLING AND SCARFING IS COMPLETE.
- POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS FROM 1 ONWARDS
- POLES SELECTED FOR INTERMEDIATE AND ANGLE STRUCTURES TO HAVE A POLE TOP DIAMETER NOT LESS THAN 3/4" (20mm) ABOVE THE MINIMUM SPECIFIED IN B.S. 1990, TABLE 3
- TERMINAL POLES AND WHEN SPECIFIED ANGLE POLES, TO BE THE MAXIMUM SIZE SPECIFIED IN B.S. 1990, BEFORE SCARFING.
- BRACINGS TO Y003X3105 REQUIRED ON ANGLE AND TERMINAL POLES ONLY.

POLE METRES	LENGTH FEET	DIMENSION 'A'	DIMENSION 'B'	DIMENSION 'C'
UP TO 11-5	UP TO 38'-0"	19'-0"	2'-10"	4'-6"
12-13	40'-0"-42'-0"	19'-0"	3'-4"	5'-0"
14	45'-0"	22'-0"	3'-10"	5'-6"
15	50'-0"	19'-0"	3'-10"	5'-6"
16		22'-0"	4'-4"	6'-0"
17	55'-0"	24'-0"	4'-4"	6'-0"
18	60'-0"	27'-0"	4'-10"	6'-6"
20		34'-0"	4'-10"	6'-6"
22		39'-0"	4'-10"	6'-6"

Copyright of YORKSHIRE ELECTRICITY GROUP plc



drawn
traced J.B.
checked G.B.
date 31-12-81
original scale
1/4" TO 1 FOOT

HV OVERHEAD LINES SPEC. CE/C/37/4W


POLE DETAILS FOR PORTAL SUPPORTS WITH EARTH WIRE

Y003 X 3116

ISSUED

13 MAY 2004

13

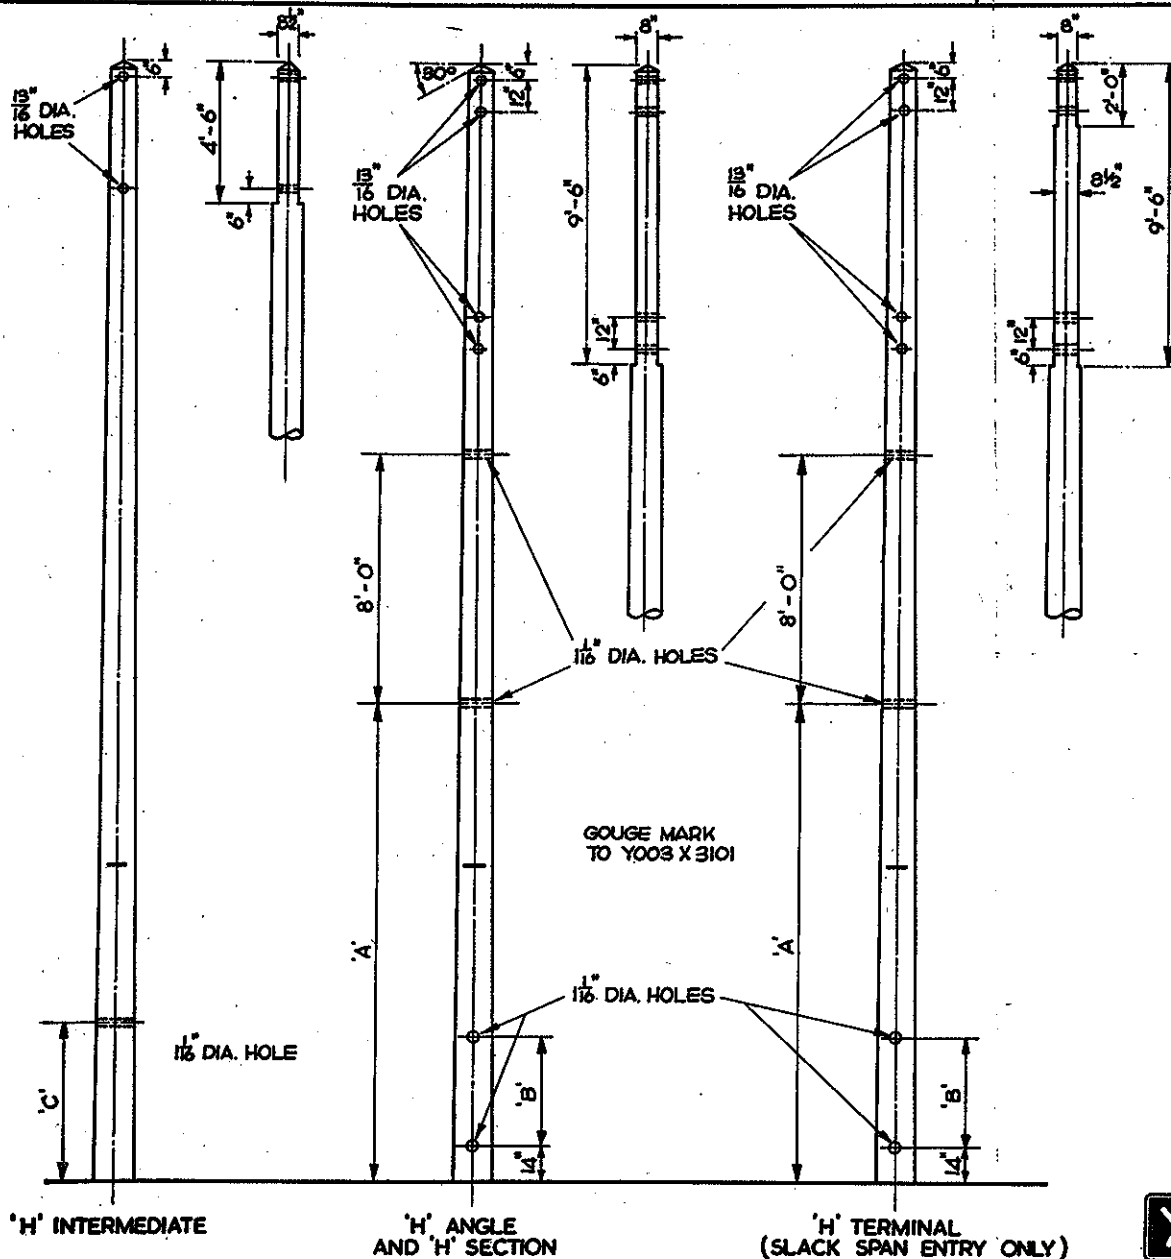

NOTES

- POLES TO BE STOUT CLASS TO B.S. 1990, CREOSOTED TO BS 913 BY THE RUPEING PROCESS AFTER ALL DRILLING AND SCARFING IS COMPLETE.
- POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS FROM 1 ONWARDS
- POLES SELECTED FOR INTERMEDIATE AND ANGLE STRUCTURES TO HAVE A POLE TOP DIAMETER NOT LESS THAN 3/4" (20mm) ABOVE THE MINIMUM SPECIFIED IN B.S. 1990, TABLE 3
- TERMINAL POLES AND WHEN SPECIFIED ANGLE POLES TO BE THE MAXIMUM SIZE SPECIFIED IN B.S. 1990, BEFORE SCARFING.
- BRACINGS TO Y003X3105 REQUIRED ON ANGLE AND TERMINAL POLES ONLY.

POLE METRES	LENGTH FEET	DIMENSION 'A'	DIMENSION 'B'	DIMENSION 'C'
UP TO 11-5	UP TO 38'-0"	19'-0"	2'-10"	4'-6"
12-13	40'-0"-42'-0"	19'-0"	3'-4"	5'-0"
14	45'-0"	22'-0"	3'-10"	5'-6"
15	50'-0"	19'-0"	3'-10"	5'-6"
16		22'-0"	4'-4"	6'-0"
17	55'-0"	24'-0"	4'-4"	6'-0"
18	60'-0"	27'-0"	4'-10"	6'-6"
20		34'-0"	4'-10"	6'-6"
22		39'-0"	4'-10"	6'-6"

'H' INTERMEDIATE

'H' ANGLE AND 'H' SECTION

'H' TERMINAL (SLACK SPAN ENTRY ONLY)

Copyright of YORKSHIRE ELECTRICITY GROUP plc



drawn
traced J.B.
checked G.B.
date 31-12-81
original scale
1/4" TO 1 FOOT

HV OVERHEAD LINES SPEC. CE/C/37/4W

POLE DETAILS FOR PORTAL SUPPORTS WITH EARTH WIRE

Y003 X 3116

ISSUED

18 MAY 2004