
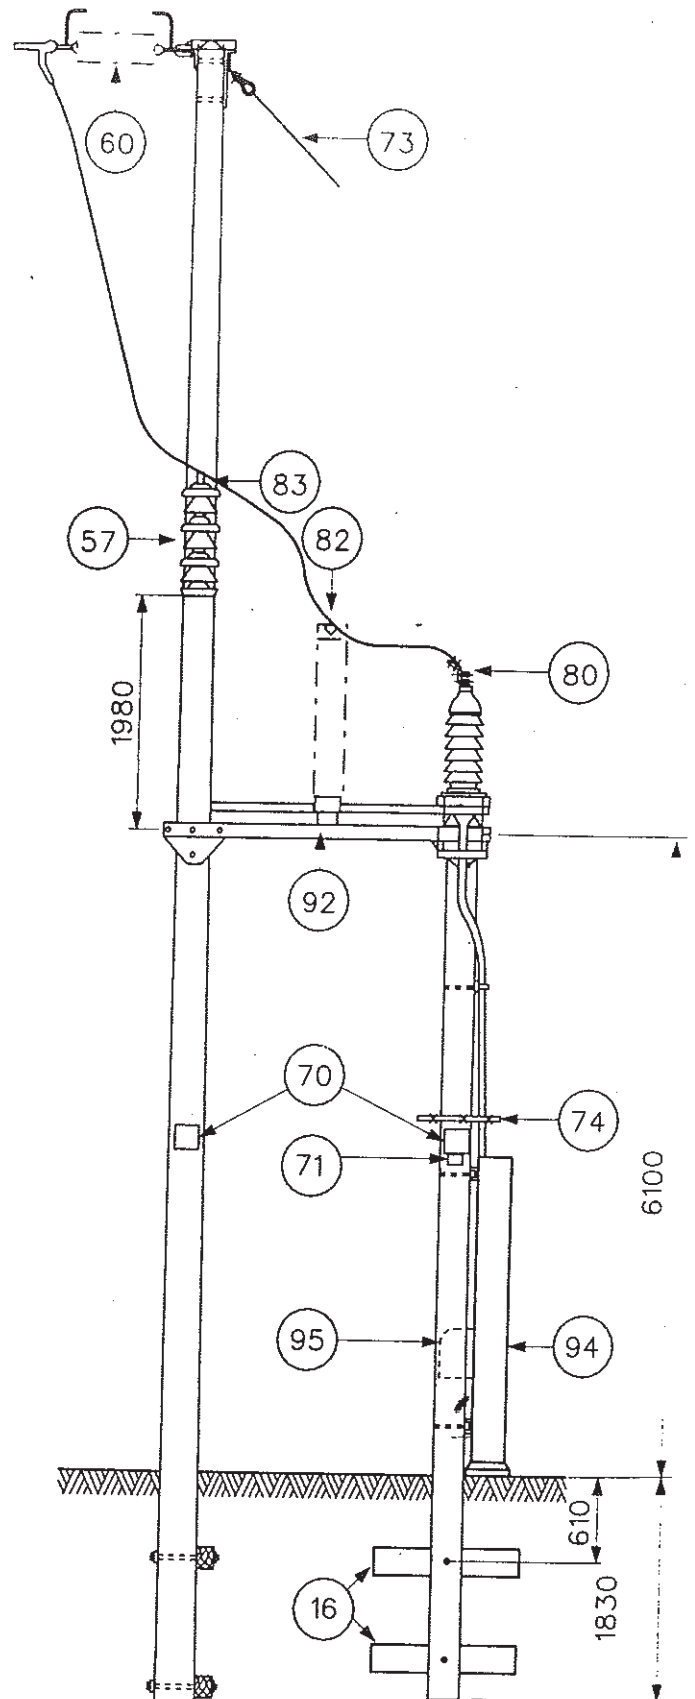


MATERIALS LIST.

Item	Nº	Commodity Code	Description	Drawing or Ref.Number	M 20 Bolts	Washers		
						sc	sf	r
9	2	BPC 024	Wood Pole	Y204 L 0604				
16	4	217539	Kicking/Stay Block (type 2)	439103	4(Pole)	4	4	
19	2	217497	Brace Block	Y204 L 0301	4(Pole)	4	4	
32	1	223669	Crossarm Member	Y204 L 0904	4 x 300			
57	3	215970	66kV Pilot Insulator	Y204 L 0702				
60	3		33kV Tension Set	Y204 L 0704				
			66kV Tension Set					
70	4	294181	Safety Sign	Y201 L 1002				
71			Operational Plates	Y201 L 1001/7				
73	4		Stay Arrangement	Y204 L 0501				
74	1	224519	Anti- Climbing Guard	Y201 L 1101/2				
80	3		66kV Sealing End Connector	Y204 L 0801				
82	3	221119	Surge Diverter Connector	Y204 L 0803				
83	3	221093	33kV Post Ins.Clamp(al)	Y204 L 0804				
		221101	66kV Post Ins.Clamp(cu)	Y204 L 0805				
92	1		66kV Sealing End P-form (15 - 18m poles)	Y204 L 0909	10(Pole)			
93	1		66kv Cable Supports	Y204 L 0910	6(Pole)			
94	1	224535	Cable Guard	Y204 L 0911	4 x 50			
95	1		Link Box	Eng Rec C55				

* 4 off M20 x 60 bolts also required for gusset plates.

Copyright of the YORKSHIRE ELECTRICITY GROUP plc. No part to be reproduced without prior permission.

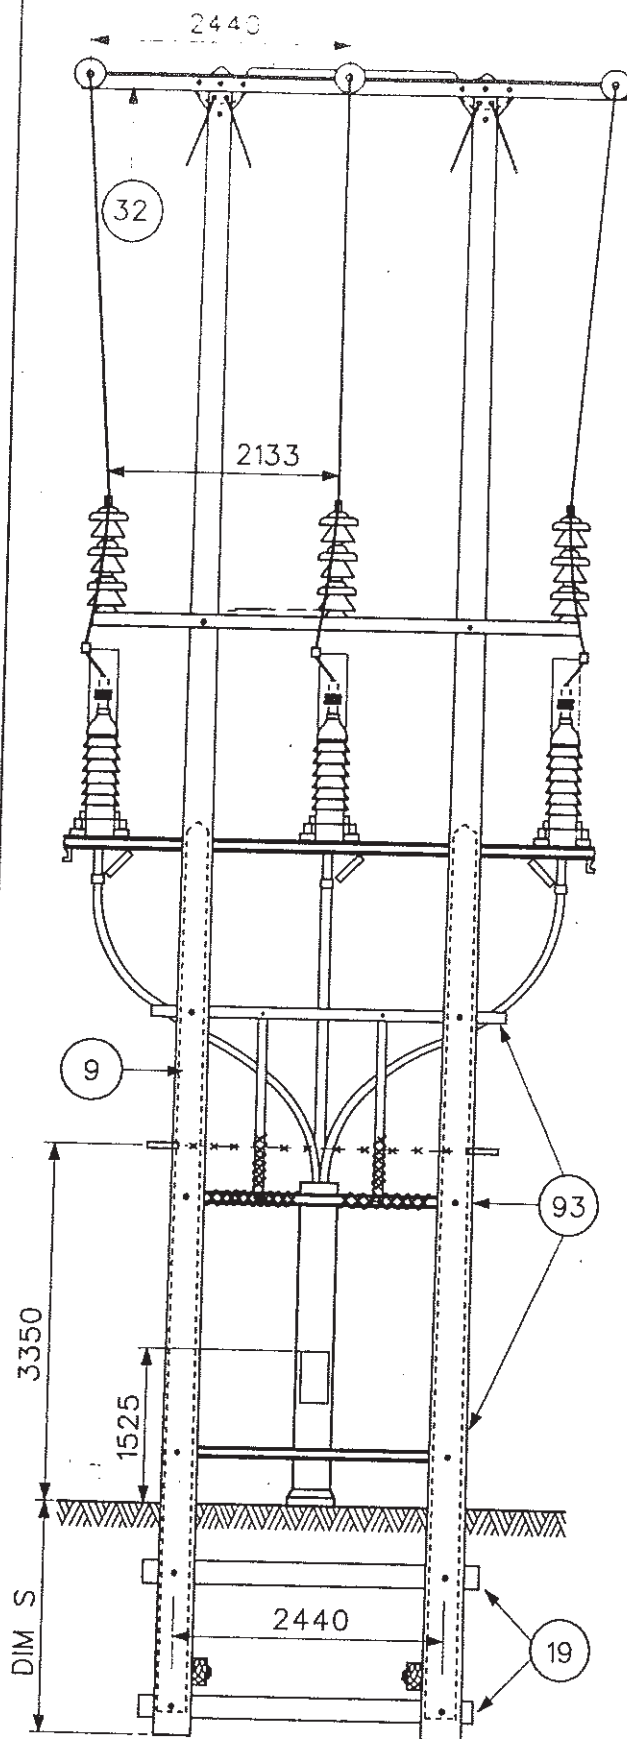

DIMENSIONS IN MILLIMETRES

drawn	BT	CE/C/37 CE/OM/DC1 66kV CABLE TERMINATION WITH SURGE DIVERTERS 15.0 TO 18.0m POLES		 Yorkshire Electricity
traced	SW			
checked	JMG			
approved	BT			
revision	date 28-3-91	original scale	Y104L0108	