

MATERIALS LIST.

Item	Nº	Commodity Code	Description	Drawing or Ref. Number	M 20 Bolts	Washers		
						sc	sf	r
4	2	BPC 024	Wood Pole (type 2)	Y204 L 0601				
19	2	217497	Brace Block	Y204 L 0301	4(Pole)	4	4	
30	1	222455	Crossarm Member	Y204 L 0902	4 x 300*			
45	1	219519	Pole Bracing(single)	Y204 L 0905				
		219501	Pole Bracing(double)					
60	6		33kV Tension Set	Y204 L 0704				
			66kV Tension Set					
70	2	294181	Safety Sign	Y201 L 1002				
71			Operational Plates	Y201 L 1001/7				
73			Stay Arrangement	Y204 L 0501				

* 8 off M20 x 45 bolts also required for gusset plates.


Notes to drawing Nº Y104 L 0114.

1. Single pole bracing required for poles up to 14.0m.

Double pole bracing required for poles 15.0m and above.

Pole Planting Depth	
Pole Length (m)	Dim S (m)
<=11.5	1.80
12.0 - 13.0	2.00
14.0 - 15.0	2.10
16.0 - 17.0	2.25
18.0 - 20.0	2.40

Area: -----
File ----- Plotted on -----

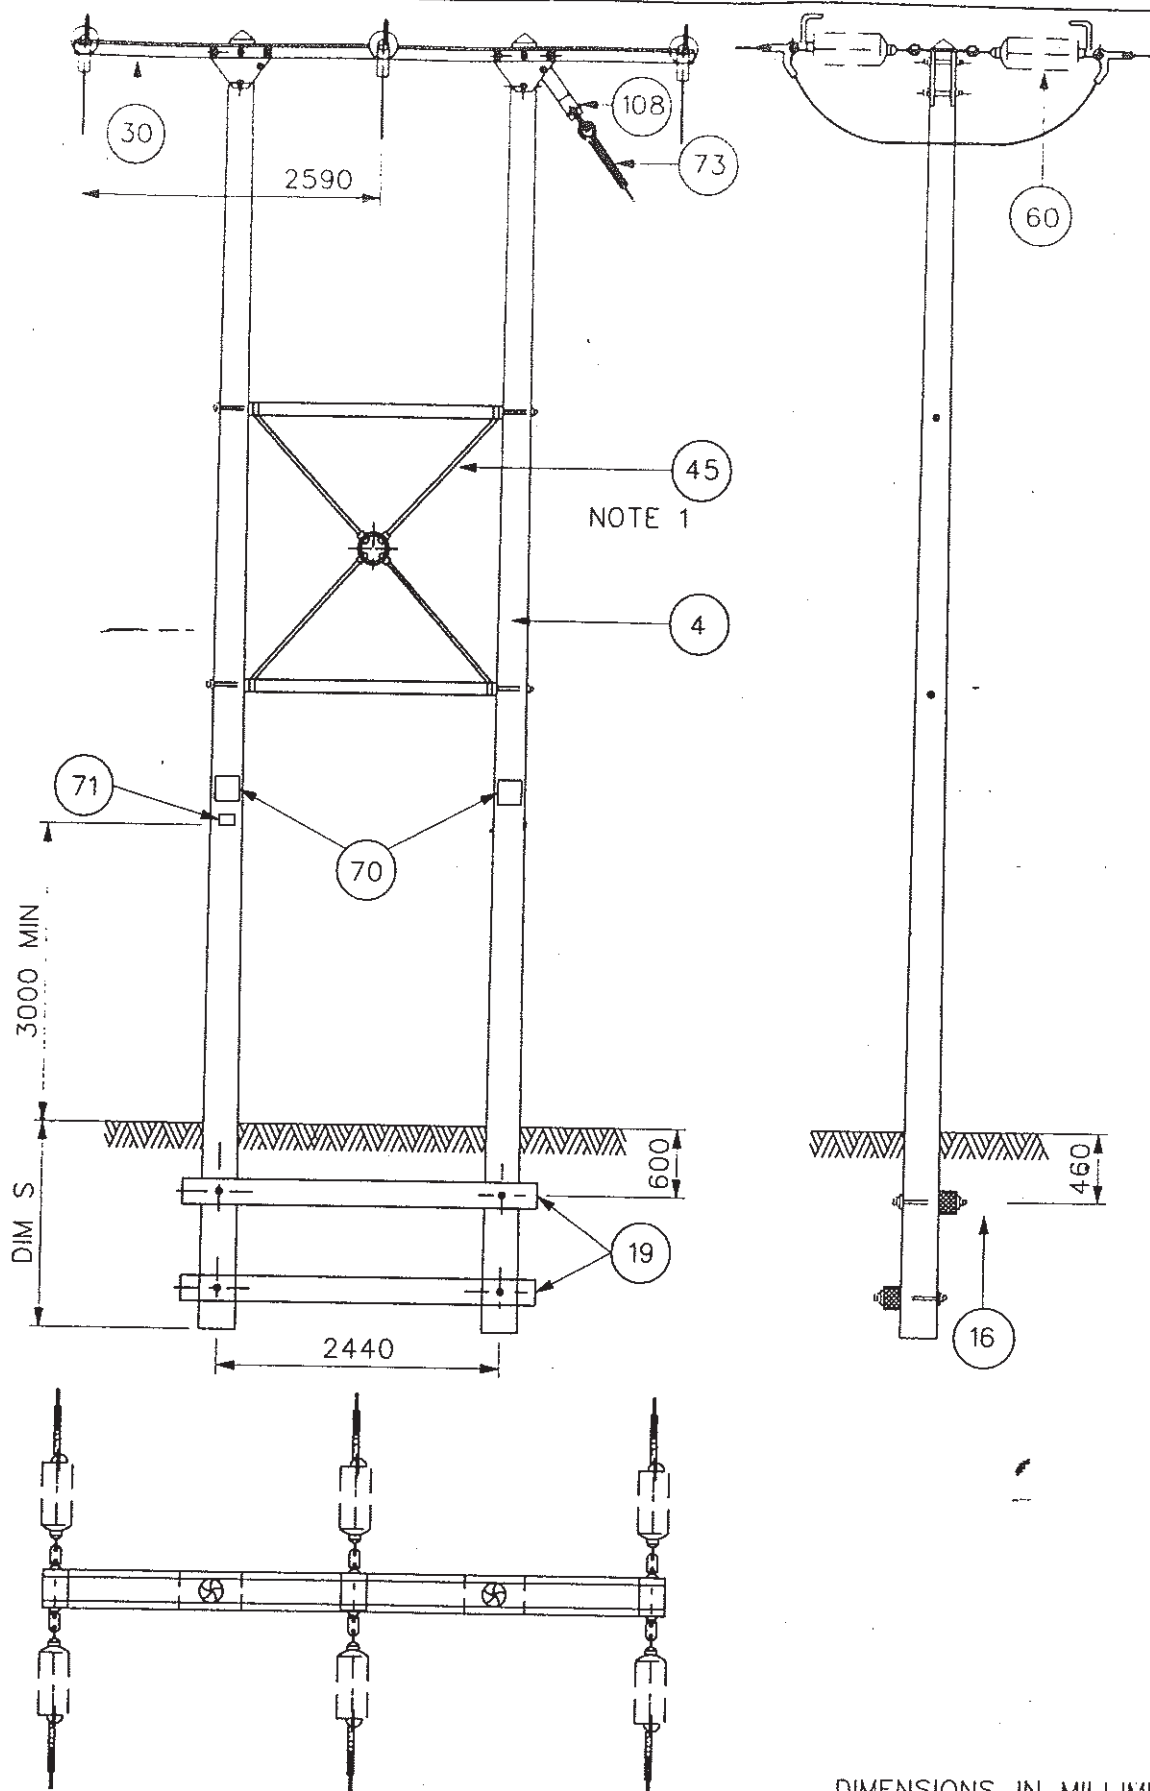

DIMENSIONS IN MILLIMETRES

drawn		GR	CE/C/37 (M1) ANGLE UP TO 10°				
traced		RLH					
checked							
approved							
revision	A	date	18.5.98	original scale	NTS	Y104L0114	



**Yorkshire
Electricity**