

MATERIALS LIST.

Item	Nº	Commodity Code	Description	Drawing or Ref. Number	M 20 Bolts	Washers		
						sc	sf	r
5	2	BPC 024	Wood Pole (type 3)	Y204 L 0601				
19	2	217497	Brace Block	Y204 L 0301	4(Pole)	4	4	
32	1	223669	Crossarm Member	Y204 L 0904	4 x 300			
45	1	219519	Pole Bracing(single)	Y204 L 0905				
		219501	Pole Bracing(double)					
60	9		33kV Tension Set	Y204 L 0704				
			66kV Tension Set					
70	2	294181	Safety Sign	Y201 L 1002				
71			Operational Plates	Y201 L 1001/7				
73	4		Stay Arrangement	Y204 L 0501				

* 8 off M20 x 45 bolts also required for gusset plates.

Notes to drawing Nº Y104 L 0116.

1. Single pole bracing required for poles up to 14.0m.

Double pole bracing required for poles 15.0m and above.


2. Alternative jumper position using 66kV post insulator, or 33kV pin or line post insulator, to be used where adequate clearances cannot be obtained with underslung jumper position.

3. Arrangement of concrete slack span support to drawing number Y003 S 3307.

Pole Planting Depth	
Pole Length (m)	Dim S (m)
<=11.5	1.80
12.0 - 13.0	2.00
14.0 - 15.0	2.10
16.0 - 17.0	2.25
18.0 - 20.0	2.40

Copyright of YORKSHIRE ELECTRICITY GROUP plc. No part of this drawing to be reproduced without prior permission.

Area: _____
 File: _____
 Plotted on: _____

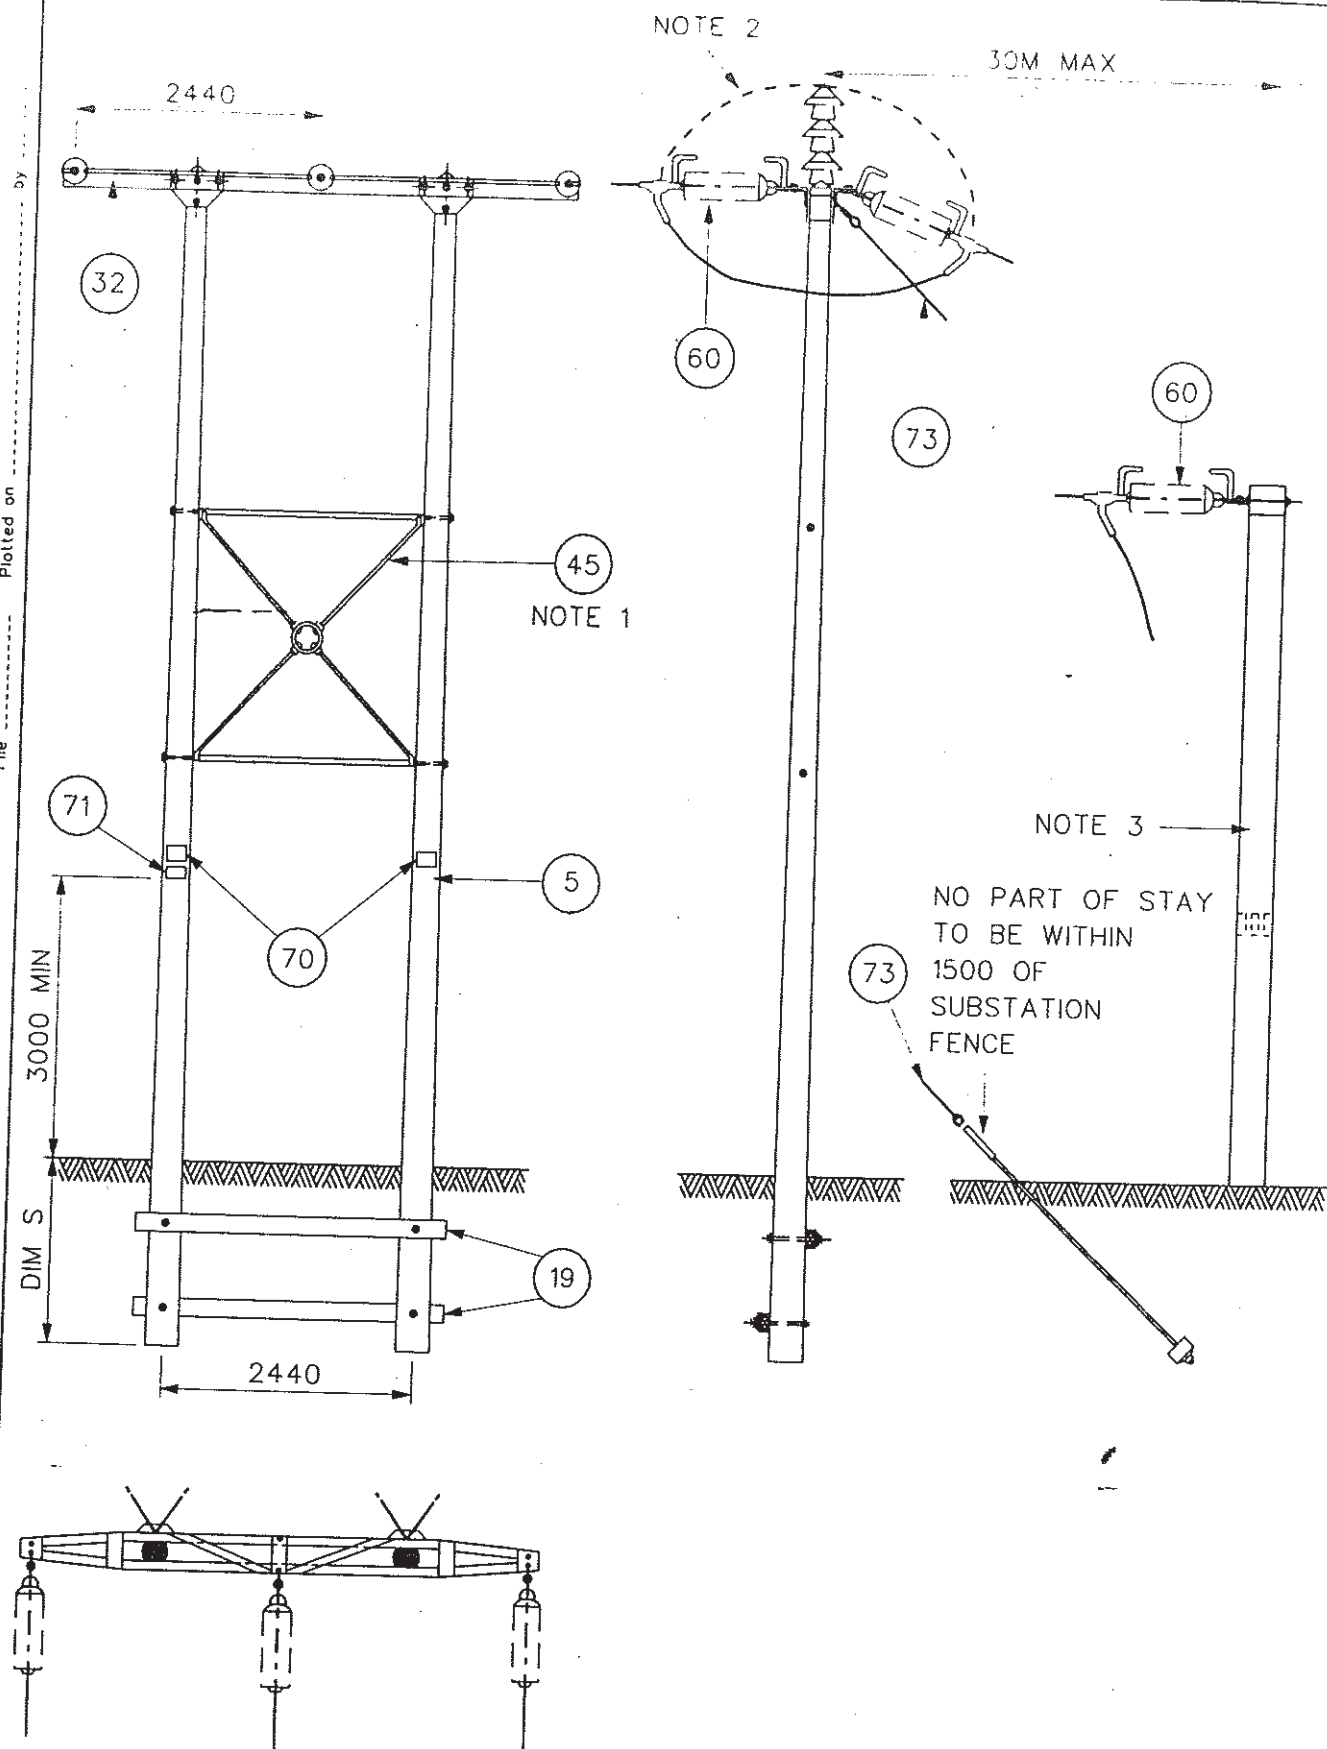

DIMENSIONS IN MILLIMETRES

drawn	BT	CE/C/37 (M1) SLACK SPAN TERMINAL		
traced	AJR			
checked	JMP			
approved				
revision	A	date 18-5-98	original scale NTS	Y104L0116



Yorkshire
Electricity

