
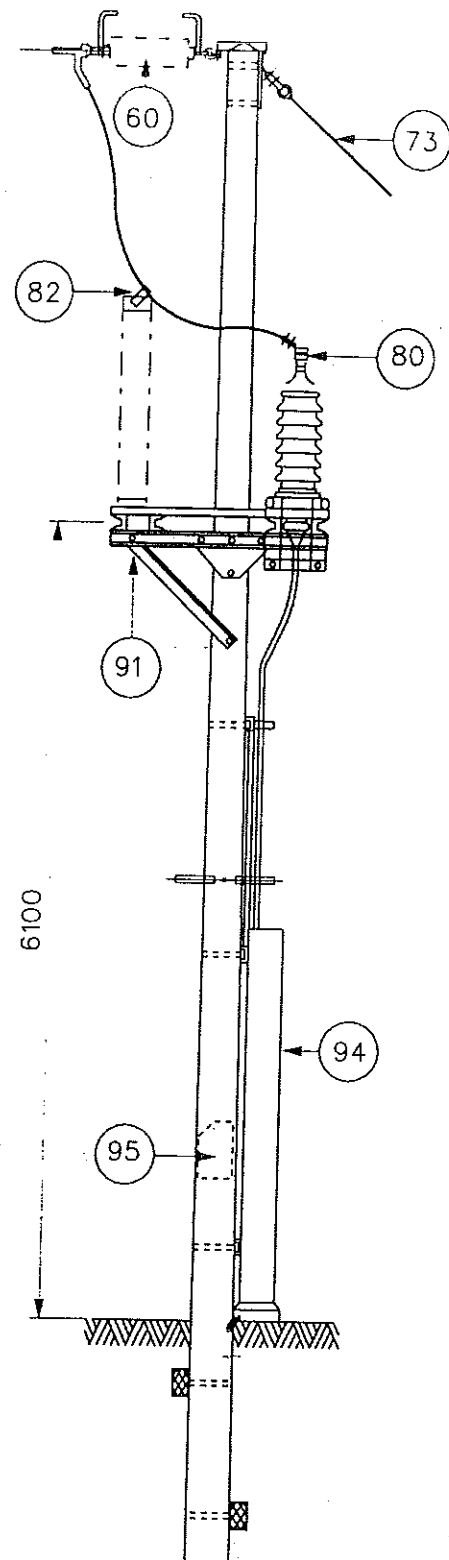


Copyright of YORKSHIRE ELECTRICITY GROUP plc. No part of this drawing to be reproduced without prior permission.

Area: _____
 File: _____
 Plotted on: _____ by: _____

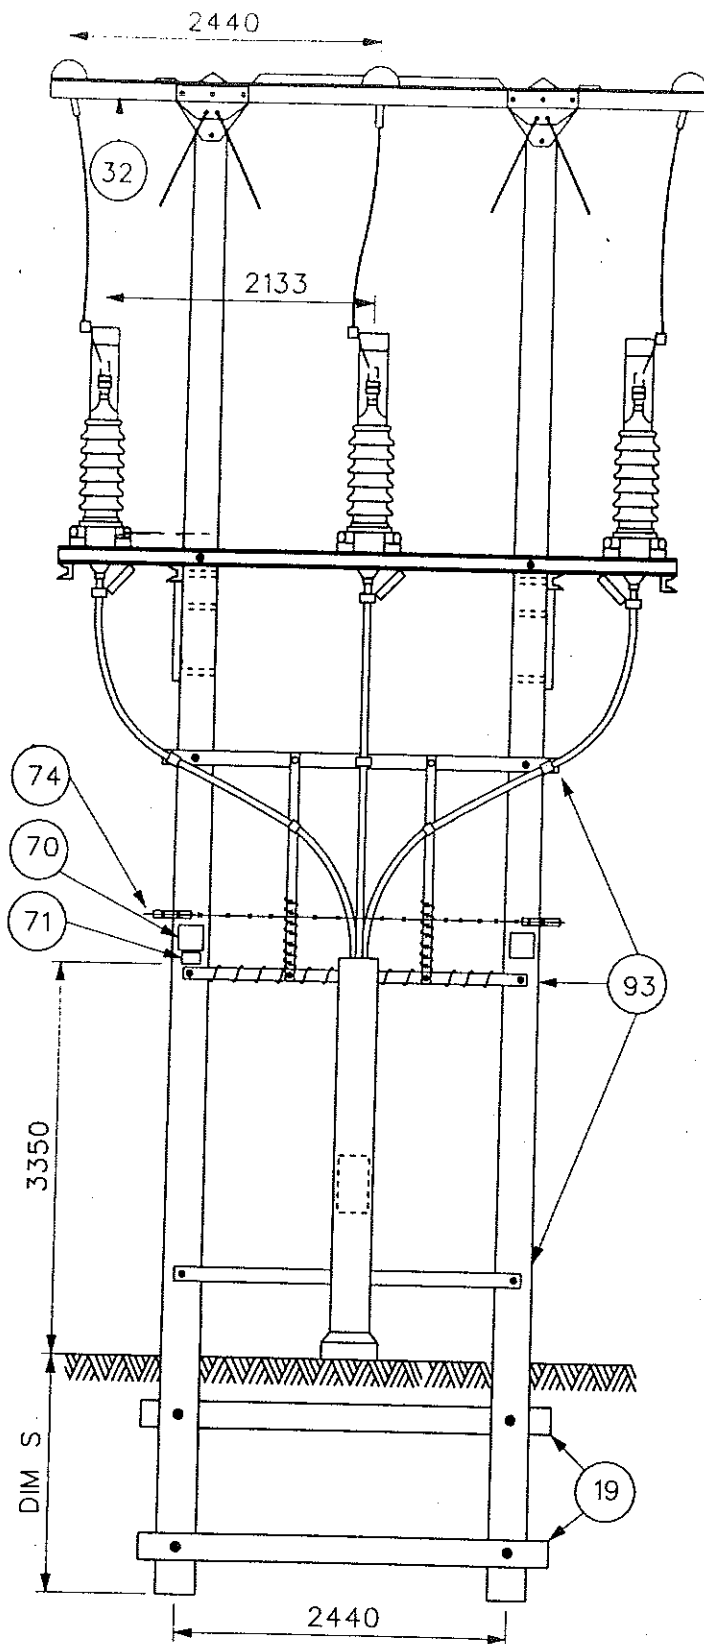

DIMENSIONS IN MILLIMETRES

drawn	BT	CE/C/37 (M1) CE/OM/DC1 66kV CABLE TERMINATION WITH SURGE DIVERTERS 11.5 TO 14 OM POLES		
traced	JEC			
checked	JMG			
approved				
revision	A	date	18.5.98	original scale
			NTS	Y104L0118



Yorkshire
Electricity



MATERIALS LIST.

Item	Nº	Commodity Code	Description	Drawing or Ref. Number	M 20 Bolts	Washers		
8	2	BPC 024	Wood Pole	Y204 L 0603		sc	sf	r
19	2	217497	Brace Block	Y204 L 0301	4(Pole)	4	4	
32	1	223669	Crossarm Member	Y204 L 0904	4 x 300			
60	3		33kV Tension Set	Y204 L 0704				
			66kV Tension Set					
70	2	294181	Safety Sign	Y201 L 1002				
71			Operational Plates	Y201 L 1001/7				
73	4		Stay Arrangement	Y204 L 0501				
74	1	224519	Anti- Climbing Guard	Y201 L 1101/2				
80	3		66kV Sealing End Connector	Y204 L 0801				
82	3	221119	Surge Diverter Connector	Y204 L 0803				
91	1	227116	66kV Sealing End P-form	Y204 L 0908	6(Pole)			
93	1		66kv Cable Supports	Y204 L 0910	6(Pole)			
94	1	224535	Cable Guard	Y204 L 0911	4 x 50			
95	1		Link Box	Eng Rec C55				

* 4 off M20 x 60 bolts also required for gusset plates.

Pole Planting Depth	
Pole Length (m)	Dim S (m)
<=11.5	1.80
12.0 - 13.0	2.00
14.0 - 15.0	2.10
16.0 - 17.0	2.25
18.0 - 20.0	2.40