

MATERIALS LIST.

Item	Nº	Commodity Code	Description	Drawing or Ref.Number	M 20 Bolts	Washers		
						sc	sf	r
12	1	BPC 024	Wood Pole (type 3)	Y205 L 0601				
20	2		Brace Block	Y205 L 0301	4(Pole)	4	4	
35	1		Crossarm Member	Y205 L 0903	see list			
42	4	223370	Crossarm Insert	Y205 L 0904				
46	1		Pole Bracing	Y205 L 0905				
56	4	215830 215863	33kV Line Post Insulator 66kV Line Post Insulator	Y204 L 0701				
60	12		33kV Tension Set 66kV Tension Set	Y204 L 0704				
70	1	294181	Safety Sign	Y201 L 1002				
71			Operational Plates	Y201 L 1001/7				
72			Circuit Identification Plates	Y201 L 1008				
73			Stay Arrangement	Y205 L 0501				
74	2	224519	Anti- Climbing Guard	Y201 L 1101/2				
75	4		Earthing Bracket	Y205 L 0906				
76	4		Flag Socket	Y205 L 0908				
77	4		Danger Notice Socket	Y205 L 0907				

Notes to drawing Nº Y105 L 0103.


1. 1520mm for poles up to 13.0m.
2286 for poles 14.0m and above.

2. Single pole bracing required for poles up to 14.0m.
double pole bracing required for poles 15.0m and above.

Bolt List.		
Application.	Bolt Detail.	Nº
Crossarm/Pole.	M20 x 300 c/w nut.	20
Crossarm/Insert.	M20 x 130* c/w nut.	16
Crossarm/Insert.	M20 x 200* c/w nut.	8
Crossarm/Gusset.	M20 x 60 c/w nut.	8
Crossarm/End Plate.	M16 x 50 c/w nut.	24


Pole Planting Depth.	
Pole Length (m)	Dim S (m)
<= 14.0	2.3
> 14.0	2.44

*16 off 100 x 100 x 6 square flat washers required.
+8 off 75 x 75 x 6 square flat washers required.

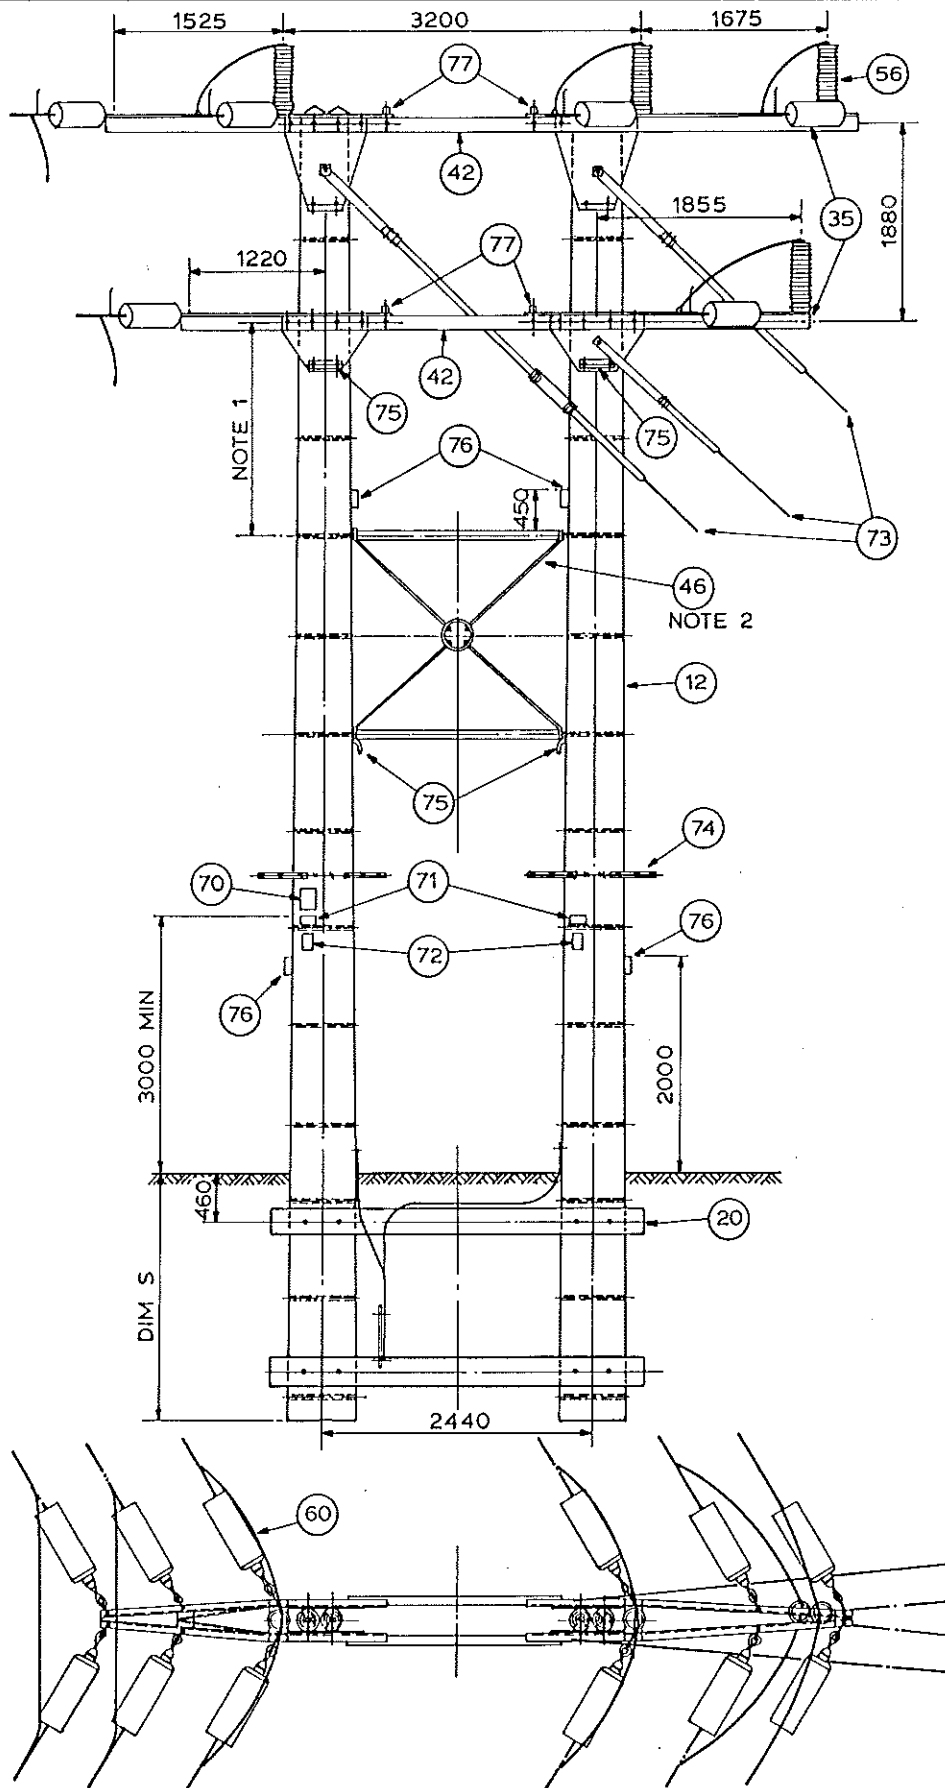

DIMENSIONS IN MILLIMETRES

drawn	BT	CE/OM/DC1 ANGLE			 Yorkshire Electricity
traced	IPM				
checked	JMP				
approved	BT				
revision	date	31-3-89	original scale	Y105L0103	



TO/FI	DRG. NO.	Y003 X
-------	----------	--------

YORKSHIRE ELECTRICITY BOARD - HEAD OFFICE					
OVERHEAD LINES SPEC DCI					
CROSSARM STEELWORK FOR ANGLE SUPPORT.					
SCALE:-					
DRG. NO. Y003 X 3314					
1" = 10' / FT					
WHERE QUOTING THIS DRG. No. IN EACH STATE LATEST EDITION OF ISSUE.					