


ISSUED

26 MAR 1999

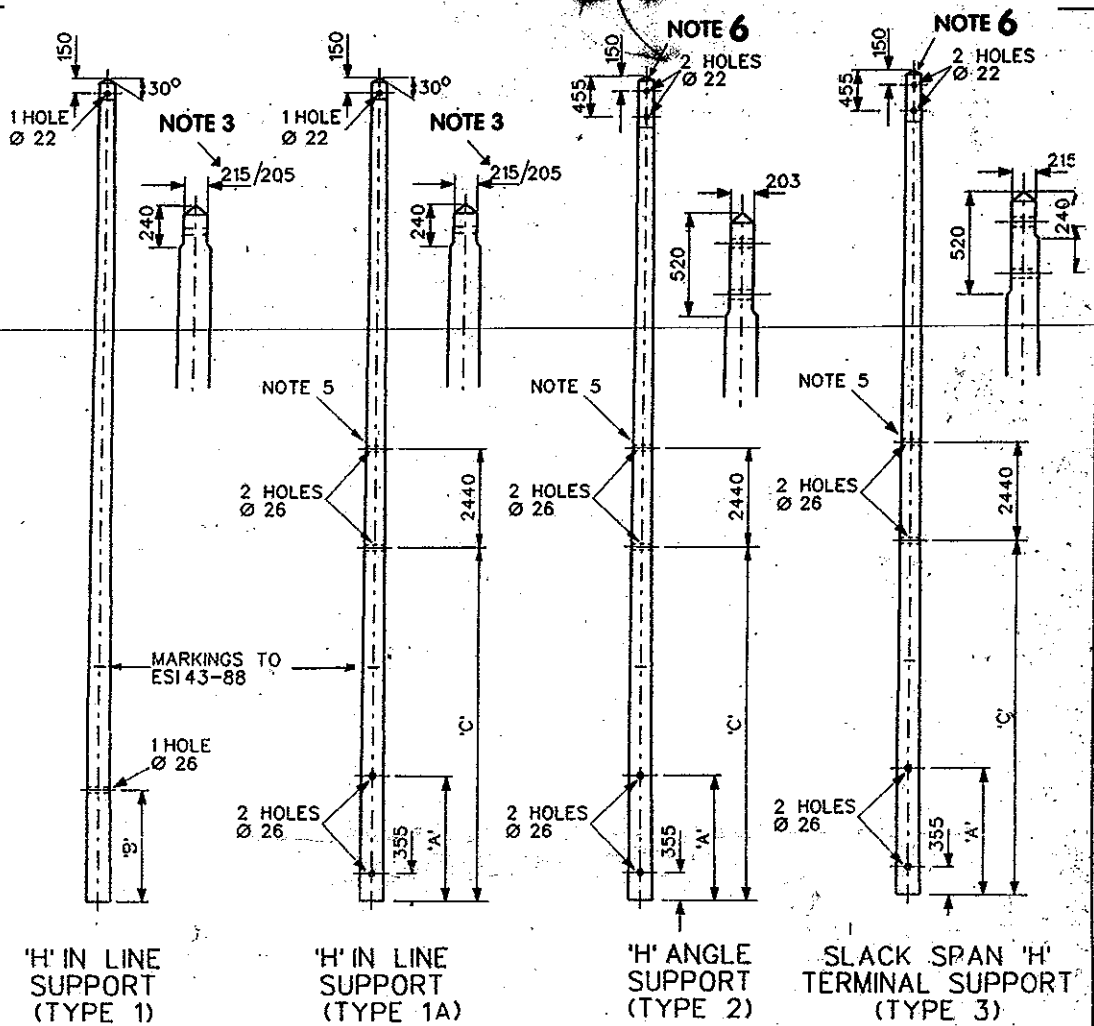

NOTES

POLE LENGTH (m)	DIM 'A' (m)	DIM 'B' (m)	DIM 'C' (m)
UP TO 11.5	1.2	1.4	6.0
12.0 TO 13.0	1.4	1.5	6.0
14.0	1.5	1.7	6.0
15.0	1.5	1.7	6.0
16.0 & 17.0	1.7	1.8	7.0
18.0	1.8	2.0	8.0
20.0	1.8	2.0	10.0
22.0	1.8	2.0	12.0

DIMENSIONS IN MILLIMETRES

- POLES TO BE 'STOUT CLASS' TO BS 1990, CREOSOTED TO BS913 BY RUPEING PROCESS, AFTER FABRICATION
- POLES TO BE MATCHED FOR H STRUCTURES, EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS
- MINIMUM POLE TOP DIAMETER 205mm FOR INTERMEDIATES, 215mm FOR SECTION POLES. SCARFING ONLY REQUIRED WHERE POLE TOP DIAMETER EXCEEDS THESE DIMENSIONS
- ALL HOLES DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE
- 1 ADDITIONAL HOLE AT 2440 INTERVAL FOR POLES OVER 14m
- ANGLE AND TERMINAL POLES TO HAVE A POLE TOP DIAMETER NOT LESS THAN 20mm ABOVE THE MINIMUM SPECIFIED IN BS 1990 TABLE 3 BEFORE SCARFING

Copyright of the YORKSHIRE ELECTRICITY GROUP plc. No part to be reproduced without prior permission.

drawn SLJ

traced

checked

approved

revision D

date 25/03/99

original scale Not to scale

POLE FABRICATION
INTERMEDIATE, ANGLE AND
SLACK SPAN TERMINAL
CE/C/37(M1)

Y204L0601

CAD



Yorkshire
Electricity