
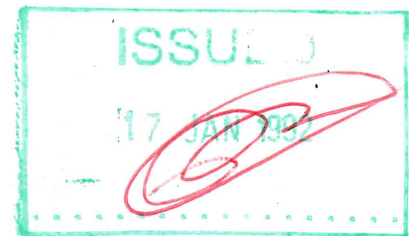
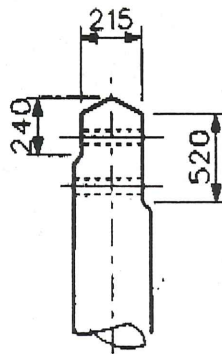



22

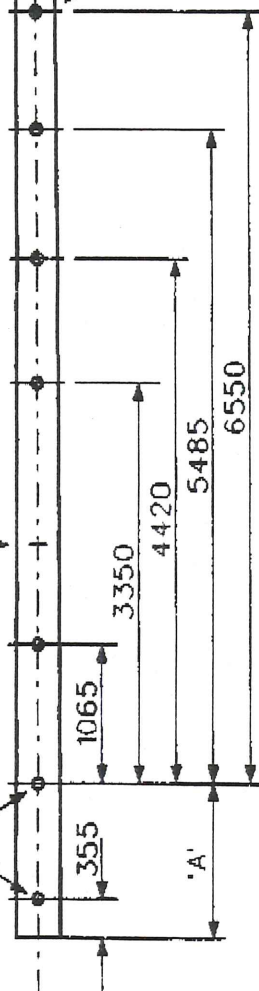

NOTE 5

MARKING TO
ESI 43-882 HOLES
Ø 26

NOTES

- 1 POLES TO BE 'STOUT CLASS' TO BS 1990, CREOSOTED TO BS 913 BY RUEPING PROCESS, AFTER FABRICATION
- 2 POLES TO BE MATCHED FOR H STRUCTURES, EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS
- 3 MINIMUM POLE TOP DIAMETER 215mm
- 4 ALL HOLES Ø 22 (UNLESS DETAILED OTHERWISE), DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE
- 5 1 ADDITIONAL HOLE AT 1065 INTERVAL FOR 12 AND 13m POLES
2 ADDITIONAL HOLES AT 1065 INTERVAL FOR 14m POLES

POLE LENGTH (m)	DIMENSION 'A' (m)
11.0-11.5	1.4
12.0-14.0	1.5

DIMENSIONS IN MILLIMETRES

drawn BT

traced JEC

checked JMP

approved

revision

date 30-8-90

original
scale

POLE FABRICATION
33kV CABLE TERMINATION
WITH SURGE DIVERTERS
CE/C/37M

Y204L0602

CAD



Yorkshire
Electricity