


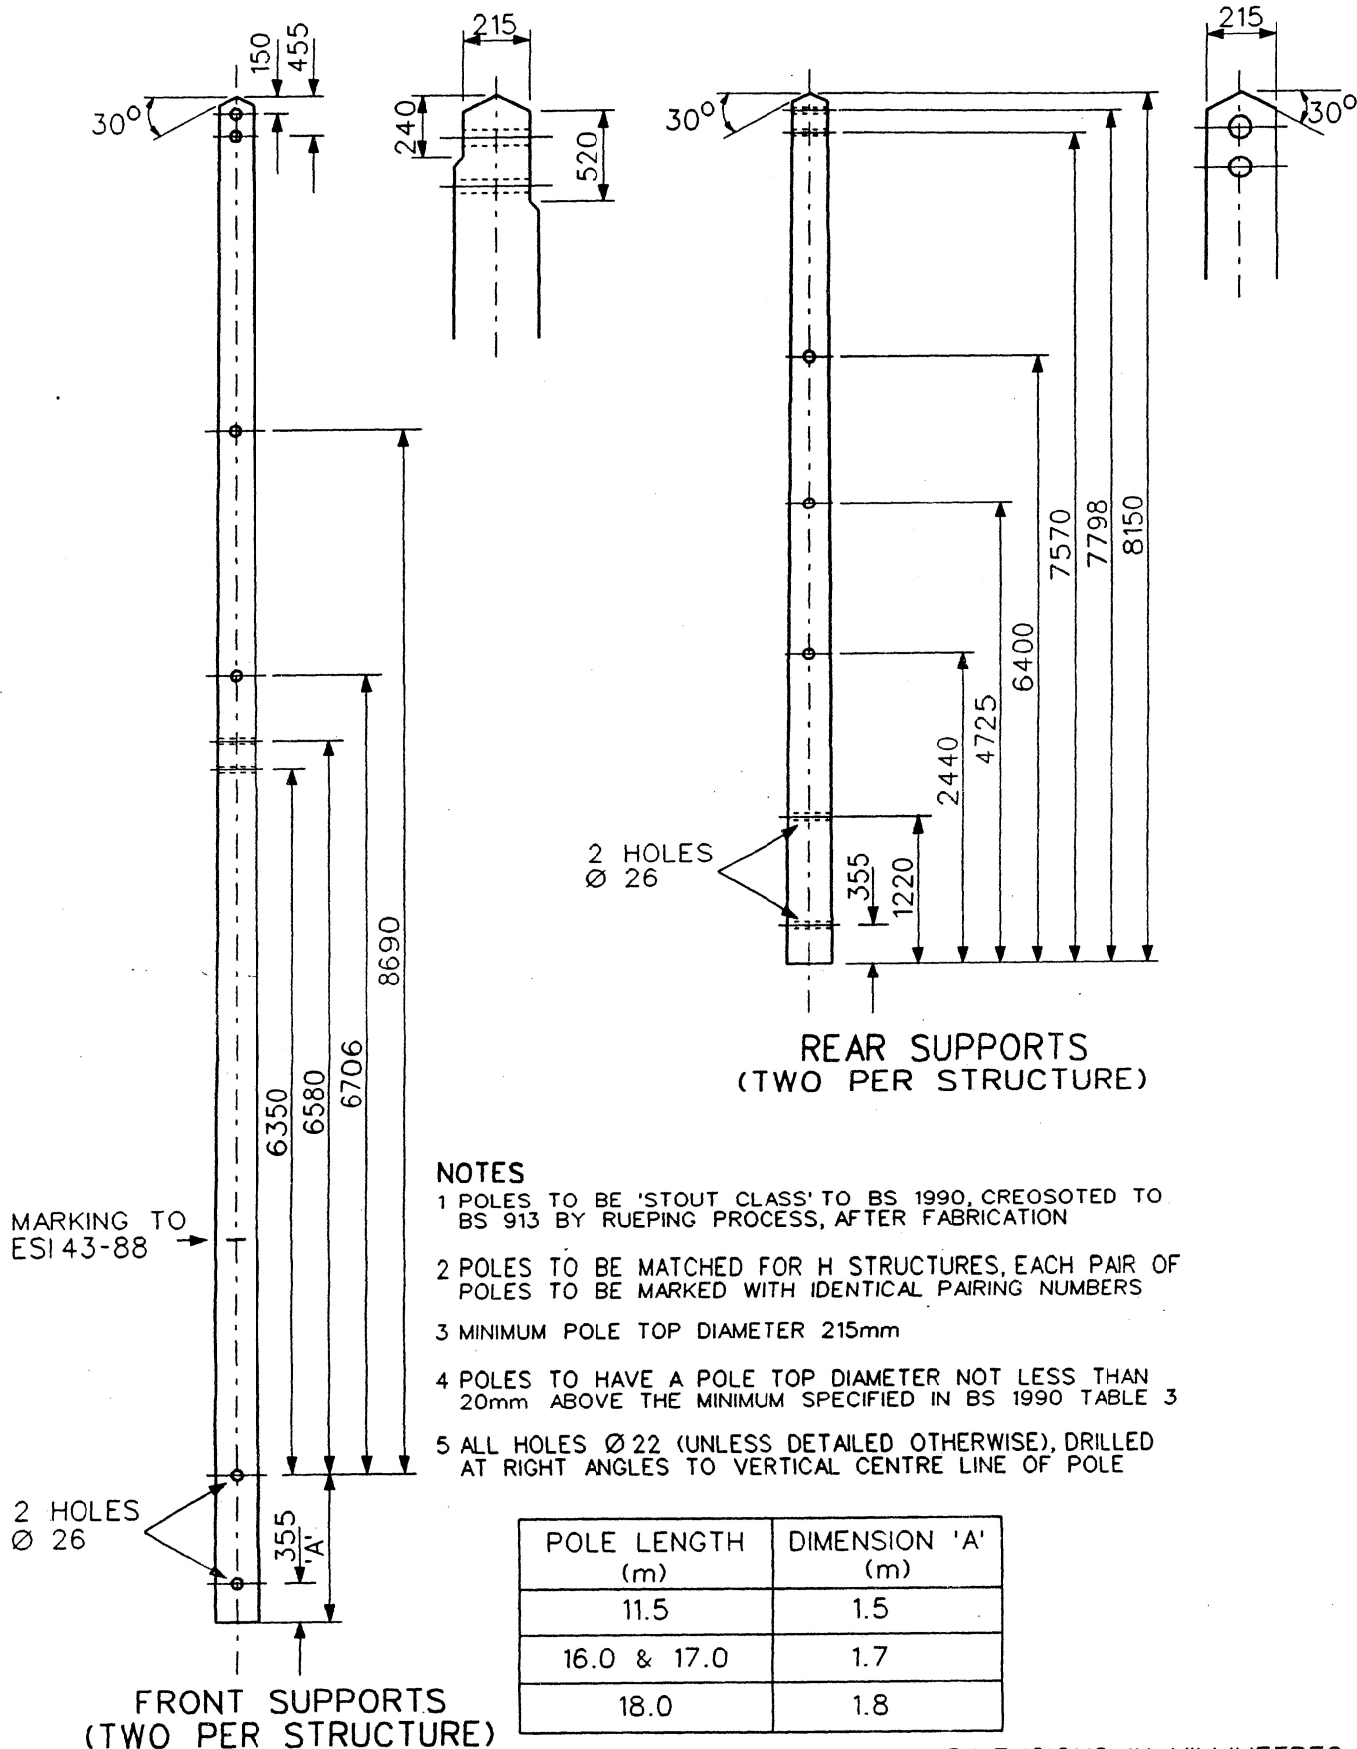

DIMENSIONS IN MILLIMETRES

drawn	BT	POLE FABRICATION 66kV CABLE TERMINATION WITH SURGE DIVERTERS 15.0-18.0m POLES		 Yorkshire Electricity
traced	JEC			
checked	JMP			
approved				
revision	date 31-8-90	original scale	Y204L0604	CAD