

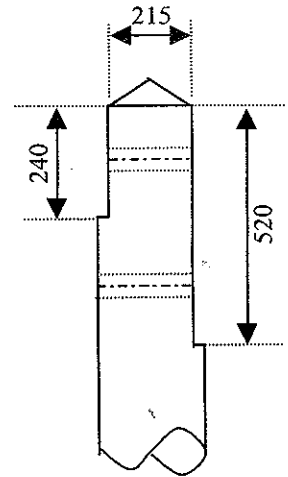


36

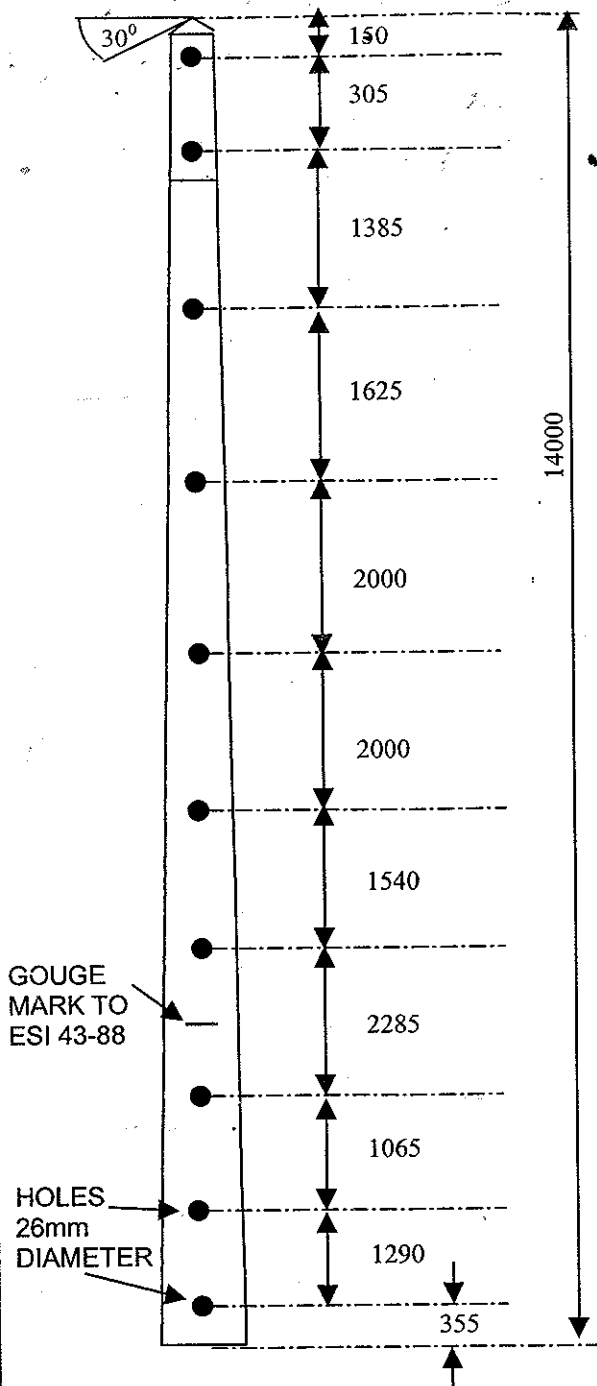

NOTES

1. POLES TO BE "STOUT" CLASS.
2. POLES TO BE MATCHED FOR "H" STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS.
3. ALL HOLES TO BE 22mm DIAMETER (EXCEPT WHERE STATED) TO BE DRILLED AT RIGHT ANGLES TO THE CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.

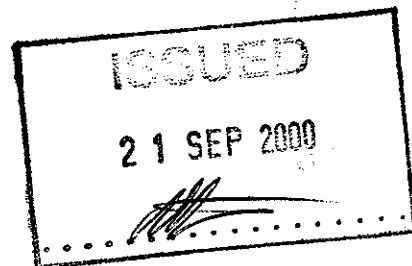

DIMENSIONS IN MILLIMETRES

Drawn: S.L.J	14 Metre Pole fabrication		Page 4 of 9
Traced:	Pole fabrication for 33 KV Polymeric Cable Termination with Porcelain Type HEC36 Surge Diverters CE/C/37(M1)		
Checked: M.S.			
Approved: I.S.			
Revision: A	Date: 17/04/00	Scale: N.T.S.	Y204L0605