


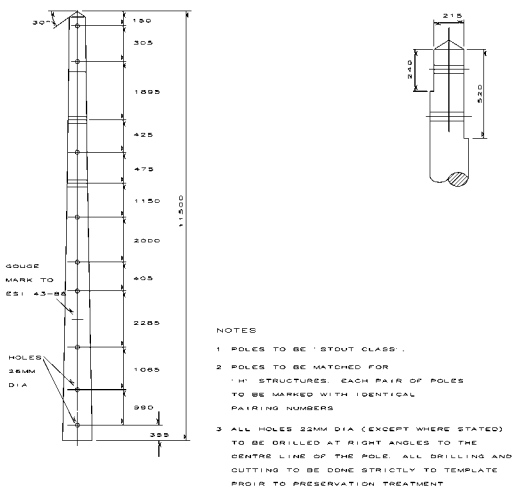

DIMENSIONS IN MILLIMETRES

6. L. J. 11.5 METRE POLE FABRICATION: 1 OF 2


6. M. POLE FABRICATION

M. S. 66KV POLYMERIC CABLE TERMINATION

WITH PORCELAIN TYPE MB75 SURGE DIVERTORS


1. S. GE/G/37(MH)

0 17.04.00 NTS Y204L0606

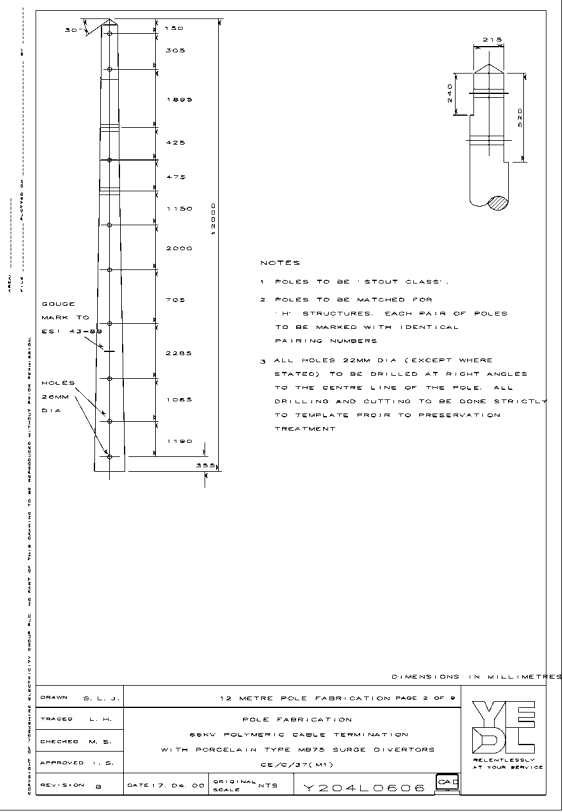


DIMENSIONS IN MILLIMETRES

DRAWN S. L. J. TRAGED L. H. CHECKED M. S. APPROVED J. S. REVISION B	12 METRE POLE FABRICATION PAGE 2 POLE FABRICATION 66KV POLYMERIC CABLE TERMINATION WITH PORCELAIN TYPE M975 SURGE DIVERTORS CE/C/37(M1) DATE 17.04.00 ORIGINAL NTS SCALE Y204L0606
---	--

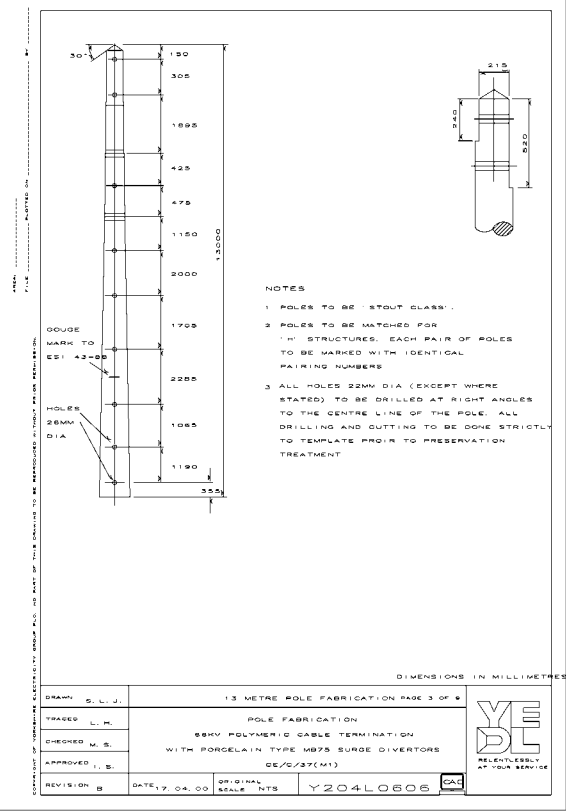


DIMENSIONS IN MILLIMETRES

DRAWN: S. L. J.		13 METRE POLE FABRICATION PAGE 3 OF 3	
TRACED: L. M.		POLE FABRICATION	
CHECKED: W. S.		88KV POLYMERIC CABLE TERMINATION	
APPROVED: I. S.		WITH PORCELAIN TYPE MB75 SURGE DIVERTORS	
		CE/037(M1)	
REVISION: B	DATE: 17.04.00	ORIGINAL SCALE: NTS	Y204L0606 C

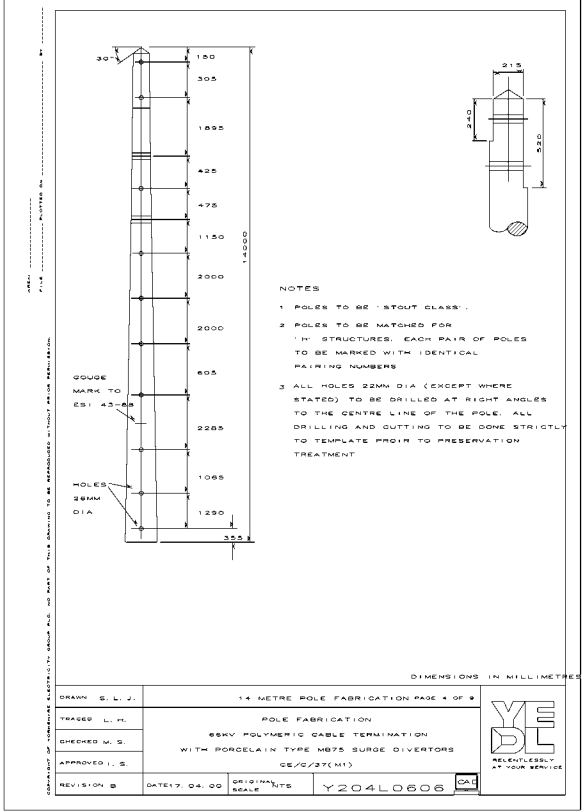


DIMENSIONS IN MILLIMETRES

DRAWN S. L. J.		14 METRE POLE FABRICATION PAGE 4 OF 4	
TRAGED L. H.		POLE FABRICATION	
CHECKED W. S.		85KV POLYMERIC CABLE TERMINATION WITH PORCELAIN TYPE MB75 SURGE DIVERTORS	
APPROVED I. S.		GE/C/37(M1)	
REVISION B	DATE 17.04.09	ORIGINAL SCALE	1:1 Y204L0606 C

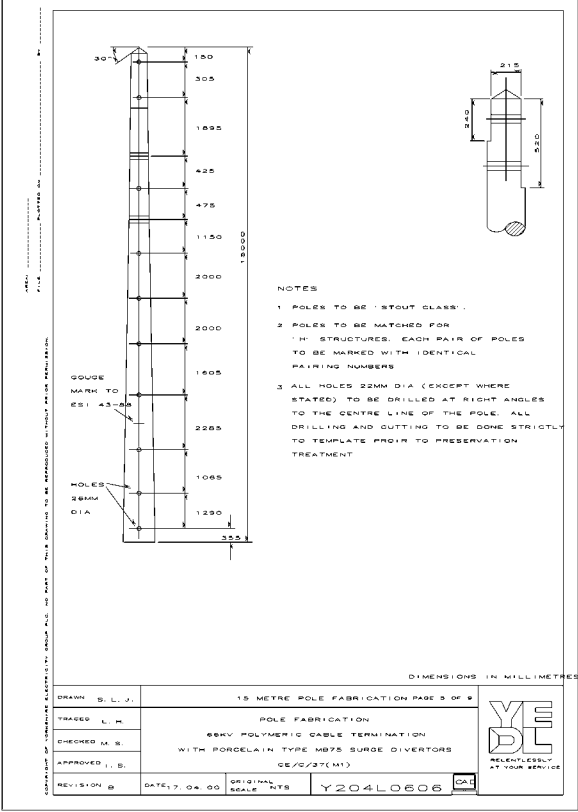


DIMENSIONS IN MILLIMETRES

DRAWN S. L. J.		15 METRE POLE FABRICATION PAGE 3 OF 3	
TRAGED L. H.		POLE FABRICATION	
CHECKED A. M.		SERV POLYMERIC CABLE TERMINATION	
APPROVED I. B.		WITH PORCELAIN TYPE MB75 SURGE DIVERTORS	
		CE/37(M1)	
REVISION B	DATE 17.04.00	ORIGINAL SCALE NTS	Y204L0606
			OK

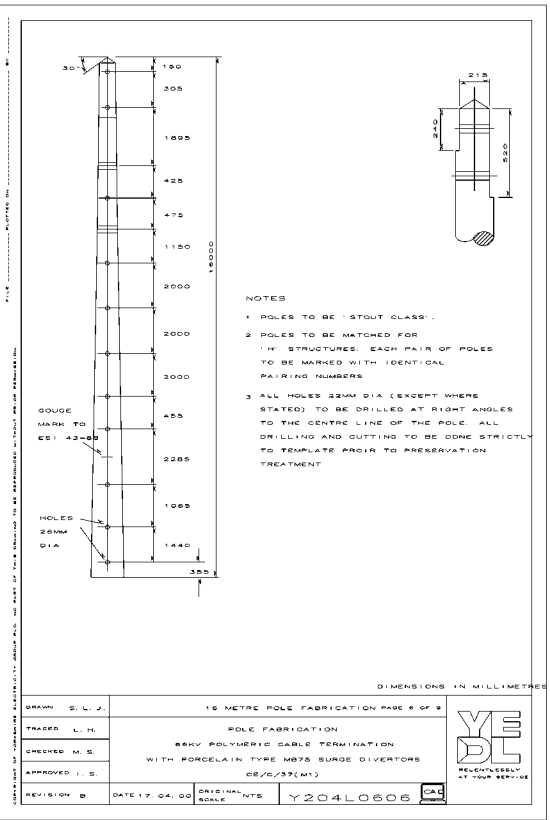


DIMENSIONS IN MILLIMETRES

DRAWN S. L. J.		16 METRE POLE FABRICATION PAGE 6	
TRACED L. H.		POLE FABRICATION	
CHECKED M. S.		80KV POLYMERIC CABLE TERMINATION	
APPROVED I. S.		WITH FOLYMERIN TYPE M875 SURGE DIVERTORS	
		GR/6/37(M1)	
REVISION D	DATE 17.04.00	ORIGINAL SCALE NTS	Y204L0606

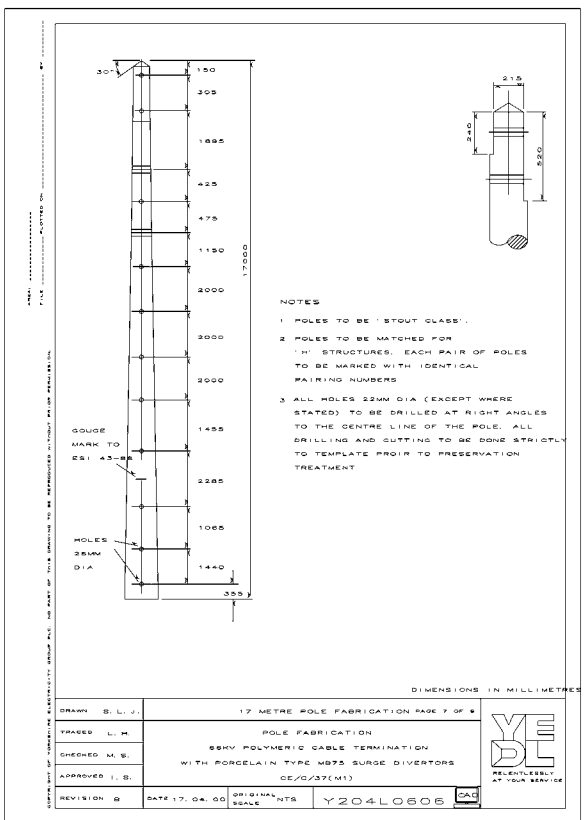


DIMENSIONS IN MILLIMETRES

DRAWN: B. L. J.		17 METRE POLE FABRICATION PAGE 7 OF 8	
TRACED: L. M.		POLE FABRICATION	
SKEETCHED: M. S.		55KV POLYMERIC CABLE TERMINATION	
		WITH FOLYMERIN TYPE MB75 SURGE DIVERTORS	
APPROVED: J. S.		CE/G/37(M)	
REVISION: 2	DATE: 17. 04. 00	ORIGINAL SCALE: NTS	Y204L0606

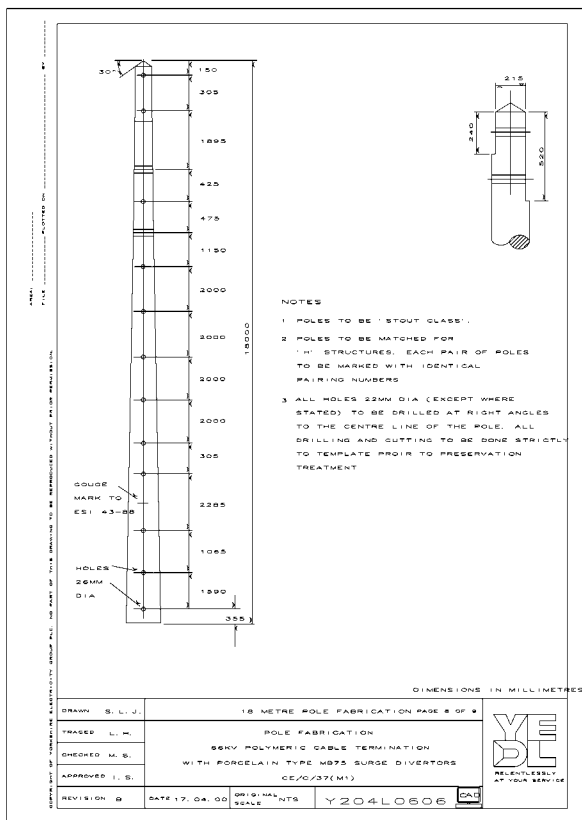

DIMENSIONS IN MILLIMETRES

DRAWN S. L. J.		18 METRE POLE FABRICATION PAGE 8 OF 8	
TRACED L. M.		POLE FABRICATION	
CHECKED M. S.		66KV POLYMERIC CABLE TERMINATION	
APPROVED I. S.		WITH ORIGINAL TYPE MB75 SURGE DIVERTORS	
		CE/C/37(M)	
REVISION 0	DATE 17.04.00	ORIGINAL SCALE	NTS
			Y204L0606

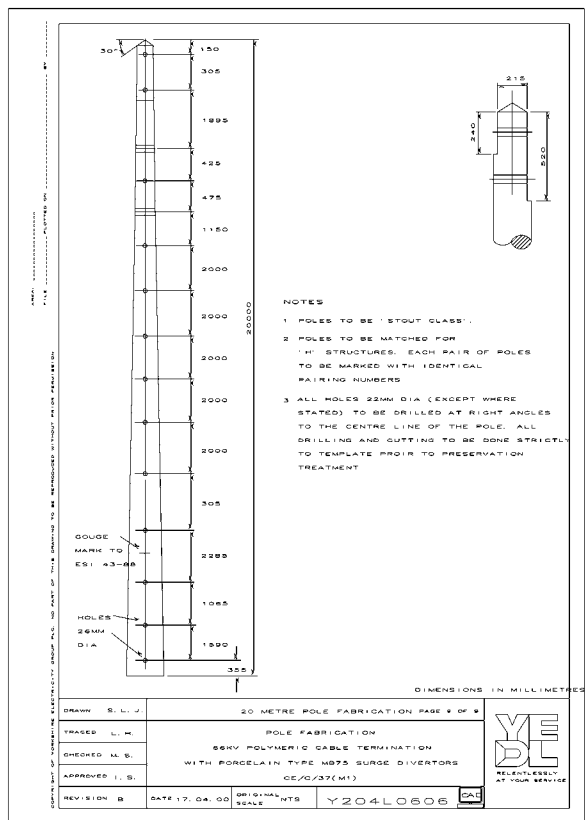

DIMENSIONS IN MILLIMETRES

DRAWN S. L. D.		20 METRE POLE FABRICATION PAGE 2 OF 2	
TRACED L. M.		POLE FABRICATION	
CHECKED M. B.		50KV POLYMERIC CABLE TERMINATION	
APPROVED I. S.		WITH TERMINATION TYPE MB75 SURGE DIVERTORS	
		CE/C/37(M1)	
REVISED BY	DATE 17.04.00	ORIGINAL SCALE NTS	Y204L0606