
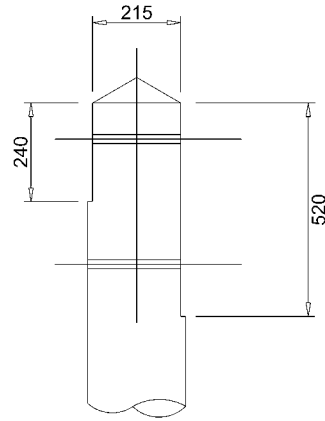


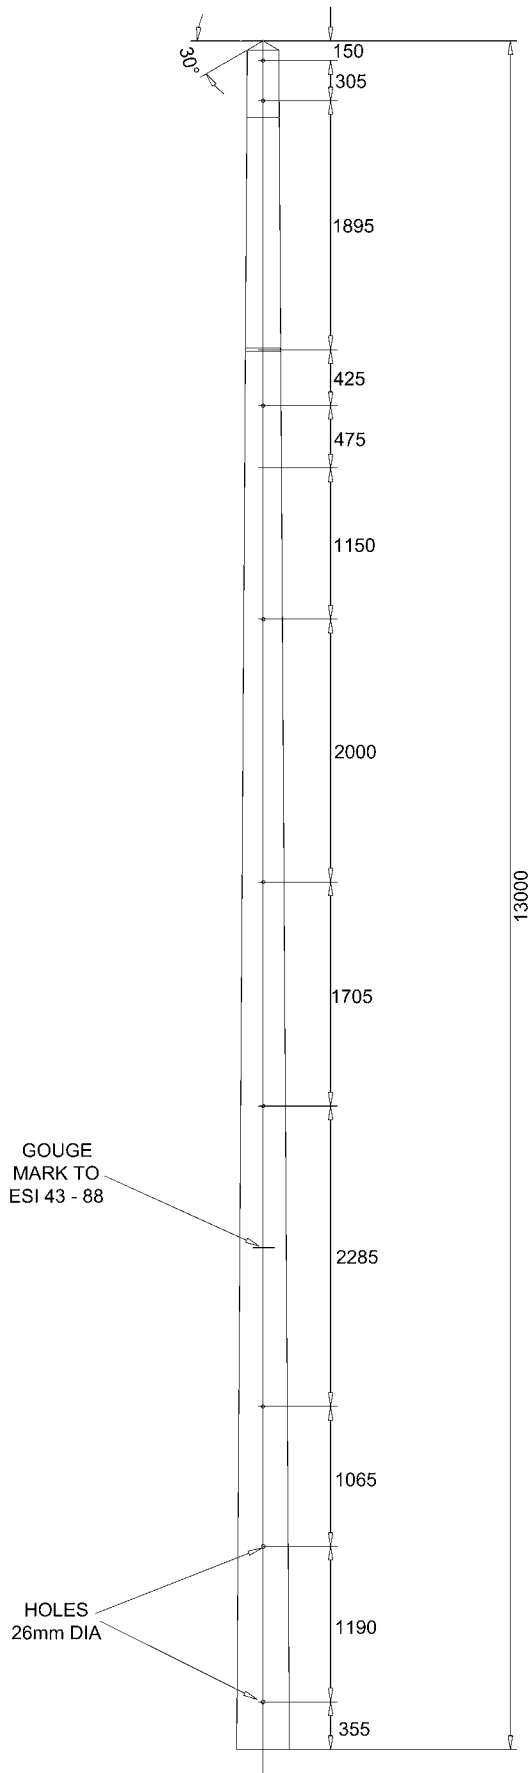

NOTES

1. POLES TO BE 'STOUT CLASS'.
2. POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS.
3. ALL HOLES 22mm DIA (EXCEPT WHERE STATED) TO BE DRILLED AT RIGHT ANGLES TO THE CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT

13 METRE POLE FABRICATION

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES
UNLESS OTHERWISE STATED

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		POLE FABRICATION 66KV POLYMERIC CABLE TERMINATION WITH PORCELAINN TYPE MB75 SURGE DIVERTORS CE / C / 37 (M1)	
Sheet No. 3	Scale N.T.S.		
Prepared By Janis.Webb		Type OVERHEAD	POLES
Revised 24/01/07	Grid Reference	Ref No. C944264	Historic Drg.No. Y204L0606
Date Issued 22/01/07	Checked By G HAMMEL		
		Revision	Notes