
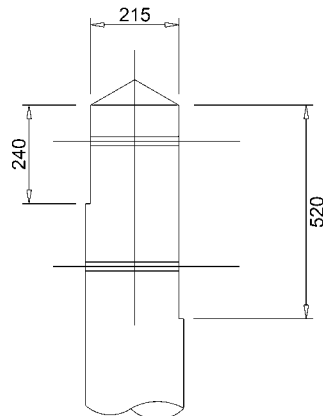


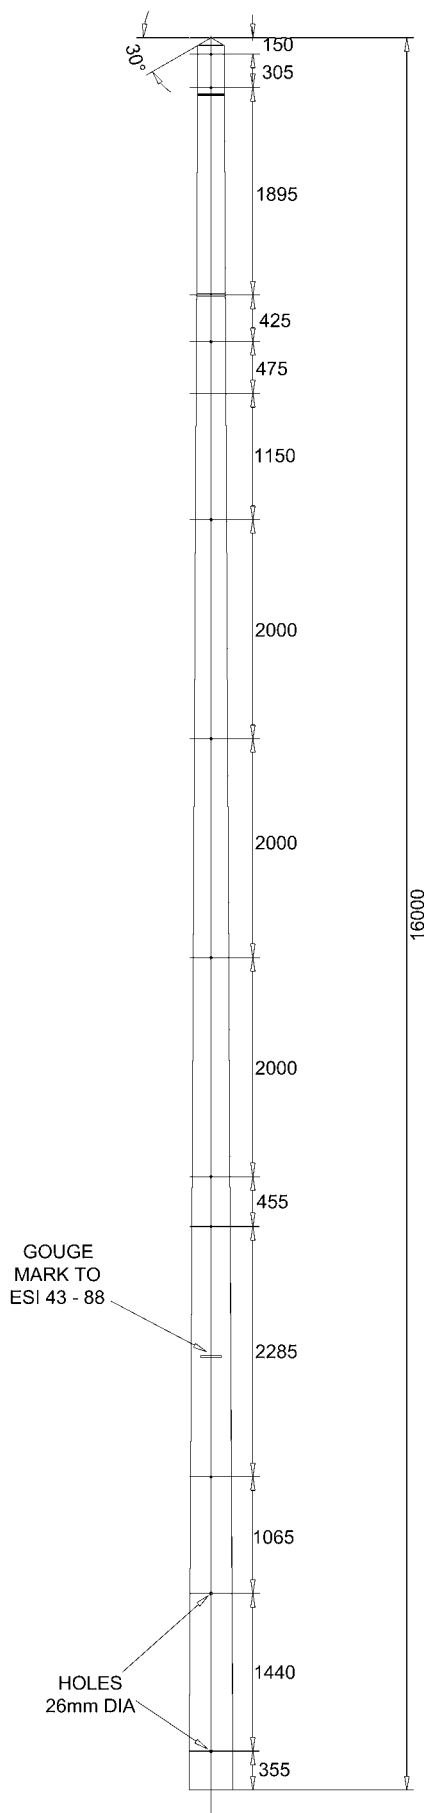

NOTES

1. POLES TO BE 'STOUT CLASS'.
2. POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS.
3. ALL HOLES 22mm DIA (EXCEPT WHERE STATED) TO BE DRILLED AT RIGHT ANGLES TO THE CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT

16 METRE POLE FABRICATION

ALL DIMENSIONS SHOWN ARE IN
MILLIMETRES UNLESS OTHERWISE STATED

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		POLE FABRICATION 66KV POLYMERIC CABLE TERMINATION WITH PORCELAIN TYPE MB75 SURGE DIVERTORS CE / C / 37 (M1)	
Sheet No. 6	Scale N.T.S.	Type OVERHEAD POLES	
Prepared By Janis.Webb		Ref No.	Historic Drg.No.
Revised 24/01/07		C944268	Y204L0606
Date Issued 22/01/07		Checked By G HAMMEL	Revision Notes