
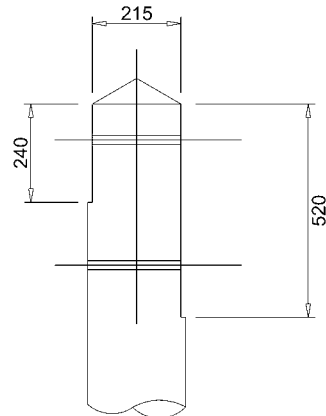


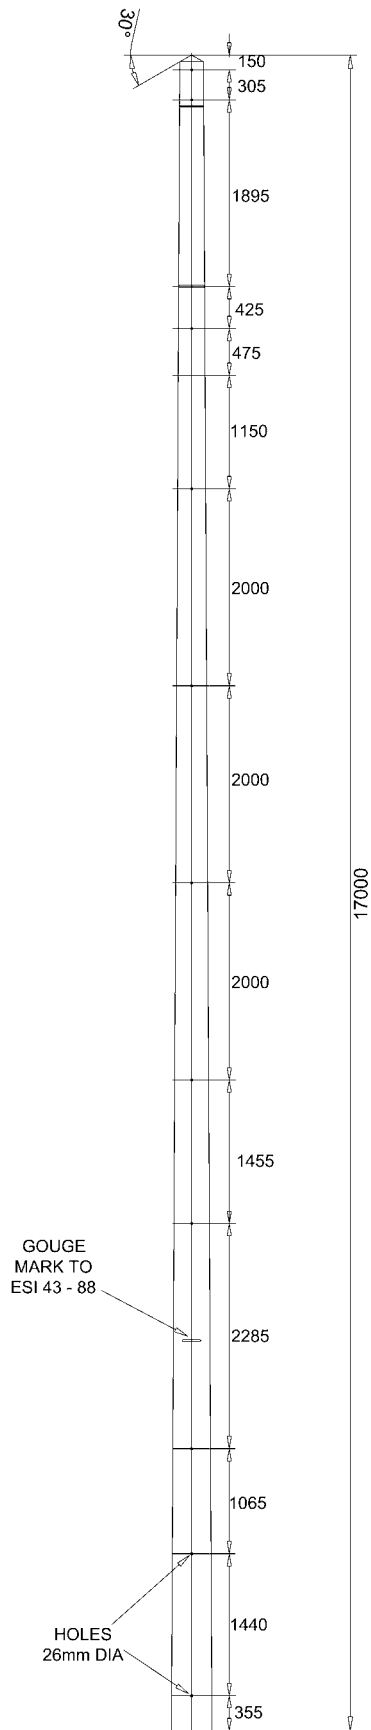

NOTES

1. POLES TO BE 'STOUT CLASS'.
2. POLES TO BE MATCHED FOR 'H' STRUCTURES. EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS.
3. ALL HOLES 22mm DIA (EXCEPT WHERE STATED) TO BE DRILLED AT RIGHT ANGLES TO THE CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT

16 METRE POLE FABRICATION

ALL DIMENSIONS SHOWN ARE IN
MILLIMETRES UNLESS OTHERWISE STATED

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		POLE FABRICATION 66KV POLYMERIC CABLE TERMINATION WITH PORCELAIN TYPE MB75 SURGE DIVERTORS CE / C / 37 (M1)	
Sheet No. 7	Scale N.T.S.	Type OVERHEAD	POLES
Prepared By Janis.Webb	Grid Reference	Ref No. C944269	Historic Drg.No. Y204L0606
Revised 24/01/07	Checked By G HAMMEL	Revision	Notes
Date Issued 22/01/07			