
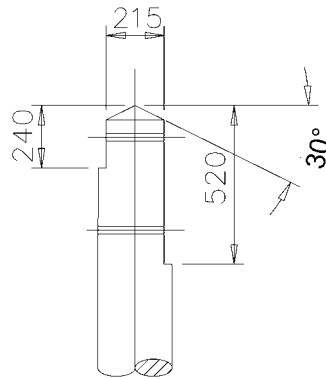


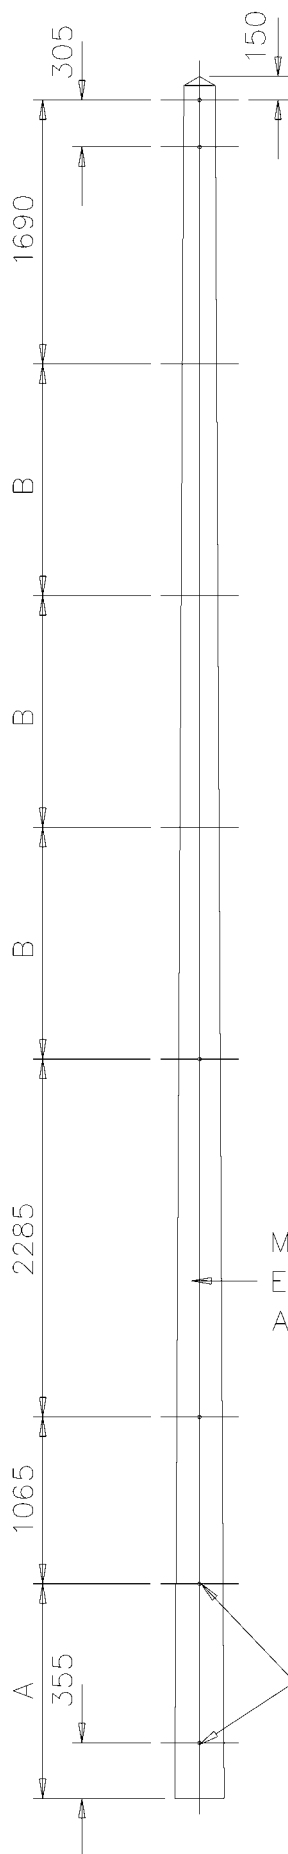

NOTES

- 1 POLES TO BE 'STOUT CLASS' TO BS 1990, CREOSOTED TO BS 913 BY RUEPING PROCESS, AFTER DRILLING & SCARFING
- 2 POLES TO BE MATCHED FOR H STRUCTURES, EACH PAIR OF POLES TO BE MARKED WITH IDENTICAL PAIRING NUMBERS
- 3 MINIMUM POLE TOP DIAMETER 215mm
- 4 ALL HOLES 22 DIA UNLESS STATED OTHERWISE DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE
- 5 FOR ARRANGMENT DRG SEE Y208L0101

POLE LENGTH (M)	DIMENSION 'A' (mm)	DIMENSION 'B' (mm)
11.0	1370	1480
11.5	1530	1593
12.0	1530	1760

DIMENSIONS IN MILLIMETRES

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		POLE FABRICATION	
Sheet No. 1	Scale N.T.S.	33KV POLYMERIC CABLE TERMINATION WITH TYPE HEC 36 SURGE DIVERTERS CE / C / 36 (M)	
Prepared By Janis.Webb		Type OVERHEAD	LINES
Revised 30/05/07	Grid Reference	Ref No. C948806	Historic Drg.No. Y208L0601
Date Issued 29/05/07	Checked By	Revision B Notes	