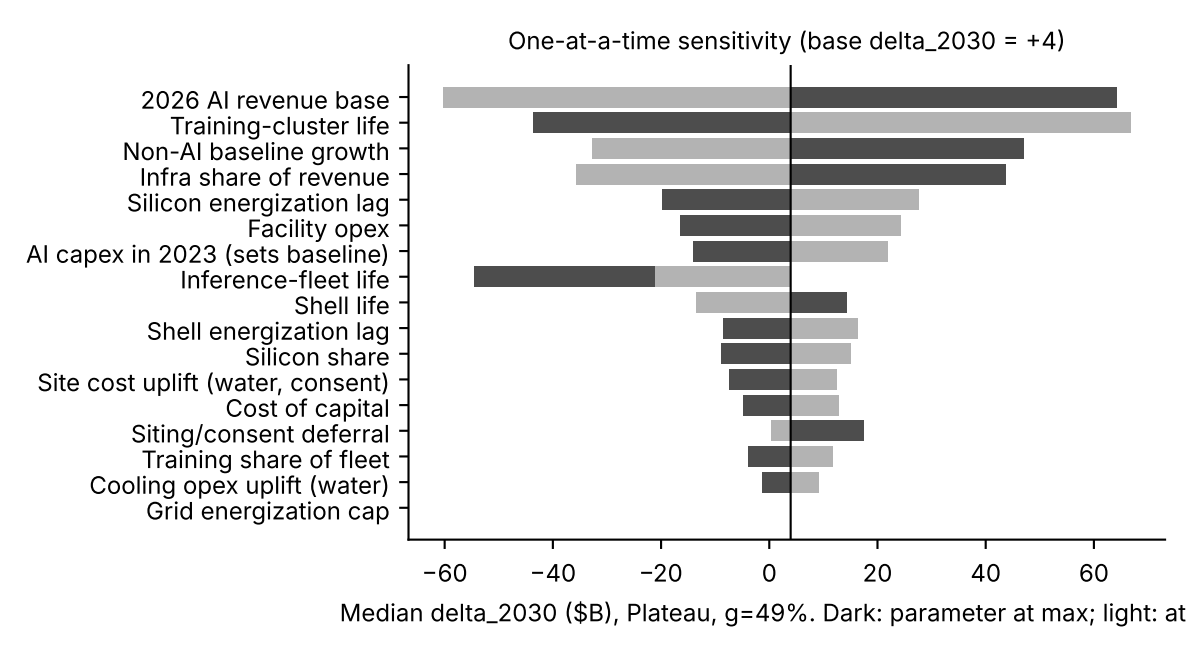
One-at-a-time sensitivity (base delta_2030 = +4)
2026 AI revenue base
Training-cluster life
Non-AI baseline growth
Infra share of revenue
Silicon energization lag
Facility opex
AI capex in 2023 (sets baseline)
Inference-fleet life
Shell life
Shell energization lag
Silicon share
Site cost uplift (water, consent)
Cost of capital
Siting/consent deferral
Training share of fleet
Cooling opex uplift (water)
Grid energization cap
−60
−40
−20
0
20
40
60
Median delta_2030 ($B), Plateau, g=49%. Dark: parameter at max; light: at