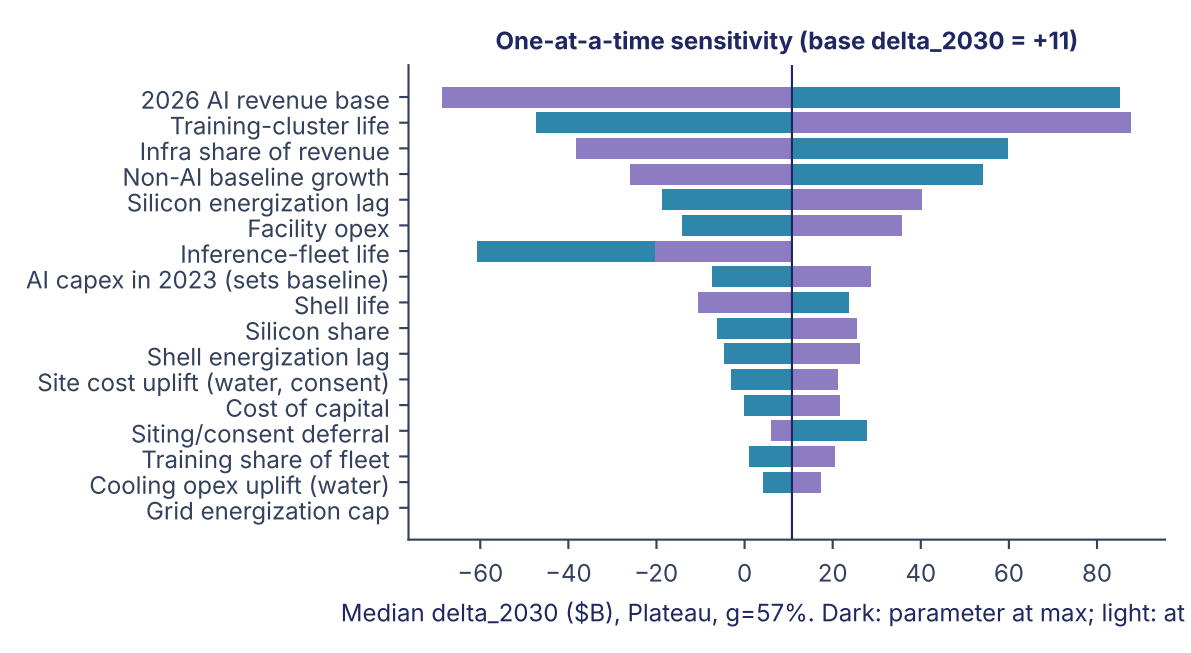
One-at-a-time sensitivity (base delta_2030 = +11)
2026 AI revenue base
Training-cluster life
Infra share of revenue
Non-AI baseline growth
Silicon energization lag
Facility opex
Inference-fleet life
AI capex in 2023 (sets baseline)
Shell life
Silicon share
Shell energization lag
Site cost uplift (water, consent)
Cost of capital
Siting/consent deferral
Training share of fleet
Cooling opex uplift (water)
Grid energization cap
−60
−40
−20
0
20
40
60
80
Median delta_2030 ($B), Plateau, g=57%. Dark: parameter at max; light: at