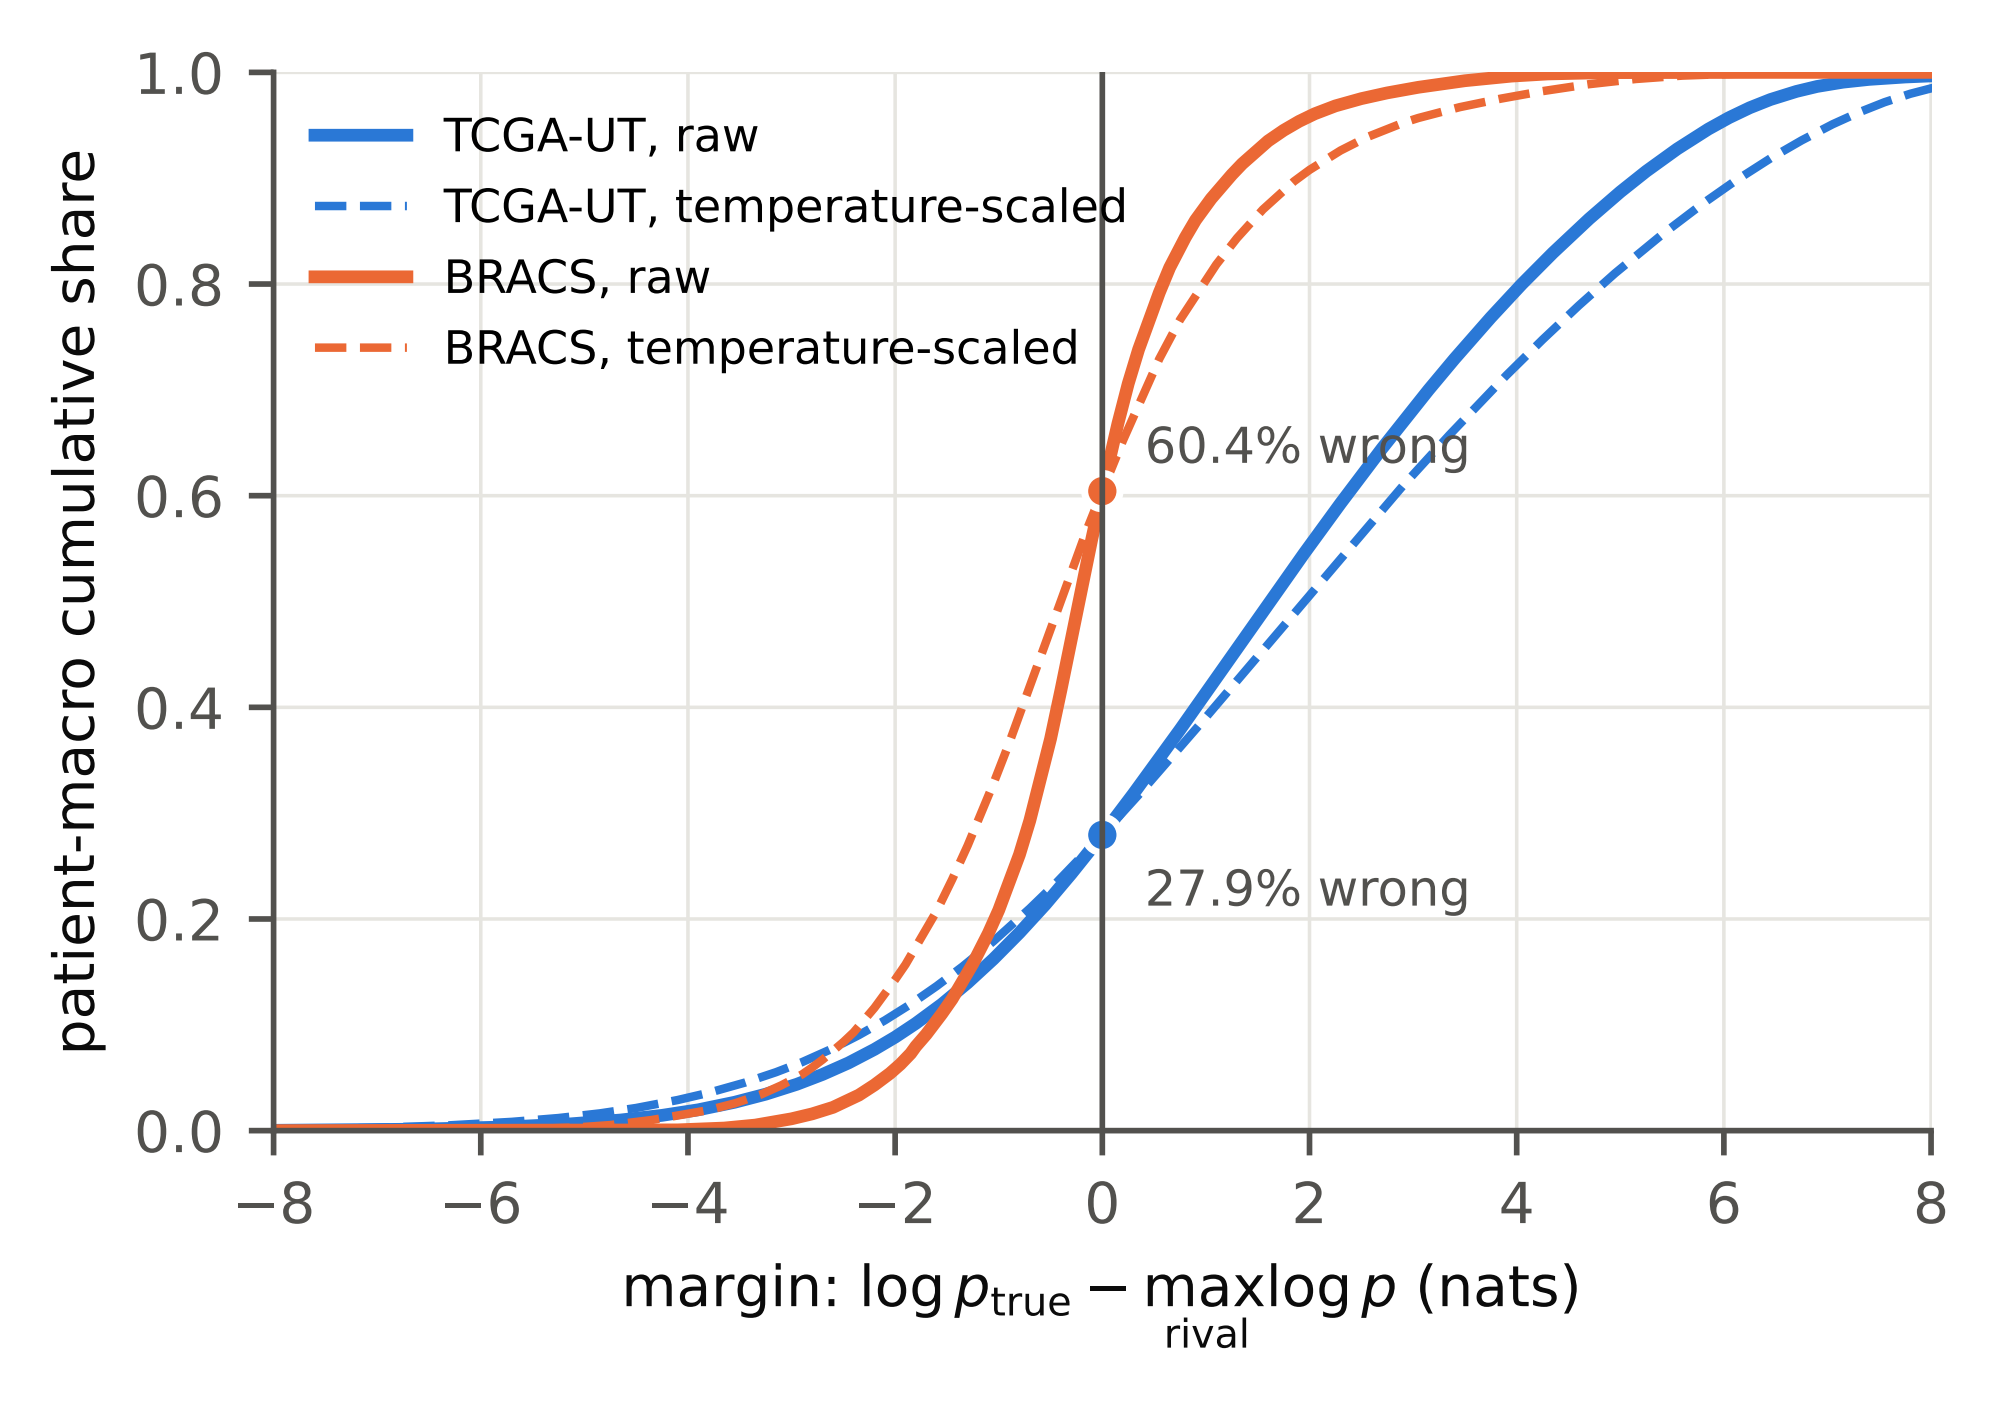
TCGA-UT, raw
TCGA-UT, temperature-scaled
BRACS, raw
BRACS, temperature-scaled
60.4% wrong
27.9% wrong
patient-macro cumulative share
1.0
0.8
0.6
0.4
0.2
0.0
−8
−6
−4
−2
0
2
4
6
8
margin: log p_{true} − max$_{\text{rival}}$ log p (nats)