


GENERAL NOTES

1. ALL UNIT DIMENSIONS ARE IN INCHES AND WEIGHT IN LBS UNLESS SPECIFIED.
2. INSTALL SPECIALTIES IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
3. AIR SEPARATOR AND EXPANSION TANK MUST BE INSTALLED ON THE SUCTION SIDE OF THE SYSTEM PUMPS.
4. PROVIDE VALVE DRAIN AND HOSE CONNECTION ON STRAINER BLOW DOWN CONNECTION.

SPECIFICATIONS

TANK MODEL	CA90-125
TANK VOLUME	90 L
HEIGHT	29 1/8
DIAMETER	20
WEIGHT	120
SYSTEM CONNECTION SIZE	1

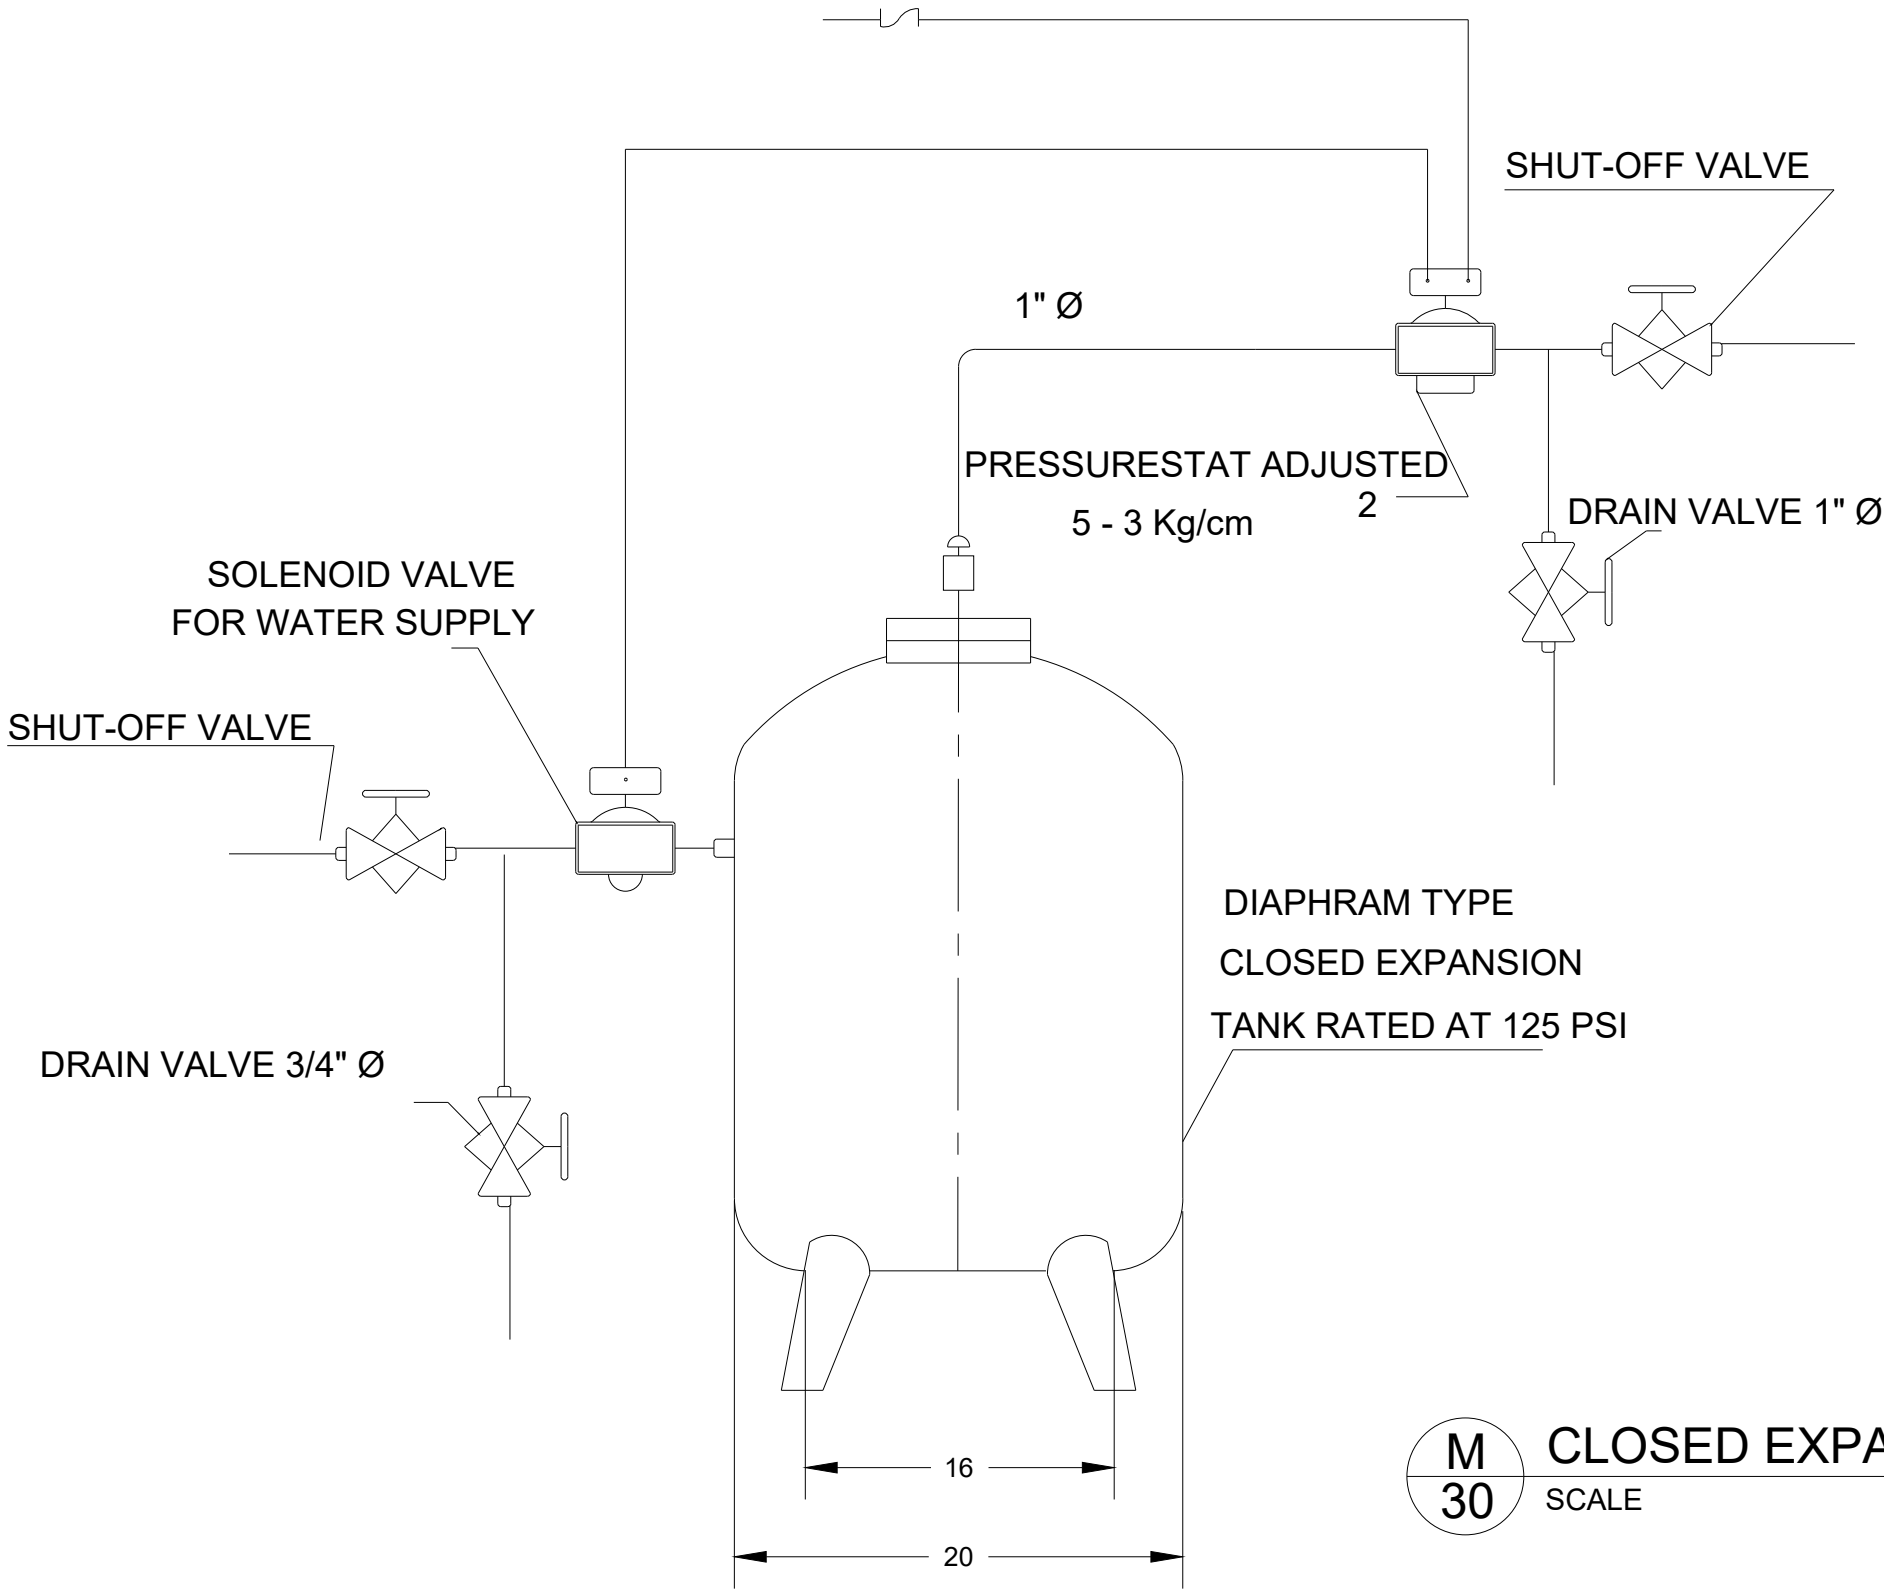

M 30 CLOSED EXPANSION TANK DETAILS SCALE NTS