


DUCT WIDTH	ANGLE SIZE	ROD SIZE Ømm.	SUPPORT SPACING mm
(UP TO 300)	25 X 25 X 2.5 THICK	6	0 – 3000
(300 TO 760)	40 X 40 X 4 THICK	8	0 – 2400
(761 TO 1060)	40 X 40 X 4 THICK	10	0 – 1800
(1061 TO 1370)	50 X 50 X 5 THICK	10	0 – 1800
(1371 TO 2130)	50 X 50 X 5 THICK	12	0 – 1200

M  
33

## DUCT SUPPORT DETAILS

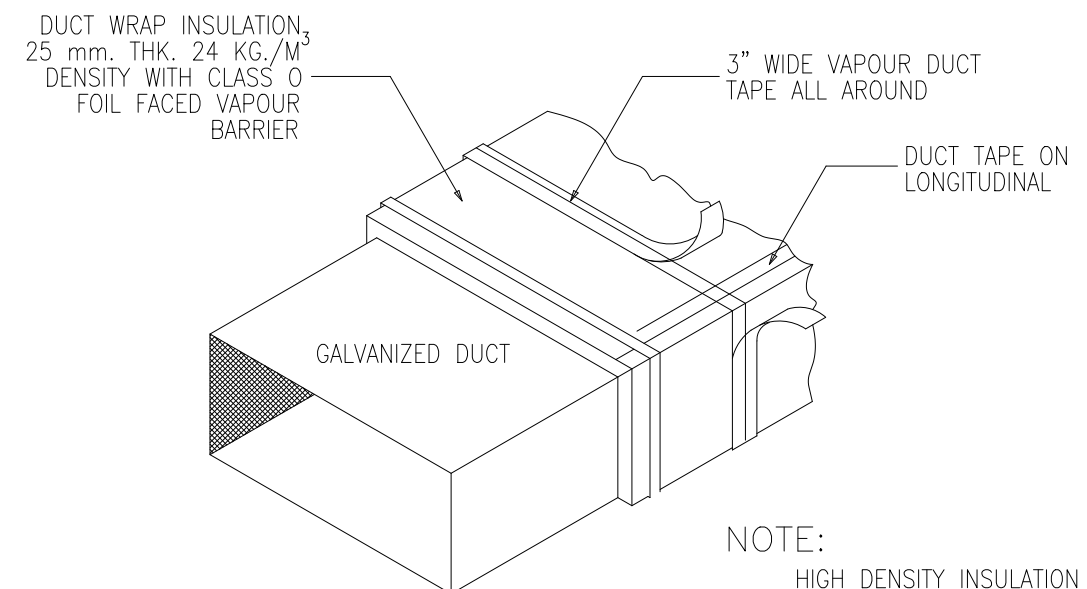

NOTE:  
HIGH DENSITY INSULATION  
INSERTS TO BE INSTALLED UNDER  
DUCT BRACKETS & FIXED TO  
ADJACENT INSULATION WITH 3"  
WIDE FOIL TAPE.

M  
33

## DUCT INSTALLATION



**BatStateU**  
BATANGAS STATE UNIVERSITY  
Gov. Pablo Borbon Main Campus II  
Alangilan, Batangas City  
MECHANICAL ENGINEERING DEPARTMENT

PROJECT LEADER  
**ENGR. MARK KERVIN N. ABU**  
MECHANICAL ENGINEER  
SECTION: ME - 5103  
GROUP NO: 12  
DATE SUB: JANUARY 10, 2020

INSTRUCTOR  
**ENGR. ALLAN B. DE VILLA**  
PROFESSIONAL MECHANICAL ENGINEER  
PRC Reg No.  
PTR No.  
TIN:  
Issued on:  
Issued at:

PROJECT / LOCATION:  
PROPOSED THREE STOREY HOSPITAL  
BATANGAS CITY

OWNER  
TEAM ABU  
**ENGR. RONIEL A. AZUCENA**  
PRESIDENT

PREPARED BY:  
ABU, MARK KERVIN N.  
AZUCENA, RONIEL A.  
CASTILLO, JOHN ADRIAN M.

No.	REVISIONS	DATE
1	DRAWING DETAILS	12/10/2019
2	DRAWING DETAILS	12/22/2019
3	DRAWING DETAILS	01/10/2020

SHEET CONTENT  
DUCT SUPPORT DETAILS  
DUCT INSTALLATION

SHEET NO.  
M  
33