


GENERAL NOTES

- 1. ALL UNIT DIMENSIONS ARE IN INCHES AND WEIGHT IN LBS UNLESS SPECIFIED.
- 2. INSTALL SPECIALTIES IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
- 3. AIR SEPARATOR AND EXPANSION TANK MUST BE INSTALLED ON THE SUCTION SIDE OF THE SYSTEM PUMPS.
- 4. PROVIDE VALVE DRAIN AND HOSE CONNECTION ON STRAINER BLOW DOWN CONNECTION.

SPECIFICATIONS

TANK MODEL	CA90-125
TANK VOLUME	90 L
HEIGHT	29 1/8
DIAMETER	20
WEIGHT	120
SYSTEM CONNECTION SIZE	1

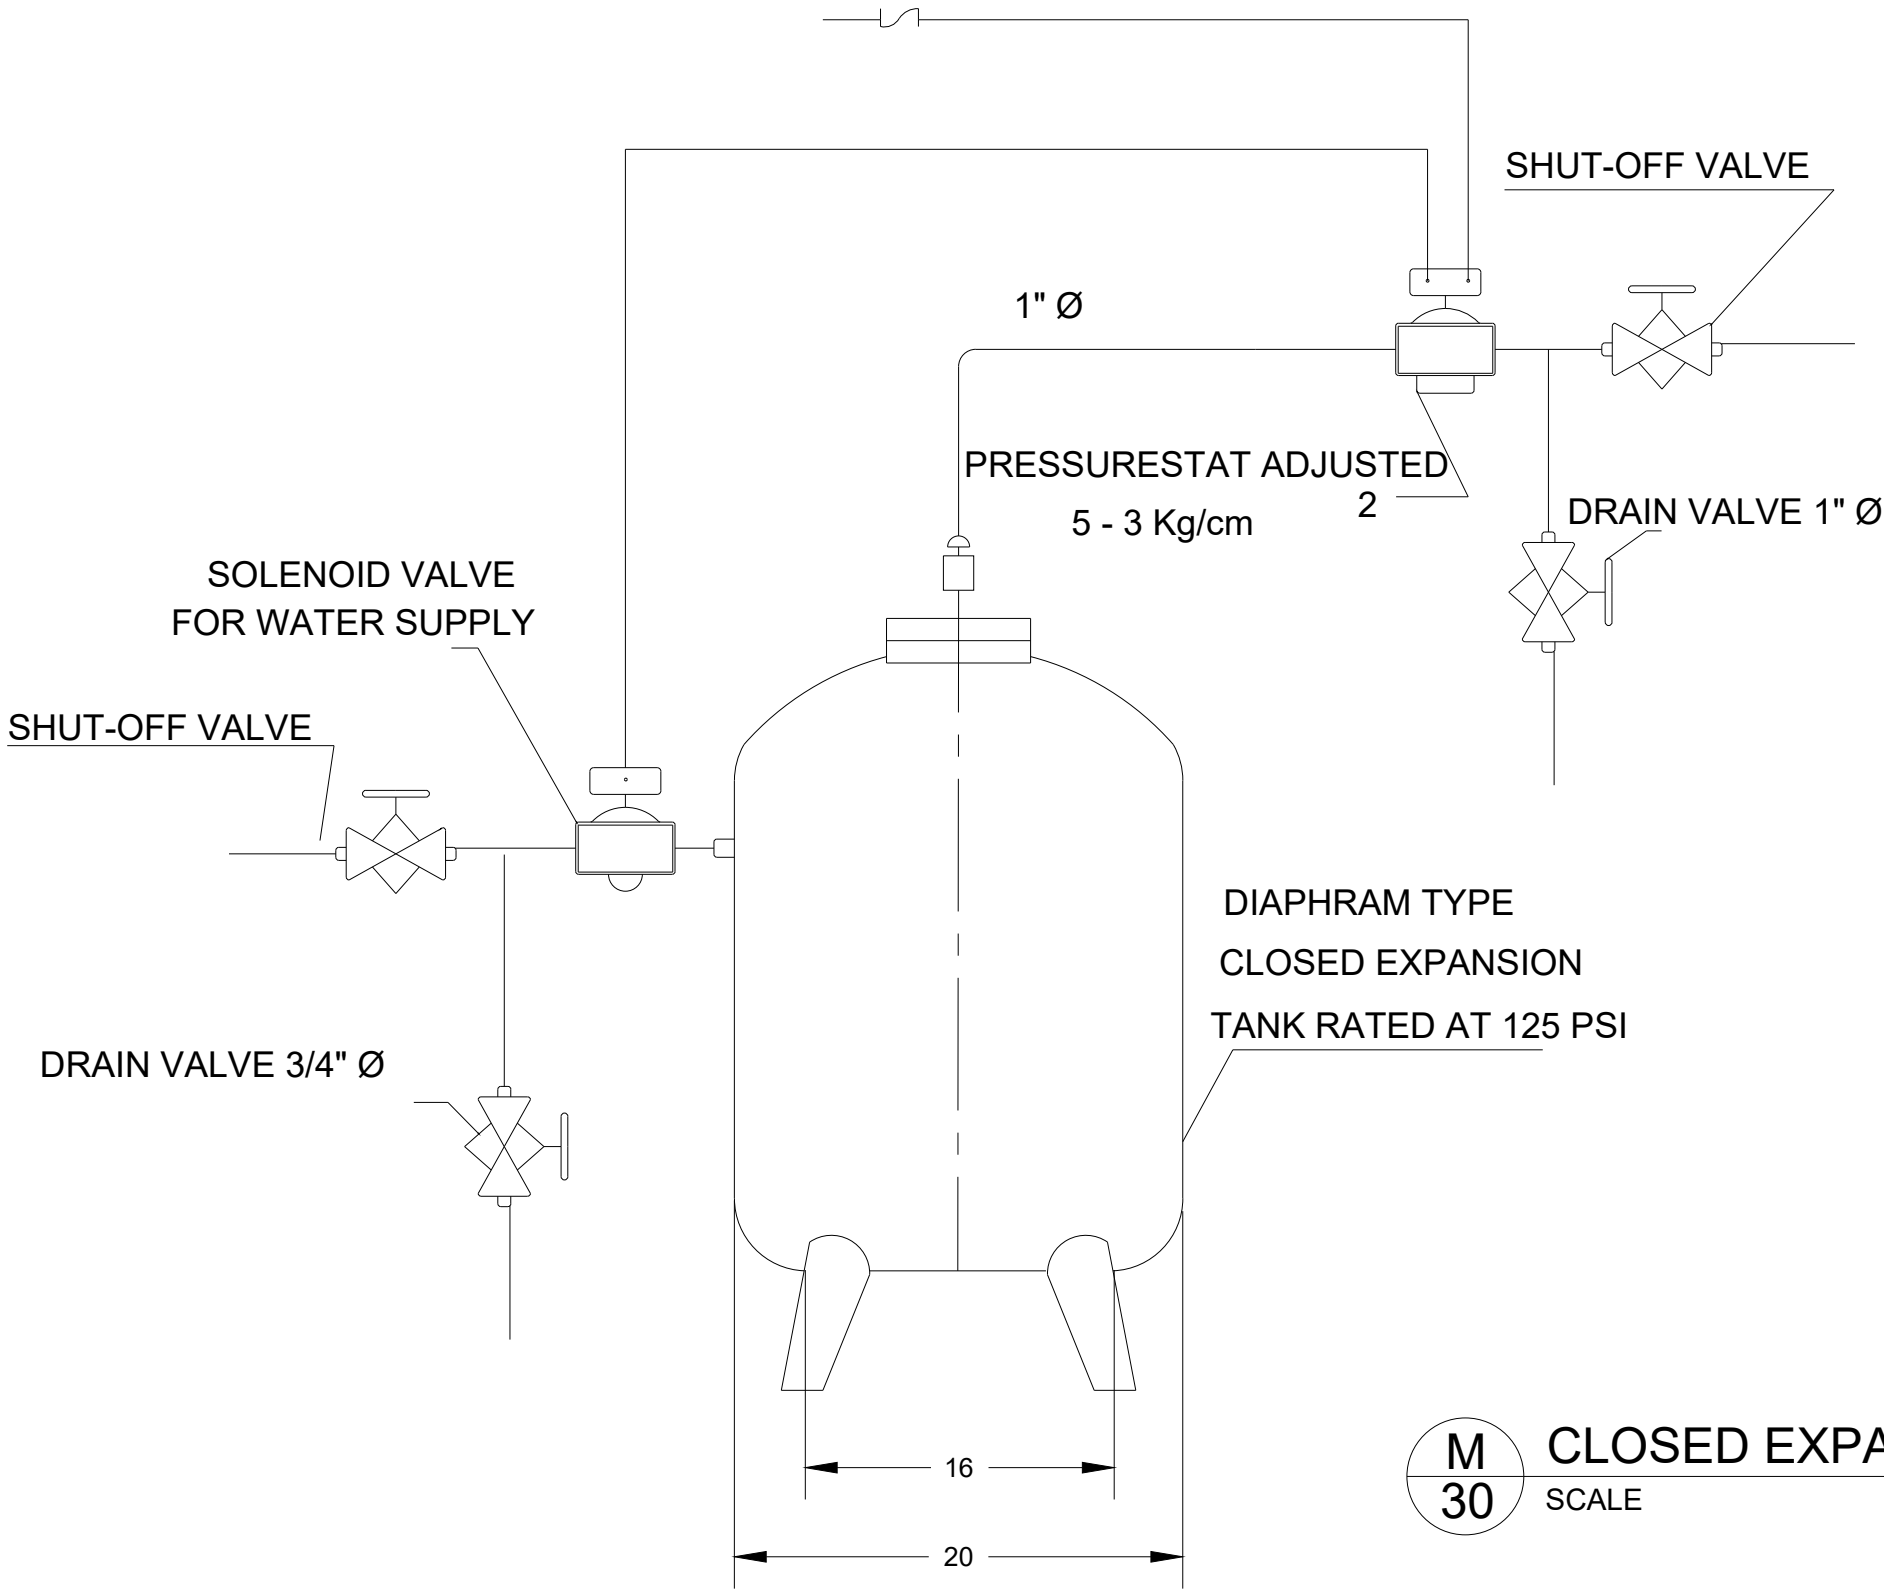

M 30 CLOSED EXPANSION TANK DETAILS SCALE NTS