


DUCT WIDTH	ANGLE SIZE	ROD SIZE Ømm.	SUPPORT SPACING mm
(UP TO 300)	25 X 25 X 2.5 THICK	6	0 – 3000
(300 TO 760)	40 X 40 X 4 THICK	8	0 – 2400
(761 TO 1060)	40 X 40 X 4 THICK	10	0 – 1800
(1061 TO 1370)	50 X 50 X 5 THICK	10	0 – 1800
(1371 TO 2130)	50 X 50 X 5 THICK	12	0 – 1200

M 33 DUCT SUPPORT DETAILS



M 33 DUCT INSTALLATION

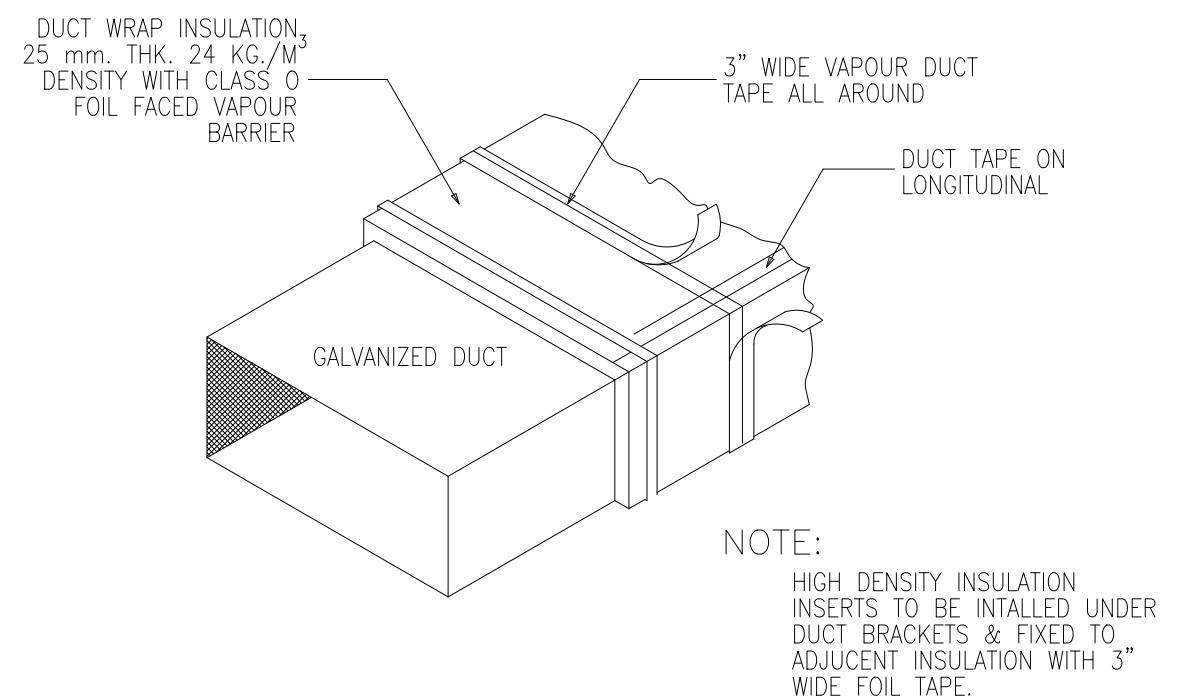

BatStateU
BATANGAS STATE UNIVERSITY
Gov. Pablo Borbon Main Campus II
Alangilan, Batangas City
MECHANICAL ENGINEERING DEPARTMENT

PROJECT LEADER
ENGR. MARK KERVIN N. ABU
MECHANICAL ENGINEER
SECTION: ME - 5103
GROUP NO: 12
DATE SUB: JANUARY 07, 2020

INSTRUCTOR
ENGR. ALLAN B. DE VILLA
PROFESSIONAL MECHANICAL ENGINEER
PRC Reg No.
PTR No.
TIN:
Issued on:
Issued at:

PROJECT / LOCATION:
PROPOSED THREE STOREY HOSPITAL
BATANGAS CITY

OWNER
TEAM ABU
ENGR. RONIEL A. AZUCENA
PRESIDENT

PREPARED BY:	No.	REVISIONS	DATE
ABU, MARK KERVIN N.	1	DRAWING DETAILS	12/10/2019
AZUCENA, RONIEL A.	2	DRAWING DETAILS	12/22/2019
CASTILLO, JOHN ADRIAN M.	3	DRAWING DETAILS	01/07/2020

SHEET CONTENT	SHEET NO.
DUCT SUPPORT DETAILS DUCT INSTALLATION	M 33