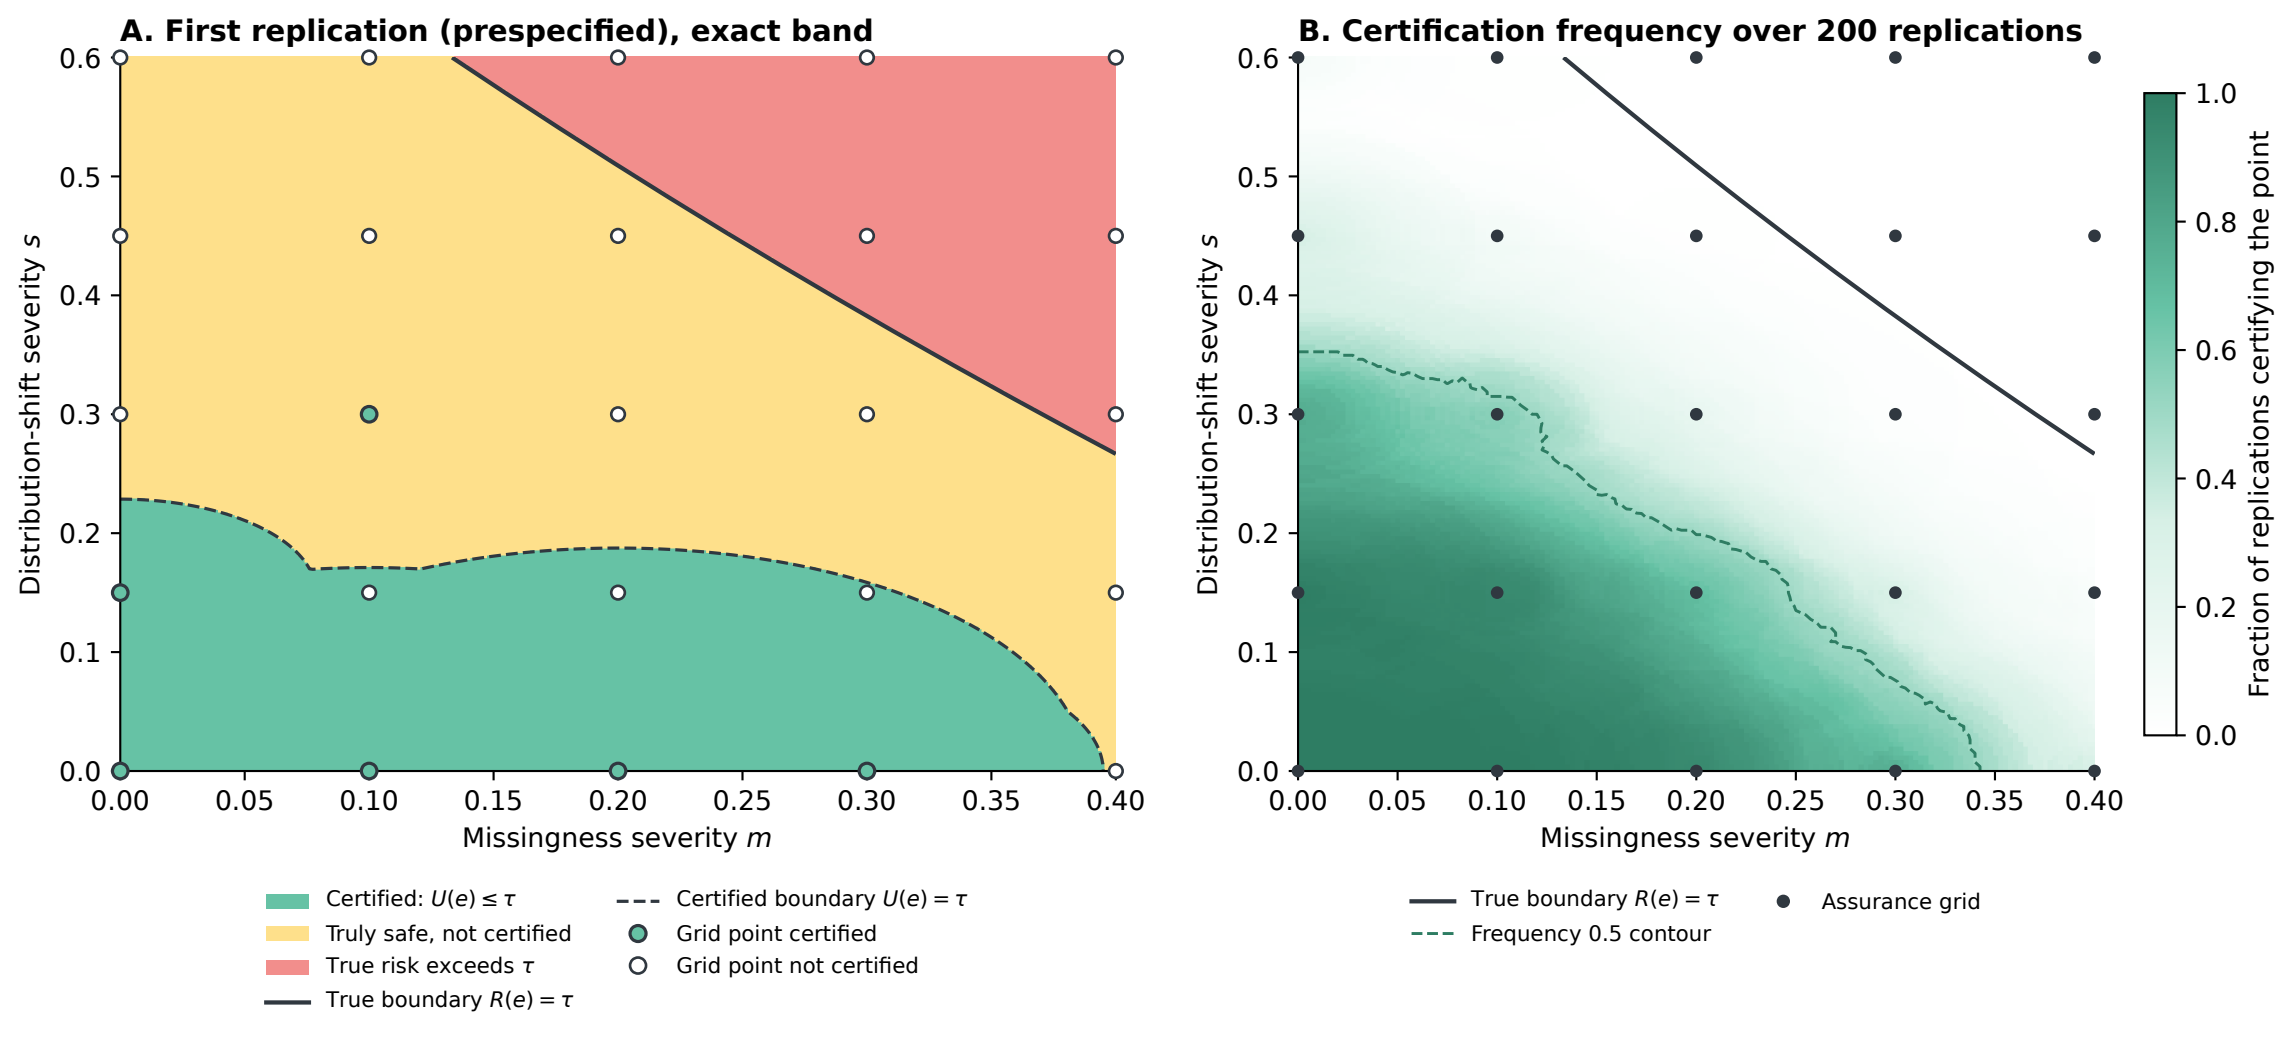

A. First replication (prespecified), exact band
B. Certification frequency over 200 replications
Distribution-shift severity s
Missingness severity m
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.00
0.05
0.10
0.15
0.20
0.25
0.30
0.35
0.40
Fraction of replications certifying the point
1.0
0.8
0.6
0.4
0.2
0.0
Certified: U(e) ≤ τ
Truly safe, not certified
True risk exceeds τ
True boundary R(e) = τ
Certified boundary U(e) = τ
Grid point certified
Grid point not certified
True boundary R(e) = τ
Frequency 0.5 contour
Assurance grid