



## Data sheet

# Differential pressure control / lube oil protection control, types MP 54 and MP 55



MP 54 and MP 55 oil differential pressure controls are used as safety switches to protect refrigeration compressors against low lubricating oil pressure.

If the oil pressure fails, the control will stop the compressor after a predetermined time period has elapsed.

MP 54 and MP 55 are used in refrigerating systems using HCFC and non-flammable HFC refrigerants.

MP 54 has a fixed differential pressure setting. It also incorporates a thermal time relay with a fixed release time setting.

MP 55 have adjustable differential pressure and are available with thermal time relay.

## Features

- Fixed and adjustable differentials available
- Extremely narrow switch differential accuracy
- Reliable, long life stainless steel bellows
- Sturdy metal cover and universal mounting hole patterns
- Integral 1/2 NPSM swivel cable connector allows direct attachment of 1/2 in. male pipe thread connector
- Simple manual trip, electrical test function eliminates need of tools and test "jumper" wires
- Standard four-wire hook-up
- Can be used for HCFC and non-flammable HFC refrigerants

## Approvals

UL listed for USA and Canada, file E31024

## Materials in contact with the medium



Unit type	Material
MP 54 MP 55	Stainless steel 19/11, no. 1.4306 to EN 10088 Deep-drawn steel plate, no. 1.0338 to EN 10130 Free cutting steel, no. 1.0718 to EN 10277
MP with capillary tube	Copper Cu-DHP, no. CW024A acc. to EN 12450

## Technical data

Ambient temperature	The time relay is temperature-compensated in the range -40 – 140 °F
Switch differential	Maximum 2.8 psi
Maximum working pressure	MWP = 245 psig
Maximum test pressure	Pe = 320 psig
Control voltage	240 or 120 V a.c. or d.c.
Permissible voltage variation	-15 – 10%
Contact load of time relay output contacts M-S	240 V a.c.: 2 FLA
	240 V d.c.: 0.2 FLA
Electrical connection	NPSM
Max. bellows temperature	212 °F
Cable entry	Integral 1/2 in. female NPSM swivel cable connector allows direct attachment of 1/2 in. male pipe thread connector.
Enclosure	~NEMA 1

## Ordering

For HCFC and non-flammable HFC refrigerants

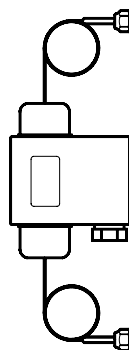

Type	Control differential $\Delta p$ [psi]	Regulation range LP side [inHg] to [psig]	Time relay delay time [s]	Connection		
				Code no.		
				1/4 in. flare	1/4 in. flare nut with 36 in. capillary tube	1/4 in. flare nut with 88 in. capillary tube
MP 54	6.0	29 inHg – 175 psi	45	060B200866	—	—
	6.0	29 inHg – 175 psi	45	—	060B205066	—
	9.0	29 inHg – 175 psi	90	060B200266	—	—
	9.0	29 inHg – 175 psi	120	060B200366 <sup>2)</sup>	—	—
	9.0	29 inHg – 175 psi	120	—	060B205366 <sup>2)</sup>	—
MP 55	4.3 – 65	29 inHg – 175 psi	45	—	060B205466	—
	4.3 – 65	29 inHg – 175 psi	60	060B201266 <sup>1)</sup>	—	—
	4.3 – 65	29 inHg – 175 psi	90	060B200666	—	—
	4.3 – 65	29 inHg – 175 psi	120	060B200766	—	—
	4.3 – 65	29 inHg – 175 psi	120	—	060B205766	—


<sup>1)</sup> With glow lamp that remains on during normal operation of compressor.

<sup>2)</sup> Three-wire hook-up

## Note:

When time delay is energized which also means that min. permissible oil pressure (differential  $\Delta p$ ) is reached, light goes out.

## Design

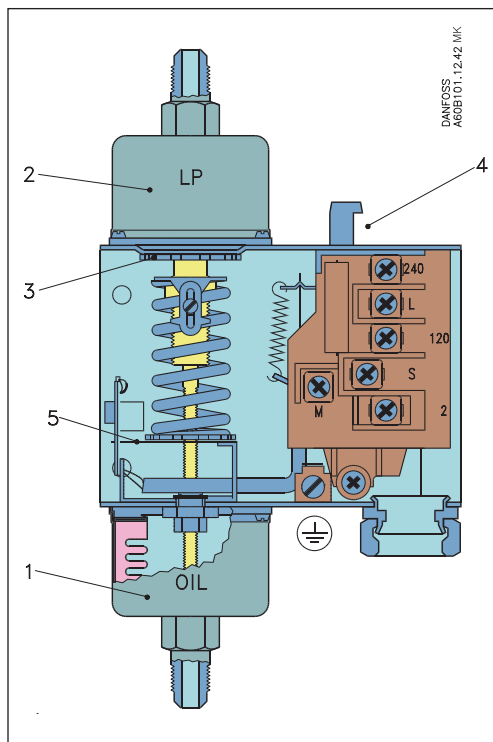

1. Connection to pressure side of lubrication system, OIL
2. Connection to suction side of refrigeration plant, LP
3. Setting disc (MP 55)
4. Reset button
5. Test device

The operation of the pressure control is based only on the differential pressure, i.e. the difference in pressure between the two counteracting bellows, whereas it is independent of the absolute pressure acting on both bellows.

The MP 55 can be set for different differential pressures by the setting disc (3). The set differential pressure can be read from the internal scale.

The MP 54 has a fixed differential and has no pressure setting disc. The factory-set differential pressure is stamped on the front plate of the control.

## Terminology

### *Differential range*

The pressure difference between LP and OIL connections within which the control can be set to operate.

### *Scale reading*

The differential between the oil pump pressure and the pressure in the crankcase that exists at the moment the contact system cuts in current to the time relay on falling oil pressure.

### *Operating range*

The pressure range on the LP connection within which the control can operate.


### *Contact differential*

The pressure rise above the set differential pressure (scale reading) necessary to cut off current to the time relay.

### *Release time*

The period for which the differential pressure control allows the compressor to run with too low an oil pressure during start-up and operation.

Electrical diagram

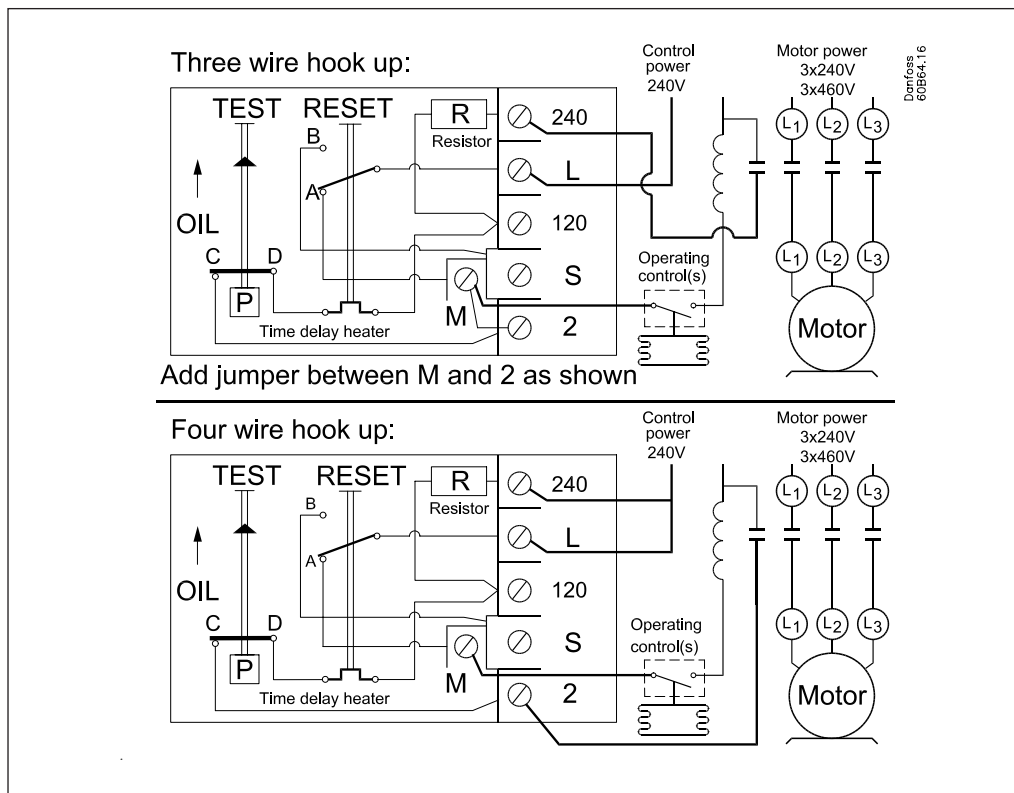



**Function**  
(continued)

**Pos. A: Normal start-up**

The lubricating oil pressure is built up during start to the set/fixed differential plus the contact differential, before the timer cuts out (in this example, after 45 seconds). At point A contacts T1-T2 open and timer (e) is stopped, i.e. normal lubricating oil conditions for the compressor have been established.

**Pos. B:** The lubricating oil pressure does not reach the set/fixed differential plus the contact differential before the timer period elapses. At point B the timer cuts out operational circuit L-M and the compressor stops.

If a signal source is connected to terminal S, it will be activated. Restart can only be performed after about 2 minutes by activation of the reset button, provided the cause of the fault has been determined.

**Pos. C:** The lubricating oil pressure falls during operation to a value lower than the set/fixed differential. At point C, safety circuit T1-T2 cuts in and the timer is activated.

**Pos. D:** The lubricating oil pressure reaches the set/fixed differential plus the contact differential before the timer period elapses. At point D, safety circuit T1-T2 cuts out and the timer is stopped, i.e. normal lubricating oil conditions for the compressor have been established.

**Pos. E:** The lubricating oil pressure falls to a value lower than the set/fixed differential during operation. At point E, safety circuit T1-T2 cuts in and the timer is activated.

**Pos. F:** The lubricating oil pressure remains lower than the set/fixed differential. At point F the timer cuts out operational circuit L-M and the compressor stops. If a signal source is connected to terminal S, it will be activated. Restart can only be performed after about 2 minutes by activation of the reset button, provided the cause of the fault has been determined.

**After start-up**

It is important that a function check should be made to ensure that the differential pressure control is operating as it should. This check can be made by pressing the test device (inside the unit on the left hand side).

When the test device is pressed down and held in this position the compressor motor should stop after the release time determined by the time relay has elapsed.

**Dimensions [in.]  
and weights [lb]**

Types MP 54, MP 55

