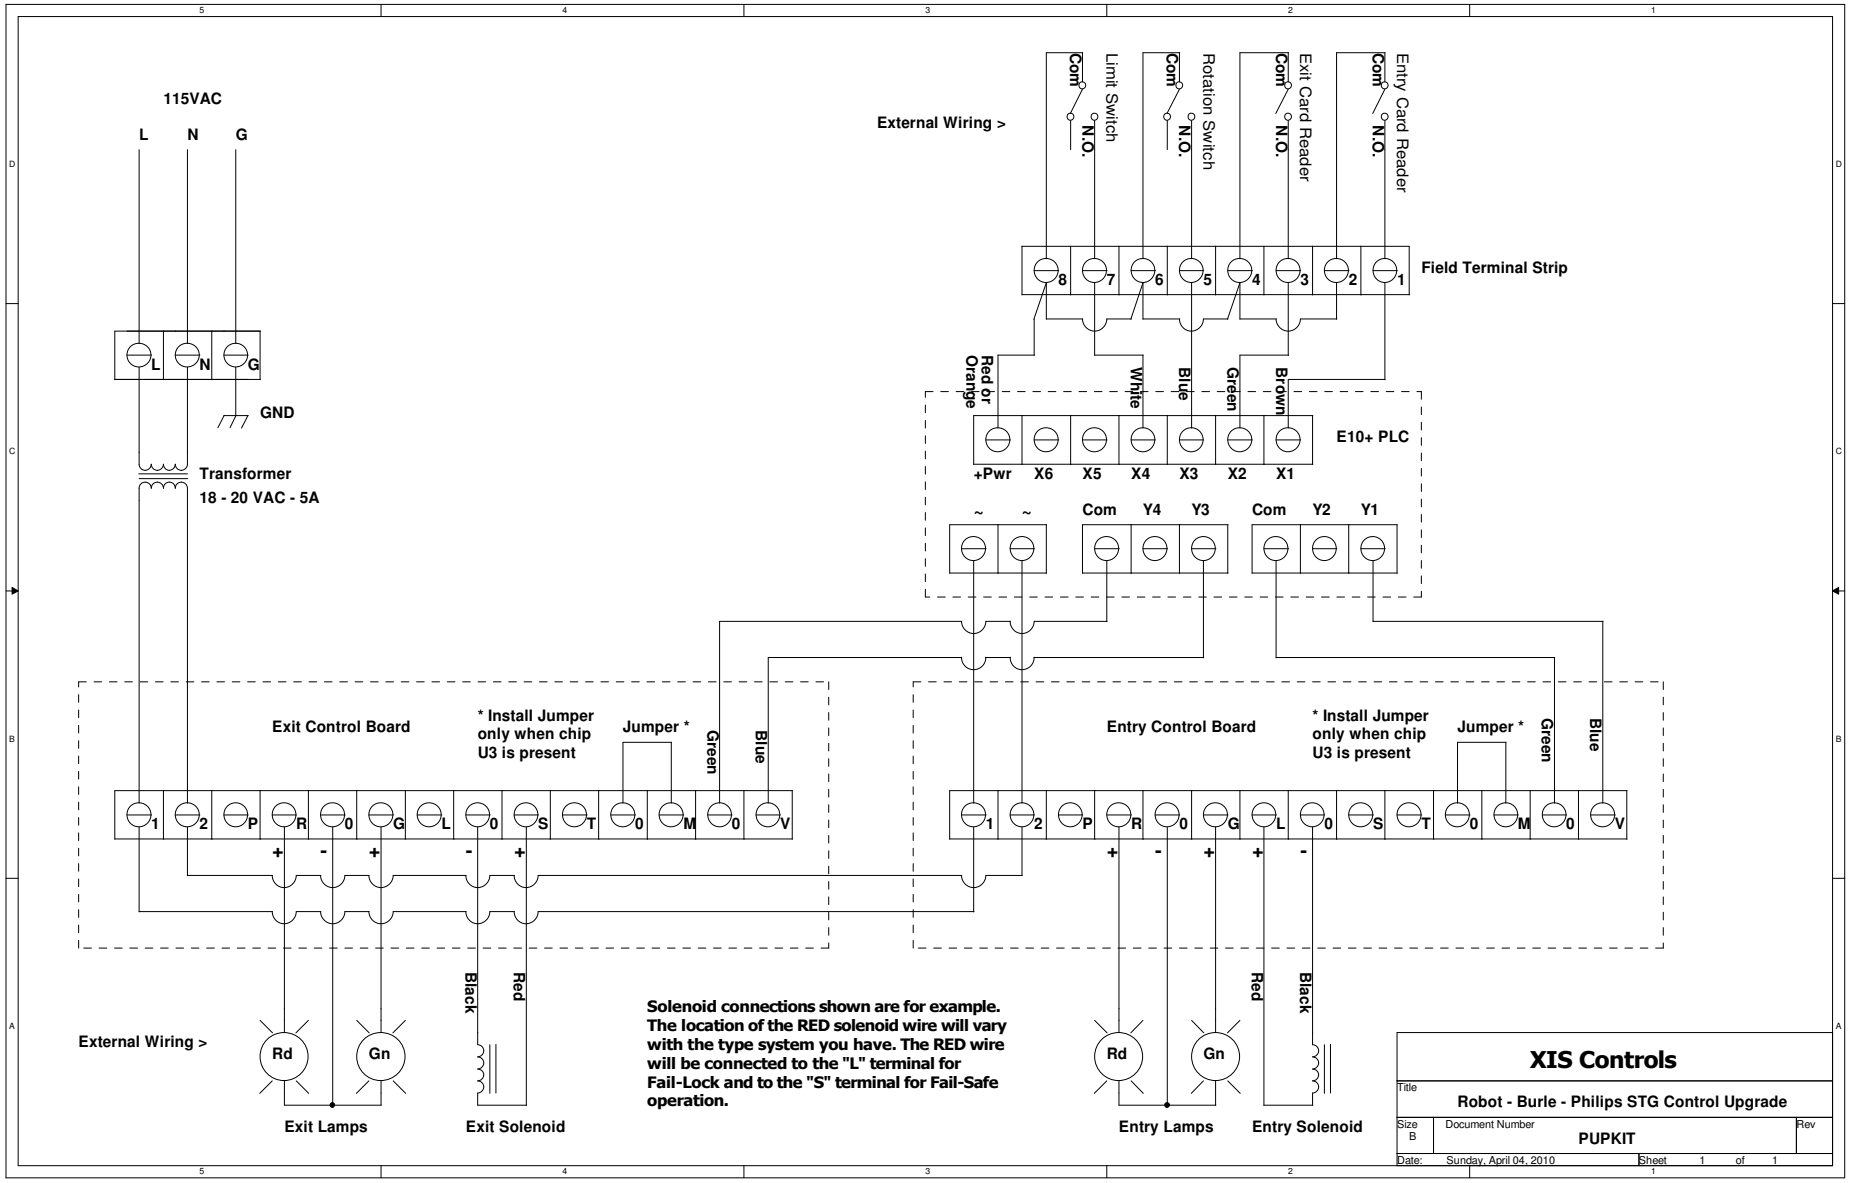
115VAC
L N G
L N G
GND
Transformer
18 - 20 VAC - 5A
External Wiring >
Com
N.O.
Limit Switch
Rotation Switch
Exit Card Reader
Entry Card Reader
8 7 6 5 4 3 2 1
Field Terminal Strip
Red or Orange
White
Blue
Green
Brown
E10+ PLC
+Pwr X6 X5 X4 X3 X2 X1
~ ~ Com Y4 Y3 Com Y2 Y1
Exit Control Board
* Install Jumper only when chip U3 is present
Jumper *
Green
Blue
1 2 P R 0 G L 0 S T 0 M 0 V
+ - + - +
Entry Control Board
* Install Jumper only when chip U3 is present
Jumper *
Green
Blue
1 2 P R 0 G L 0 S T 0 M 0 V
+ - + + -
External Wiring >
Rd
Gn
Black
Red
Exit Lamps
Exit Solenoid
Solenoid connections shown are for example. The location of the RED solenoid wire will vary with the type system you have. The RED wire will be connected to the "L" terminal for Fail-Lock and to the "S" terminal for Fail-Safe operation.
Rd
Gn
Red
Black
Entry Lamps
Entry Solenoid
XIS Controls
Title
Robot - Burle - Philips STG Control Upgrade
Size B
Document Number
PUPKIT
Rev
Date: Sunday, April 04, 2010
Sheet 1 of 1