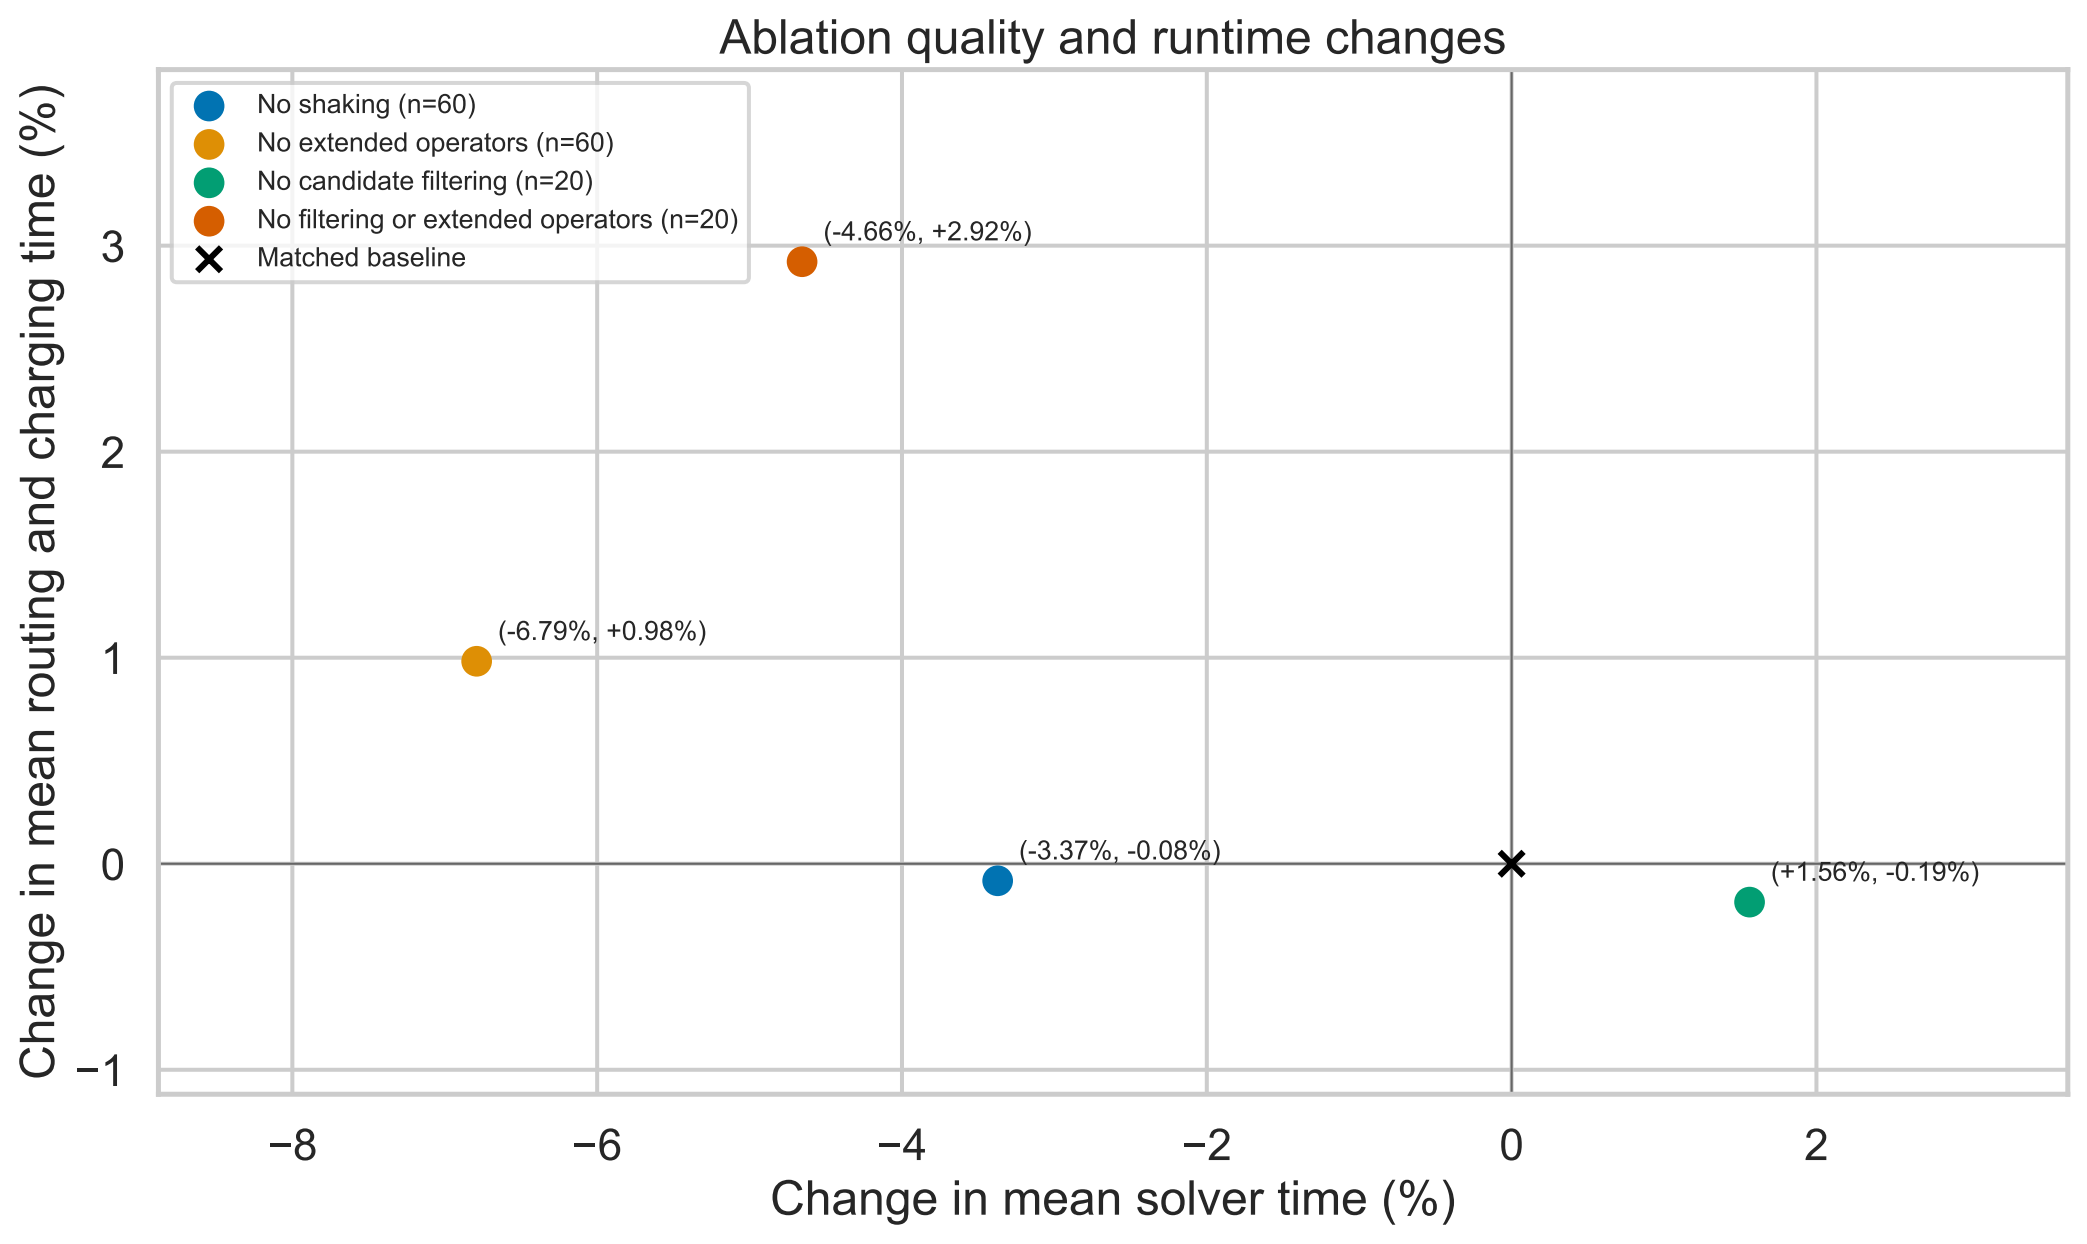
Ablation quality and runtime changes
No shaking (n=60)
No extended operators (n=60)
No candidate filtering (n=20)
No filtering or extended operators (n=20)
Matched baseline
(-4.66%, +2.92%)
(-6.79%, +0.98%)
(-3.37%, -0.08%)
(+1.56%, -0.19%)
Change in mean routing and charging time (%)
Change in mean solver time (%)
3
2
1
0
−1
−8
−6
−4
−2
0
2