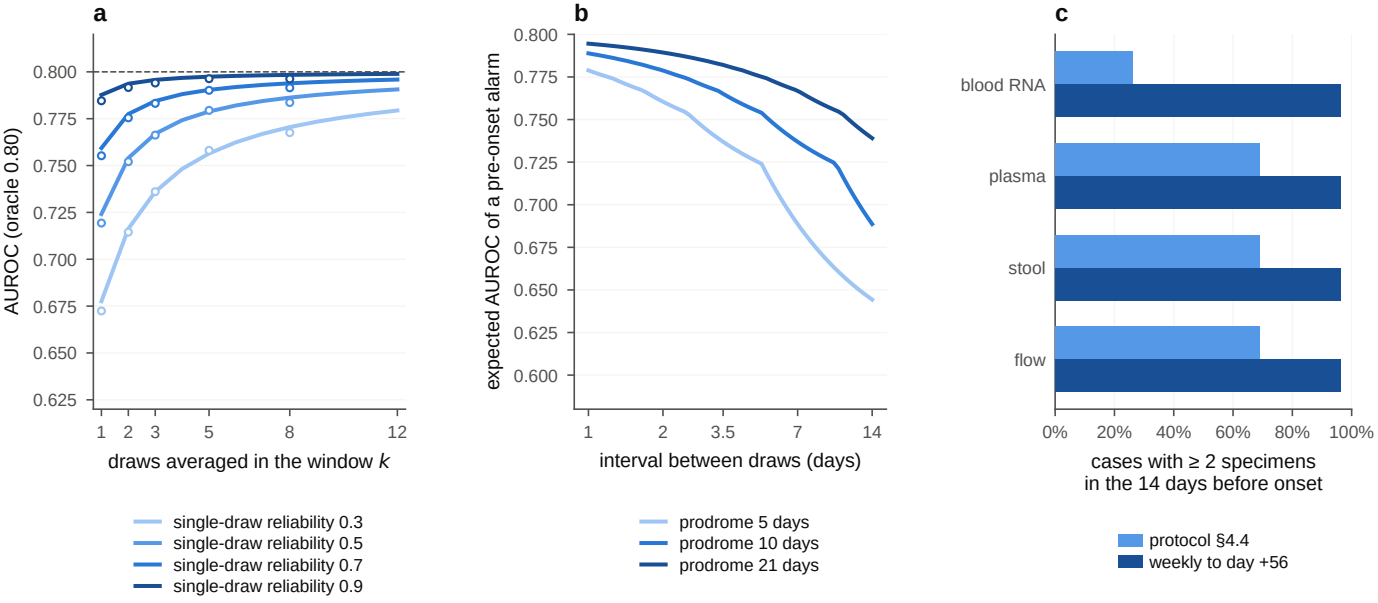
a
AUROC (oracle 0.80)
0.800
0.775
0.750
0.725
0.700
0.675
0.650
0.625
1
2
3
5
8
12
draws averaged in the window k
single-draw reliability 0.3
single-draw reliability 0.5
single-draw reliability 0.7
single-draw reliability 0.9
b
expected AUROC of a pre-onset alarm
0.800
0.775
0.750
0.725
0.700
0.675
0.650
0.625
0.600
1
2
3.5
7
14
interval between draws (days)
prodrome 5 days
prodrome 10 days
prodrome 21 days
c
blood RNA
plasma
stool
flow
0%
20%
40%
60%
80%
100%
cases with ≥ 2 specimens
in the 14 days before onset
protocol §4.4
weekly to day +56