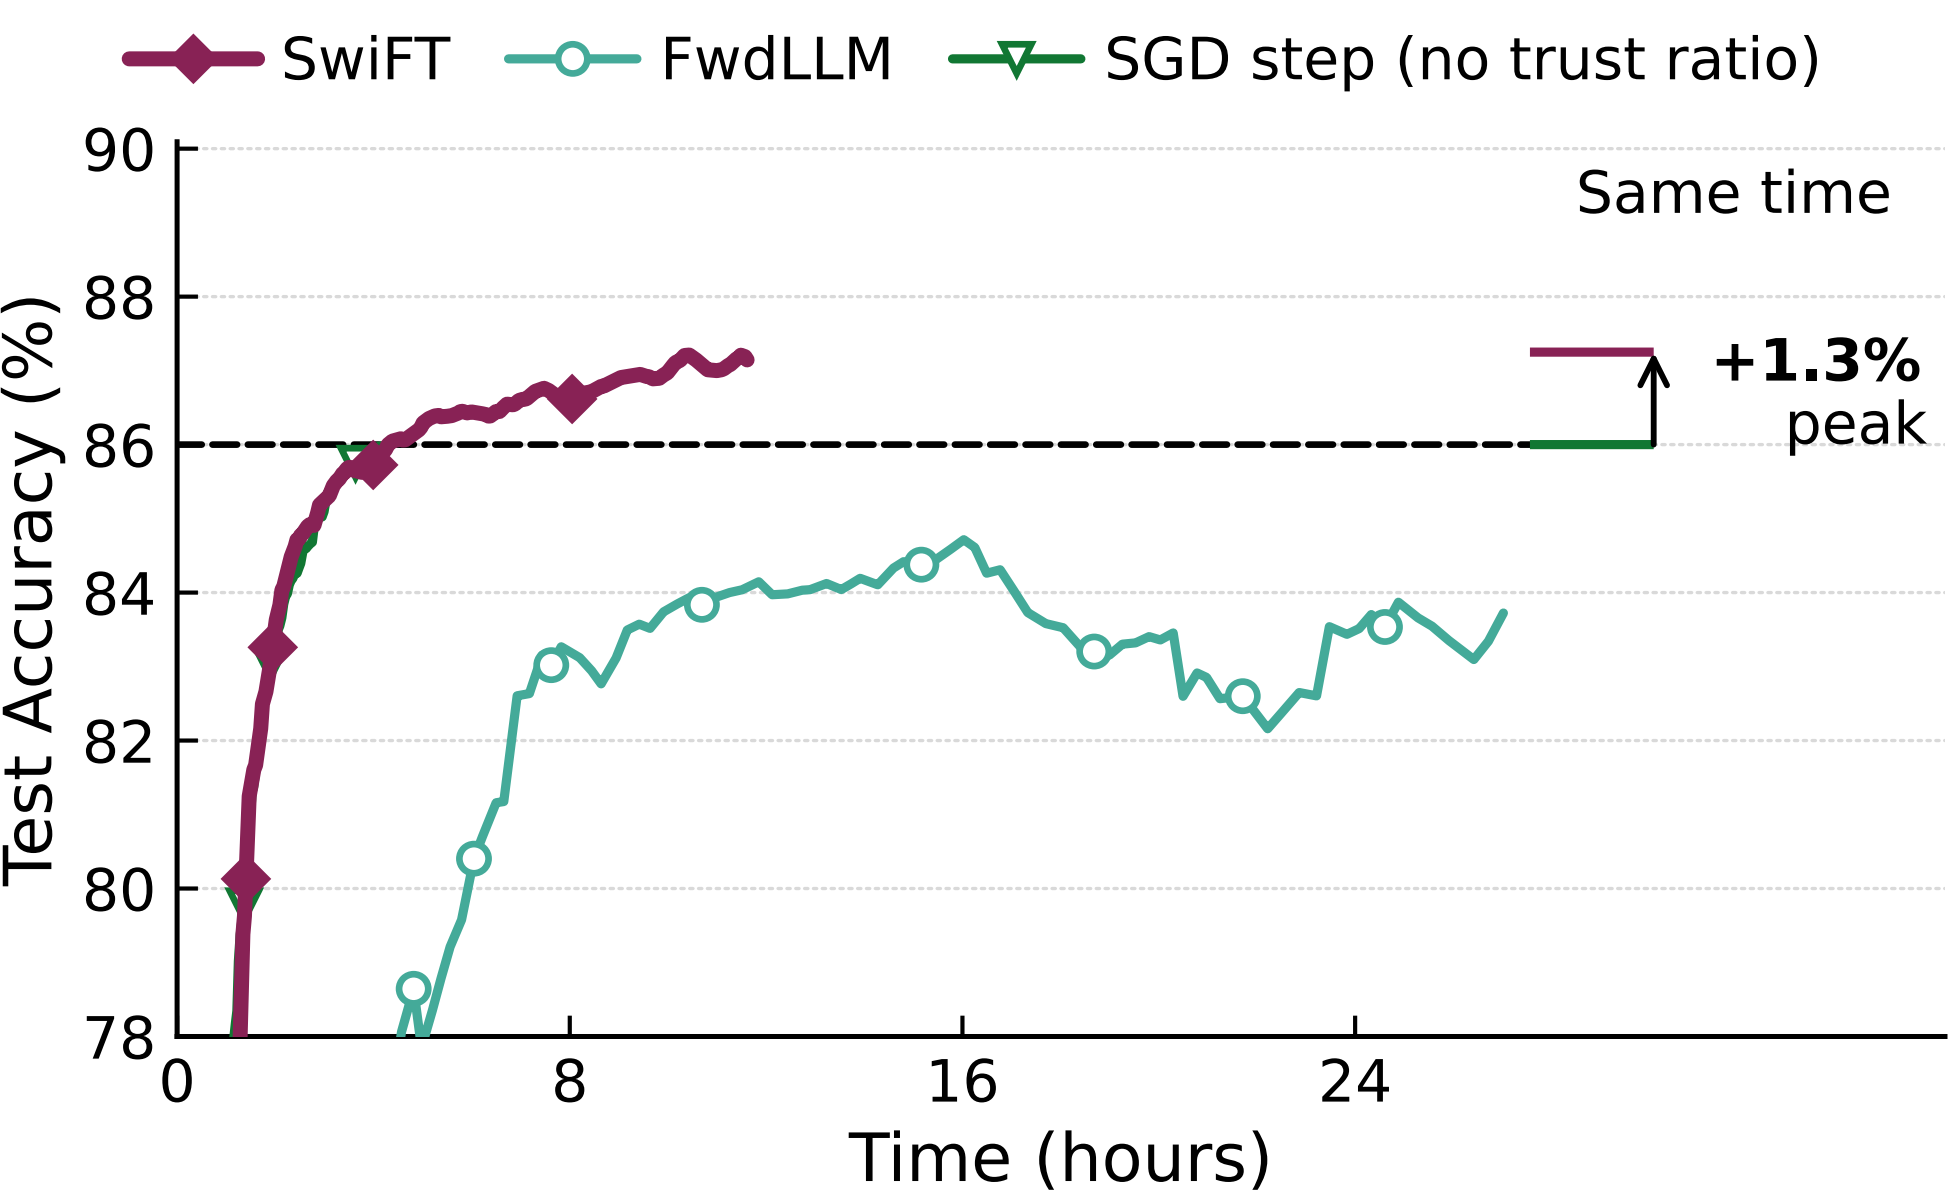
SwiFT
FwdLLM
SGD step (no trust ratio)
Same time
+1.3%
peak
Test Accuracy (%)
90
88
86
84
82
80
78
0
8
16
24
Time (hours)