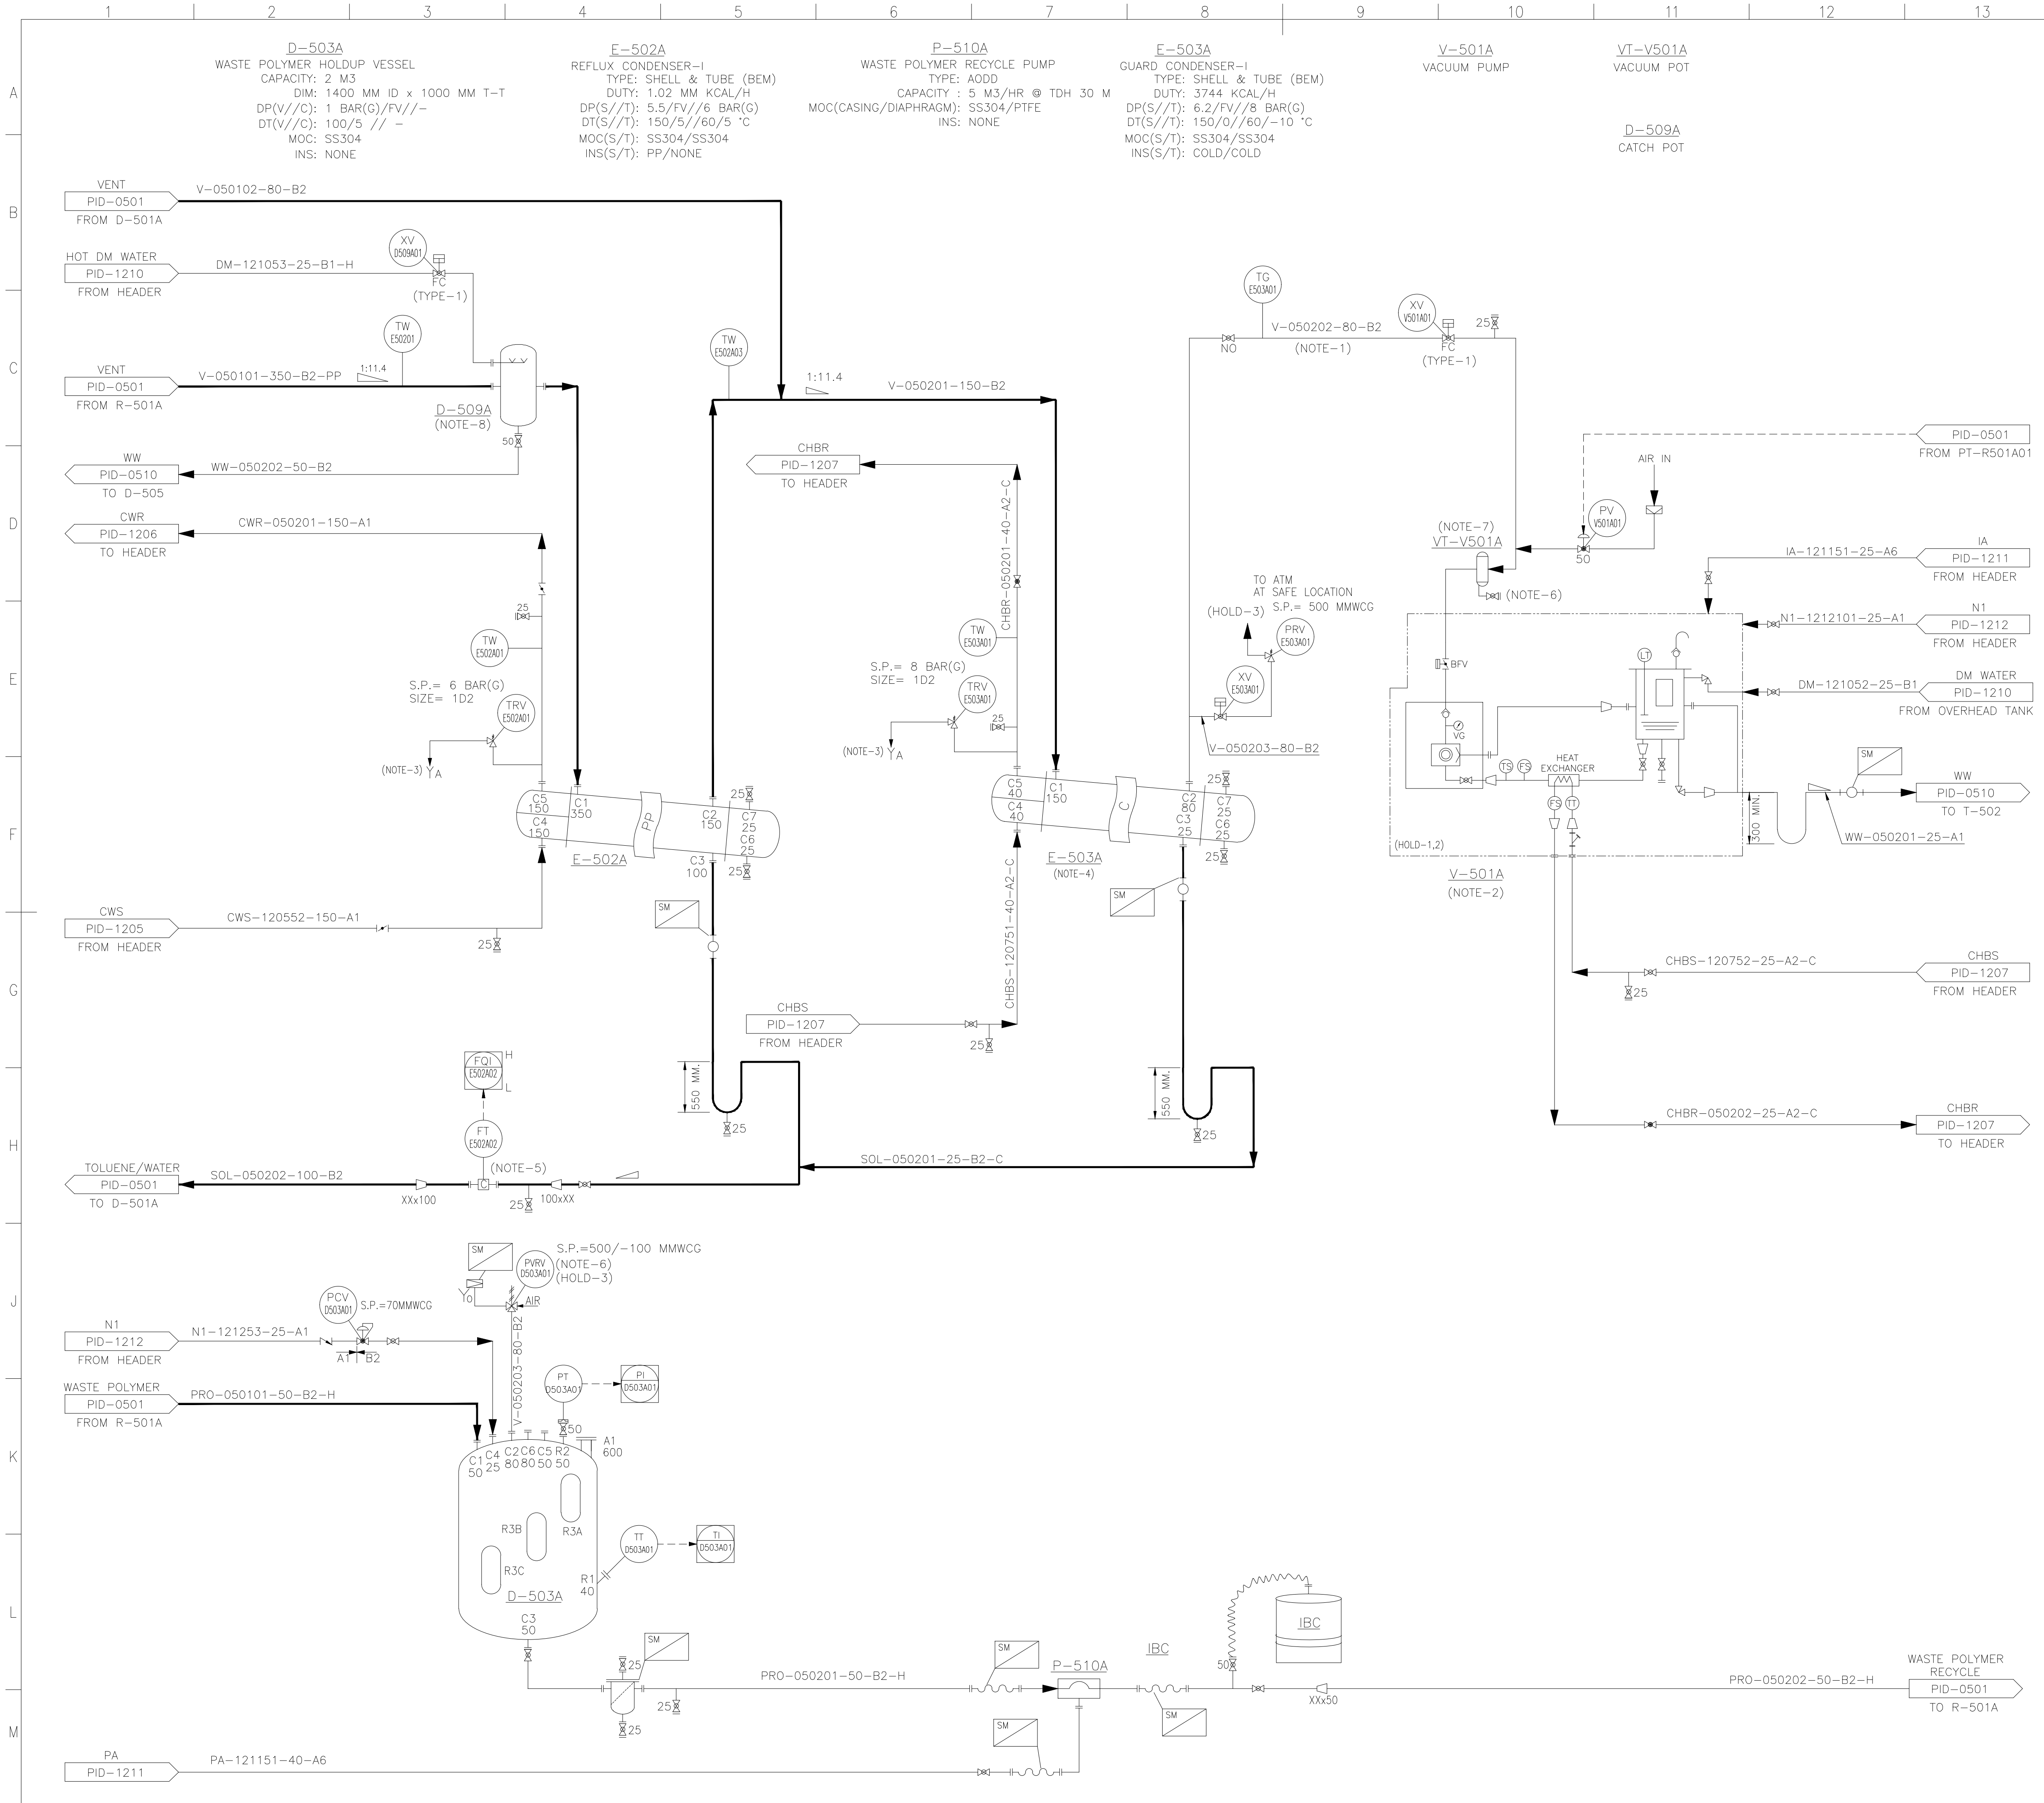

GENERAL NOTES:

1. ALL VAPOR LINES, SLURRY LINES AND GRAVITY LINES SHOULD HAVE MINIMUM BENDS AND NO LOOPS.
2. PROVIDE PROPER EARTHING AND BONDING FOR THE HYDROCARBON LINES.
3. DELETED.
4. DRAIN TO BE PROVIDED AT THE LOWEST POINT AND VENT TO BE PROVIDED AT THE HIGHEST POINT.
5. REFER LEGEND SHEET FOR ABBREVIATIONS, SYMBOL, ON-OFF VALVE DETAILS, MOTOR/VFD AND STEAM TRAP DETAILS.
   DWG NO. EPAM01-PR-PID-1000,
   EPAM01-PR-PID-1001,
   EPAM01-PR-PID-1002.
6. FOR LINES WITH SLOPE, SLOPE TO BE PROVIDED IN SUCH A WAY THAT THE LINE SHOULD BE DRAINED ON EITHER SIDE.
7. PROPOSED SPECIAL PIPING ITEM. TO BE FINALISED DURING DETAIL ENGINEERING.
8. TYPICAL XV SYMBOL ON PID TO BE READ AS BELOW.
   (TYPE-1,2,3) (TYPE-1,2,3)
9. FOR ALL INLINE INSTRUMENTS, UPSTREAM AND DOWNSTREAM DISTANCE TO BE CONSIDERED IN PIPING.
10. ORIFICE TO BE INSTALLED IN HORIZONTAL LINE ONLY.
11. INSTRUMENT ISOLATION VALVES & DRAIN/VENT REQUIREMENT TO BE UPDATED DURING DETAILED DESIGN ALONG WITH THE P&ID.

NOTES:

1. DO NOT PROVIDE SLOPE IN THE LINE TOWARDS VACUUM PUMP.
2. DETAILS ON VACUUM PUMP REPRESENTED IS PRELIMINARY. TO BE FINALISED DURING DETAILED ENGINEERING.
3. FLAME ARRESTOR TO BE AN INTEGRAL PART OF PVRV. SAME WILL BE PROCURED ALONG WITH PRV. FUNNEL ARRANGEMENT AND ROUTING TO BE DONE DURING DETAILED ENGINEERING.
4. E-503A TO BE MINIMUM 500 MM ELEVATED THAN E-502A.
5. FT-E502A02 TO BE MOUNTED ON A VERTICAL LINE.
6. DRAIN TO BE ROUTED TO THE NEAREST WASTE WATER HEADER.
7. VACUUM POT AND ASSOCIATED CONTROL VALVE TO BE SIZED DURING DETAILED DESIGN.
8. CATCH POT TO BE SIZED DURING DETAILED DESIGN.

HOLDS:

1. VACUUM PUMP DETAILS.
2. UTILITY REQUIREMENT FOR VACUUM PUMP.
3. PRV SIZE.

No.	DATE	REVISION	DRAWN	CHD	REVD	APPD
0	01-JUN-26	ISSUED FOR DETAIL ENGG.	DVS	NC	DP	KV
B	29-MAY-26	ISSUED FOR DESIGN	DVS	NC	DP	KV
A	27-MAR-26	ISSUED FOR APPROVAL	DVS	NC	DP	KV

Rasayan Engineering Solutions

CLIENT: EPIGRAL Limited

PROJECT: BASIC ENGINEERING FOR EPAM PROJECT

TITLE: PIPING & INSTRUMENTATION DIAGRAM RD REACTOR TRAIN-I

SCALE : NTS | DWG.NO.:EPAM01-PR-PID-0502 | SHT: 1 OF 1 | REV. 0