


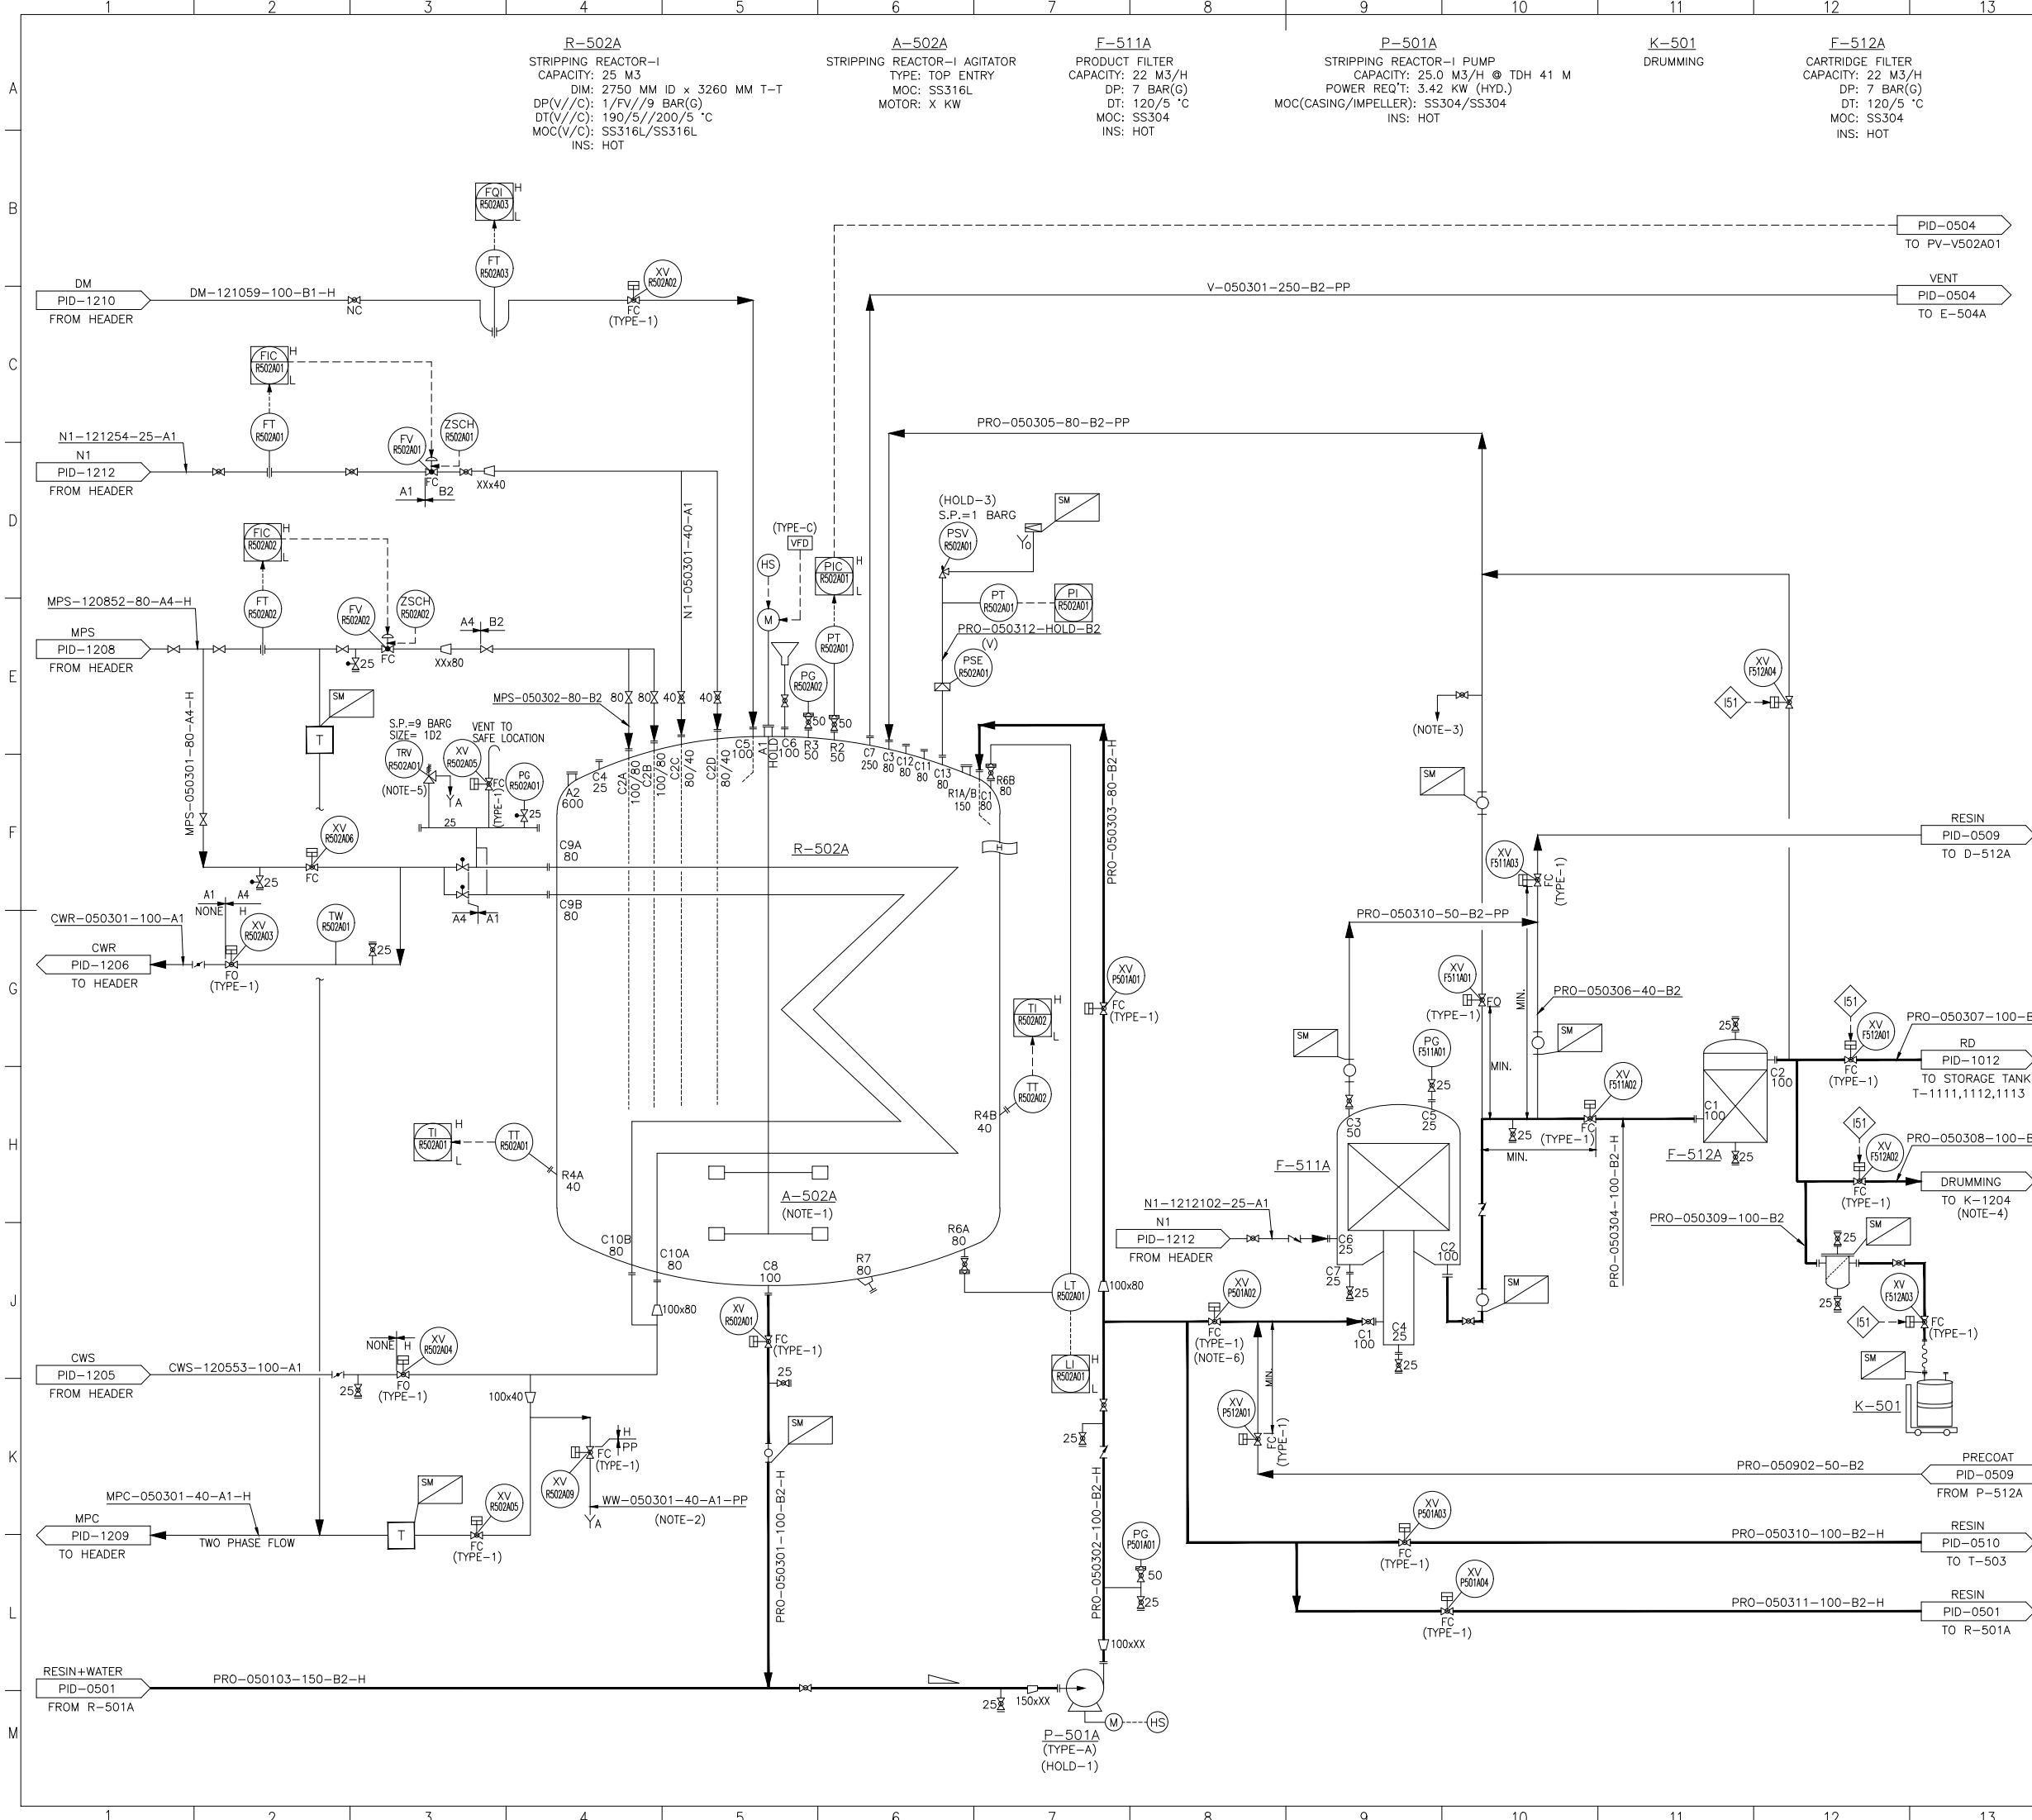

GENERAL NOTES:

- ALL VAPOR LINES, SLURRY LINES AND GRAVITY LINES SHOULD HAVE MINIMUM BENDS AND NO LOOPS.
- PROVIDE PROPER EARTHING AND BONDING FOR THE HYDROCARBON LINES.
- DELETED.
- DRAIN TO BE PROVIDED AT THE LOWEST POINT AND VENT TO BE PROVIDED AT THE HIGHEST POINT.
- REFER LEGEND SHEET FOR ABBREVIATIONS, SYMBOL, ON-OFF VALVE DETAILS, MOTOR/VFD AND STEAM TRAP DETAILS.
- DWG NO. EPAM01-PR-PID-1000, EPAM01-PR-PID-1001, EPAM01-PR-PID-1002.
- FOR LINES WITH SLOPE, SLOPE TO BE PROVIDED IN SUCH A WAY THAT THE LINE SHOULD BE DRAINED ON EITHER SIDE.
- PROPOSED SPECIAL PIPING ITEM. TO BE FINALISED DURING DETAIL ENGINEERING.
- TYPICAL XV SYMBOL ON PID TO BE READ AS BELOW.

- FOR ALL INLINE INSTRUMENTS, UPSTREAM AND DOWNSTREAM DISTANCE TO BE CONSIDERED IN PIPING.
- ORIFICE TO BE INSTALLED IN HORIZONTAL LINE ONLY.
- INSTRUMENT ISOLATION VALVES & DRAIN/VENT REQUIREMENT TO BE UPDATED DURING DETAILED DESIGN ALONG WITH THE P&ID.

NOTES:

- AGITATOR MOTOR SHALL TRIP FROM DCS IN CASE OF MECHANICAL SEAL LEAKAGE.
- ALL DRAIN POINTS SHALL BE CONNECTED TO A SEPARATE HEADER.
- SAMPLE POINT PROVISION, SAMPLE TO BE COLLECTED MANUALLY.
- DRUMMING IN WAREHOUSE.
- FUNNEL ARRANGEMENT AND ROUTING TO BE DONE DURING DETAILED ENGINEERING.
- XV-P501A02 SHOULD BE NEAR TO T POINT.

HOLDS:

- PUMP SUCTION AND DISCHARGE NOZZLE SIZE.
- FILTER NOZZLE DETAILS.
- PSV SIZE.

INTERLOCK TABLE:

NO.	CAUSE	EFFECT
151	IF ONE XV OPEN OF XV-F512A01/XV-F512A02/XV-F512A03/XV-F512A04	OTHER XVs REMAIN CLOSED

Rasayan Engineering Solutions

CLIENT: **EPIGRAL** | **EPIGRAL Limited**

PROJECT: **BASIC ENGINEERING FOR EPAM PROJECT**

TITLE: **PIPING & INSTRUMENTATION DIAGRAM STRIPPING REACTION & FILTRATION SECTION (RD) TRAIN-I**

SCALE : NTS	DWG.NO.:EPAM01-PR-PID-0503	SHT: 1 OF 1	REV. 0
-------------	----------------------------	-------------	--------