




Cross-zone summary of thermal persistence coefficient a_z

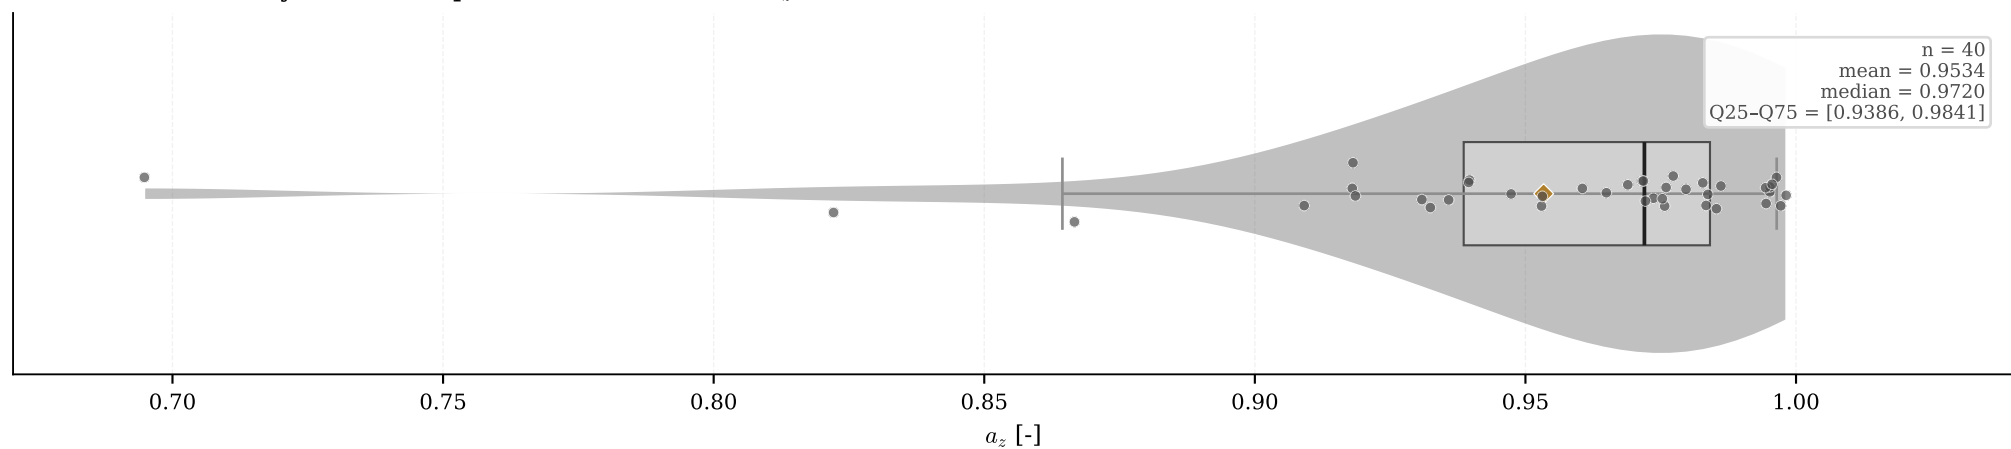

Cross-zone summary of outdoor-temperature coefficient b_z

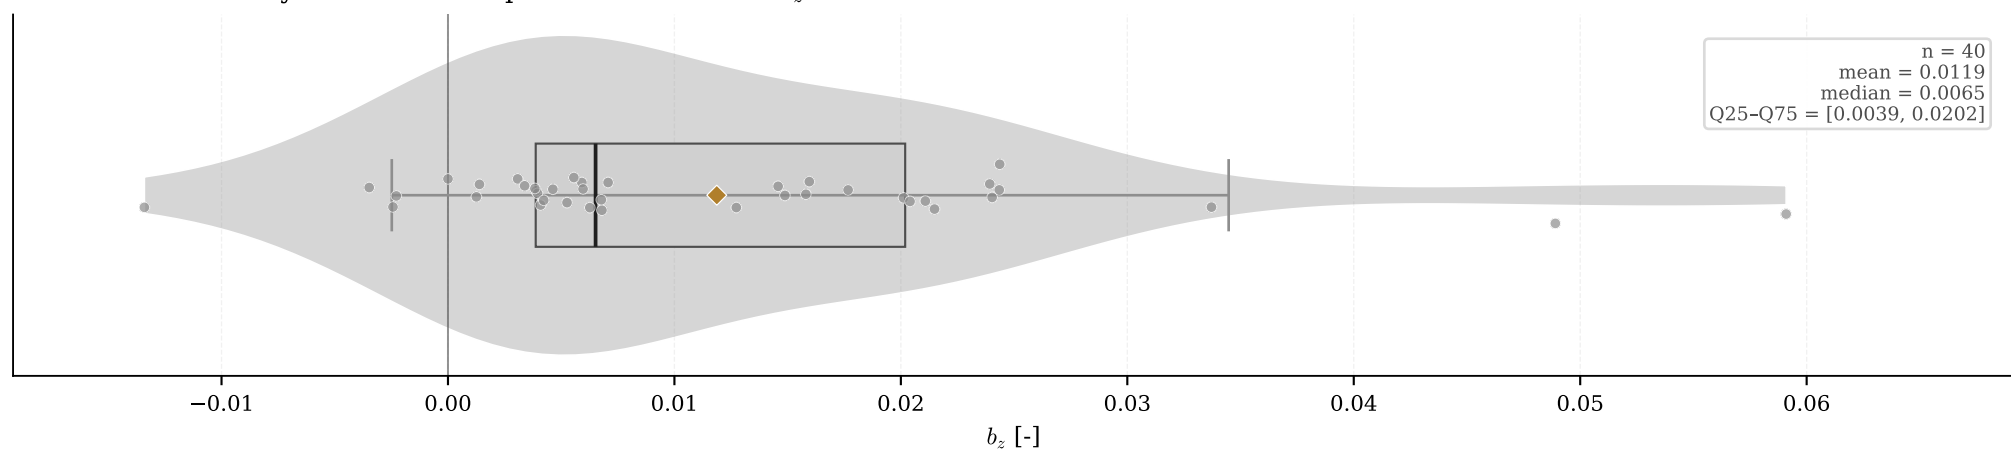

Cross-zone summary of additive term c_z

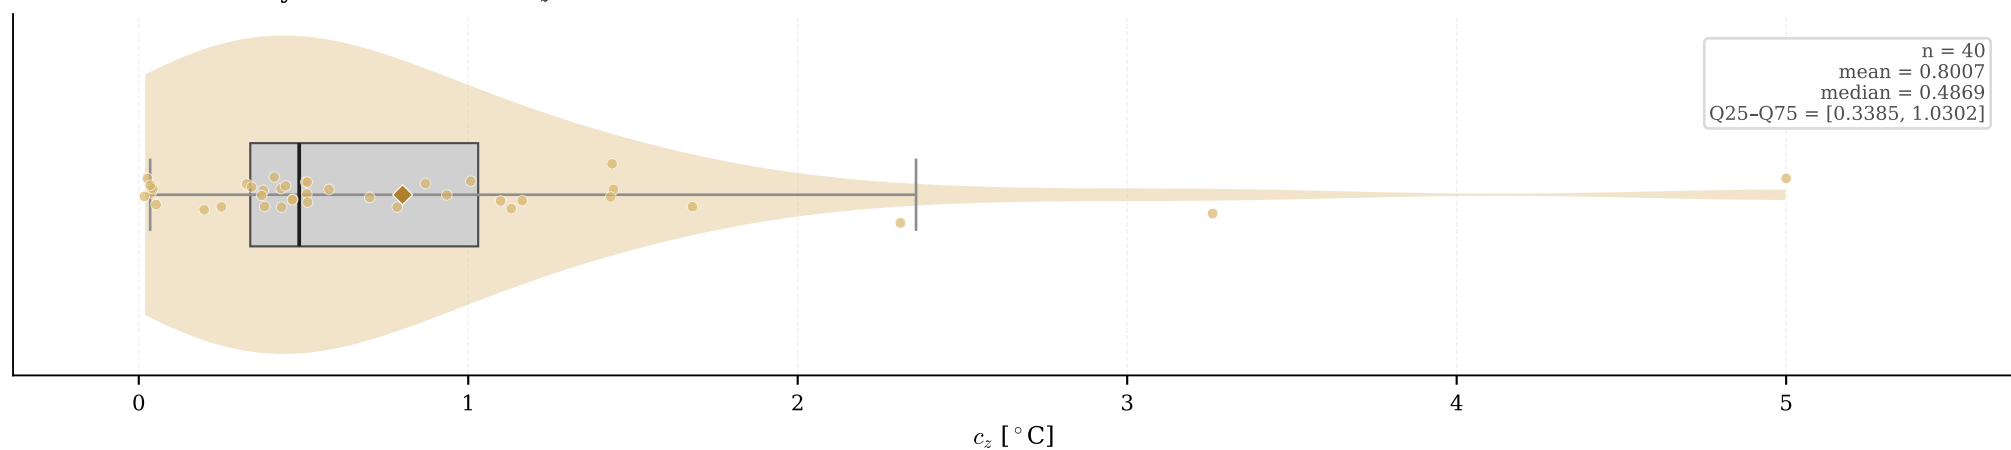

Density shape (violin)
 Individual zone estimate
 P05-P95 range
 Q25-Q75 (IQR)
 Median
 Mean

Integrated violin-box-scatter summary across zones. a_z and b_z are dimensionless, c_z is an additive temperature term, and g_z expresses the temperature response per unit of the identified effective HVAC input u_z .