Ink & Varnish Free Area

великобритания. HOTTNHYEM, NG90 2DB, Интернешнл Лтд, Тейн Роуд, Рекитт Бенкизер Хелскэр Отпуск без рецепта.

. С. эшыя эн эqүтёqэпмэт nqп хранить в сухом месте

.ЭТЭЭМ ИЭТЭД КГСД МОНПҮТ ЗАНИТЬ ПРЕПАРАТ В НЕДОСТУПНОМ


декстроза жидкая [декстроза, олиго- и полисахариды] (жидкая глюкоза). прутовидного листьев масло, винная кислота, индигокармин, сахароза жидкая, амилметакрезол – 0,6 мг, левоментол - 8 мг и вспомогательные вещества: эвкалипта

Одна таблетка содержит активные вещества: 2,4-дихлорбензиловый спирт – 1,2 мг,

способ применения. Местно. Рекомендуется взрослым и детям старше 5 лет. Рассасыв 10 одной таблетке каждые 2-3 часа. Не принимать более 8 таблеток в течение 24 часов.

и десен (афтозный стоматит, гингивит, молочница). Эфирные масла ментола и эвкалипта угольнои промышленности), охриплости, воспалении слизистои оболочки полости рта профессионального характера - у преподавателей, дикторов, работников химической и инфекционно-воспалительных заболеваниях: тонзиллит, фарингит, ларингит (в т.ч. Симптоматическое лечение боли в ротовой полости, горле, гортани при Препарат обладает антисептическим и антимикотическим действием.





Strepsils® CTPERICUTIC® CMENTORON H 3 BRAINHTON

От боли в горле и Заложенности носа

Сментолом и эвкалиптом

2,4-дихлорбензиловый спирт 1,2 мг Амилметакрезол 0,6 мг Левоментол 8 мг

24 таблетки для рассасывания ментолово-эвкалиптовые



От боли в горле и заложенности носа



trepsils

с Ментолом и Эвкалиптом ментолово-эвкалиптовые Лечение боли в горле

трепсилс



RBH Artwork and Print Specification

TR409765 Trident Reference No: Action / Version: Brand:

Brand Platform: Throatcare Sub Platform: First Aid Medicine Sub Brand: Core Throat Format:

Delivery: Sore Throat & Blocked Nose Pack Size: 24's

Country: Date Created: 01/09/10 Date Modified: 17/04/12

RBH Contact Victoria Bondarenko

Artwork Type: Commercial Print

Component Code (2D if applicable): Parent Technical Packaging D0278921 Specification:

Bulk Code (if applicable):

CAD Cam Ref: S-Crt-FB-S1-79x109x21mm-D0278921-(Lott Chesapeake (Nottingham, UK) Substrate

Edgemark Position: Pharmacode No/NE: 1000110110(1589)



Print and Tec	hnic	al Colours			
Process Yellow		Varnish-Water Based		Process Black	
		Emulsion			
	1		2		3
	LTH		LTH		LTH
Emboss		PANTONE 321	c		
	4		5		
	LTH		LTH		

COLOURS TO MATCH RECOGNISED STANDAR

120

110

100

BARCODE INFO

Barcode Type: Barcode Number 5000158100169 Magnification: Truncated by (smallest Bar): 5.5 mm

Encoded Data:

All other aspects of the bar code to conform to the current GS1 Operating Manual or other agreed commercial standard.



Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100

Please note that any low resolution paper Canon colou copies associated with this job should be referred to for content, layout and colour separation only.


STUDIO USE ONLY Leanne Clarke Sm•Art check results: G=0: O=3: R=0: - LC - 17/04/12 10:32:41

ARTWORK APPROVAL

UNDER NO CIRCUMSTANCES SHOULD THIS PERMISSION FROM TRIDENT. Tel. Alan Smith: +44 (0)1482 710304

NOT APPROVED FOR COLOUR

CUSTOMER INFO: Minimum Point Size = 7 pt

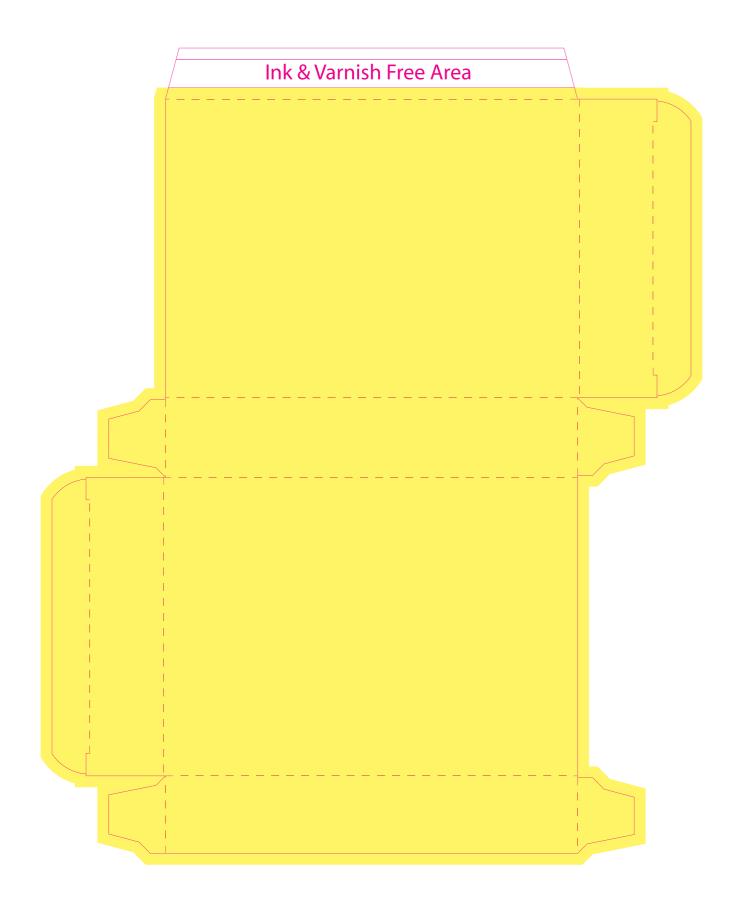

RBH Artwork and Print Specification

TR409765 Trident Reference No: Action / Version: Brand Platform: Throatcare Sub Platform: First Aid Medicine Sub Brand:

Format: Lozenge Delivery: Sore Throat & Blocked Nose

Core Throat

Pack Size: 24's Russia Country: Date Created: 01/09/10 Date Modified: 17/04/12

Victoria Bondarenko

Artwork Type: Commercial Print

Component Code (2D if applicable): Parent Technical Packaging D0278921 Specification:

Bulk Code (if applicable): na

CAD Cam Ref: S-Crt-FB-S1-79x109x21mm-D0278921-(Lotti Chesapeake (Nottingham, UK) Substrate:

210

180

160

120

110


100

9

- 2

Edgemark Position: 1,F, u
Pharmacode No/NE: 1000110110(1589)





COLOURS TO MATCH RECOGNISED STANDARD

BARCODE INFO

Barcode Type: EAN 13 Barcode Number: 5000158100169 Magnification: 85% 0 microns Truncated by (smallest Bar): 5.5 mm Encoded Data:

All other aspects of the bar code to conform to the current GS1 Operating Manual or other agreed commercial standard.



Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100

Please note that any low resolution paper Canon colour copies associated with this job should be referred to for content, layout and colour separation only.

STUDIO USE ONLY Leanne Clarke Sm•Art check results: G=0; O=3; R=0; - LC - 17/04/12 10:32:41

ARTWORK APPROVAL

UNDER NO CIRCUMSTANCES SHOULD THIS PERMISSION FROM TRIDENT.

CUSTOMER INFO: Minimum Point Size = 7 pt



RBH Artwork and Print Specification

Trident Reference No: TR409765
Action / Version: L
Brand: Strepsils
Brand Platform: Throatcare
Sub Platform: First Aid Medicine
Sub Brand: Core Throat
Format: Logence

Format: Lozenge
Delivery: Sore Throat & Blocked Nose
Pack Size: 24's

Country: Russia
Date Created: 01/09/10
Date Modified: 17/04/12

H Contact: Victoria Bondarenko

Artwork Type: Commercial Print


Component Code (2D if applicable): 0325272
Parent Technical Packaging
Specification: 0325272

Bulk Code (if applicable): na

CAD Cam Ref: S-Crt-FB-S1-79x109x21mm-D0278921-(Lottic Printer: Chesapeake (Nottingham, UK) Substrate: Carton Board - White

Edgemark Position: 1,F, u Pharmacode No/NE: 1000110110(1589)





180

160

120

110

100

9

- 2

COLOURS TO MATCH RECOGNISED STANDARDS

BARCODE INFO

Barcode Type: EAN 13
Barcode Number: 5000158100169
Magnification: 85%
BWR: 0 microns
Truncated by (smallest Bar): 5.5 mm
Encoded Data: N/A

All other aspects of the bar code to conform to the current GS1 Operating Manual or other agreed commercial standard.



Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100

Please note that any low resolution paper Canon colour copies associated with this job should be referred to for content, layout and colour separation only.

 STUDIO USE ONLY
 Leanne Clarke
 v1.

 Sm•Art check results:
 G=0; 0=3; R=0; - LC - 17/04/12 10:32:41

ARTWORK APPROVAL

Approved by Sonoco Trident on behalf of Reckitt Benckiser
Signed:

UNDER NO CIRCUMSTANCES SHOULD THIS ARTWORK BE ALTERED WITHOUT PRIOR PERMISSION FROM TRIDENT. Tel. Alan Smith: +44 (0)1482 710304

NOT APPROVED FOR COLOU

CUSTOMER INFO: Minimum Point Size = 7 pt

Production line Manufacturing site Pack Tech approver		DD11 A (1
		RBH Artwork
Pack Tech approver 1s		and Print Specification
	st 2 nd	
Date	1	Trident Reference No: TR409765
	Details & Comments Checks	Action / Version: L Brand: Strepsils
Approvals	1st 2nd	Sub Platform: First Aid Medicine
Market Approval		Sub Brand: Core Throat
Regulatory Approval		Format: Lozenge Delivery: Sore Throat & Blocked No.
3rd Party Approval	1 1	Delivery: Sore Throat & Blocked No Pack Size: 24's
echnical Drawing/Cutter ref no.	+ +	Country: Russia
		Date Created: 01/09/10
PPI component code correct on artwork?		Date Modified: 17/04/12
Correct drawing for the production line?		RBH Contact: Victoria Bondarenko
Profile shape & dimensions		Artwork Type: Commercial Pri
Graphics layout/orientation		
Unwind diagram (PPTD1022/1-20)		Component Code (2D if applicable): 0325272
Printable areas/bleed		Parent Technical Packaging D0278921 Specification:
		•
Varnish free areas		Bulk Code (if applicable): na
Variable coding position & dimensions		
Varnish and print requirements		CAD Cam Ref: S-Crt-FB-S1-79x109x21mm-D0278921-(L Printer: Chesapeake (Nottingham, UK)
Pre-printed headers (alignment and suitability)	† †	Substrate: Carton Board - White
Embossing, Braille & Foil Blocking		Edgemark Position: 1,F, u
		Pharmacode No/NE: 1000110110(1589)
Separations on artwork		
Alignment within cutter		Cutter - Does not print Guides- Does not print
Braille structure		
Verification Code Type; Pharma Code / 2D / OCV	1 1	
Bar sequence and/or number correct Position	 	Print and Technical Colours
		Process Yellow Varnish-Water Based Process Black Emulsion
Size (height, width, spacing, font)		1 2
Direction of read		LTH LTH
Light margins and print free areas		Emboss PANTONE 321 C
Colour		LIIIUUSS FANIUNE 321 C
Repeat distance (reeled material)	† †	4 5
Bar code Type; EAN, ITF, Code39, etc		LTH LTH
		1
Magnification / width and height		41
Colour (e.g. black print on white background)		_I
Light margins & indicators		11
Bearer bars & H gauges (if required)		1
		-
Symbol grade (Pass = A,B,C; Action = D,F)		4
Bar code number (human readable)		4
Bar code number (encoded & hidden data)		
Confirm bar code number from source		COLOURS TO MATCH RECOGNISED STANDAR
Cross check related docs (JDE/PID)	† †	DADCODE IMEO
Photo-electric cell mark / edge marks	+ +	BARCODE INFO
		Barcode Type: EAN 13
Present & per Tech drawing?		Barcode Type: EAN 13 Barcode Number: 5000158100169
10		Magnification: 85%
Correct pitch?		BWR: 0 microns
Additional markings		Truncated by (smallest Bar): 5.5 mm
Additional markings	1 1	II Fucoded Data: N/A
Additional markings e-mark, recycle logo etc	++-	Encoded Data: N/A All other aspects of the har code to confor
Additional markings e-mark, recycle logo etc Legend box (RB specification)		All other aspects of the bar code to confor
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard.
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec		All other aspects of the bar code to confor
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code		All other aspects of the bar code to confor
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec		All other aspects of the bar code to confor
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard.
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate		All other aspects of the bar code to confor to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road,
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England.
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road,
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only.
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct Pass / Fail comments and Signature		All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct Pass / Fail comments and Signature	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only.
rkings e logo etc B specification) nent code ate appropriately for this substrate ails etails t process nation s are correct ments and Signature he artwork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England T: +44 (0) 1482 828100 Please note that any low resolution paper Canon complete content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke
riately for this substrate ss rrect and Signature vork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England T: +44 (0) 1482 828100 Please note that any low resolution paper Canon or copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:33
al markings recycle logo etc box (RB specification) component code D spec printer Substrate et up appropriately for this substrate ork details Et print process information details are correct iil comments and Signature bying the artwork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke
dditional markings -mark, recycle logo etc egend box (RB specification) forrect component code forrect D spec forrect printer forrect Substrate JW is set up appropriately for this substrate dge mark details harmacode details folours & print process farnish farcode information feneral details are correct fass / Fail comments and Signature y approving the artwork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:32:
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct Pass / Fail comments and Signature By approving the artwork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC-17/04/12 10:32:
dditional markings -mark, recycle logo etc egend box (RB specification) orrect component code orrect D spec orrect Frinter orrect Substrate /W is set up appropriately for this substrate dge mark details harmacode details olours & print process arnish arcode information eneral details are correct ass / Fail comments and Signature y approving the artwork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:32:
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:32: ARTWORK APPROVAL Approved by Sonoco Trident on behalf of Reckitt Benckis Signed:
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct Pass / Fail comments and Signature By approving the artwork referenced within this for Additional Comments	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:32: ARTWORK APPROVAL Approved by Sonoco Trident on behalf of Reckitt Benckis
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct Printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct Pass / Fail comments and Signature By approving the artwork referenced within this for Additional Comments	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:32: ARTWORK APPROVAL Approved by Sonoco Trident on behalf of Reckitt Benckis Signed: Date: Date: Date:
Additional markings e-mark, recycle logo etc Legend box (RB specification) Correct component code Correct D spec Correct printer Correct Substrate A/W is set up appropriately for this substrate Edge mark details Pharmacode details Colours & print process Varnish Barcode information General details are correct Pass / Fail comments and Signature By approving the artwork referenced within this for	rm I authorise it for release to the print supplier	All other aspects of the bar code to confort to the current GS1 Operating Manual or other agreed commercial standard. TRIDENT Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100 Please note that any low resolution paper Canon col copies associated with this job should be referred to content, layout and colour separation only. STUDIO USE ONLY Leanne Clarke Sm*Art check results: G=0; 0=3; R=0; - LC - 17/04/12 10:32: ARTWORK APPROVAL Approved by Sonoco Trident on behalf of Reckitt Benckis Signed: