

Отпуск без рецепта. . С. «С. выше 25° С.


.ЭТОЭМ ЙЭТЭД RПД МОНПҮТ ЗАНИТЬ ПРЕПАРАТ В НЕДОСТУПНОМ

декстроза жидкая [декстроза, олиго- и полисахариды] (жидкая глюкоза). прутовидного листьев масло, винная кислота, индигокармин, сахароза жидкая, эмилиетакрезол – 0.6 мг, левоментол - 8 мг и вспомогательные вещества: эвкалипта Одна таблетка содержит активные вещества: 2,4-дихлорбензиловый спирт – 1,2 мг,

и десен (афтозный стоматит, гингивит, молочница). Эфирные масла ментола и эвкалипта угольной промышленности), охриплости, воспалении слизистой оболочки полости рта профессионального характера - у преподавателей, дикторов, работников химической и инфекционно-воспалительных заболеваниях: тонзиллит, фарингит, парингит (в т.ч. Симптоматическое лечение боли в ротовой полости, горле, гортани при Препарат обладает антисептическим и антимикотическим действием.



От боли в горле и заложенности носа



Лечение боли в горле

Strepsils® CTPERICUTIC® CMHTOTOM IN 3 BHEATURITION

От боли в горле и Заложенности носа

Сментолом и эвкалиптом

2,4-дихлорбензиловый спирт 1,2 мг Амилметакрезол 0,6 мг Левоментол 8 мг

36 таблеток для рассасывания ментолово-эвкалиптовых









RBH Artwork and Print Specification Trident Reference No: TR409761

Action / Version: Brand: **Brand Platform:** Throatcare Sub Platform: First Aid Medicine Sub Brand: Core Throat Format: Lozenae

Delivery: Sore Throat & Blocked Nose

Date Created: 01/09/10 Date Modified 17/04/12

Artwork Type: Commercial Print

D0279139

210

Parent Technical Packaging Specification:

Bulk Code (if applicable):

RBH Contact

CAD Cam Ref: S-Crt-FB-S4-79x110.5x31.5mm-D0279139-(Lot Chesapeake (Nottingham, UK)

Edgemark Position: Pharmacode No/NE:



Print and Te	cnnic	ai Colours			
Process Yellow		Varnish-Water Based		Process Black	
		Emulsion			
	1		2		3
	LTH		LTH		LTH
Emboss		PANTONE 321 C			
	4		5		
	LTH		LTH		

COLOURS TO MATCH RECOGNISED STANDARDS

Barcode Type: Barcode Number 5000158101814 Magnification: BWR: 0 microns Truncated by (smallest Bar): 0.0 mm

BARCODE INFO

All other aspects of the bar code to conform to the current GS1 Operating Manual or other agreed commercial standard.



vood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100

Please note that any low resolution paper Canon colou copies associated with this job should be referred to for content, layout and colour separation only.

STUDIO USE ONLY


m•Art check results: G=0; O=3; R=0; -LC - 17/04/12 09:39:15

ARTWORK APPROVAL

UNDER NO CIRCUMSTANCES SHOULD THIS ARTWORK BE ALTERED WITHOUT PRIOR PERMISSION FROM TRIDENT.

NOT APPROVED FOR COLOUR

CUSTOMER INFO: Minimum Point Size = 7 pt

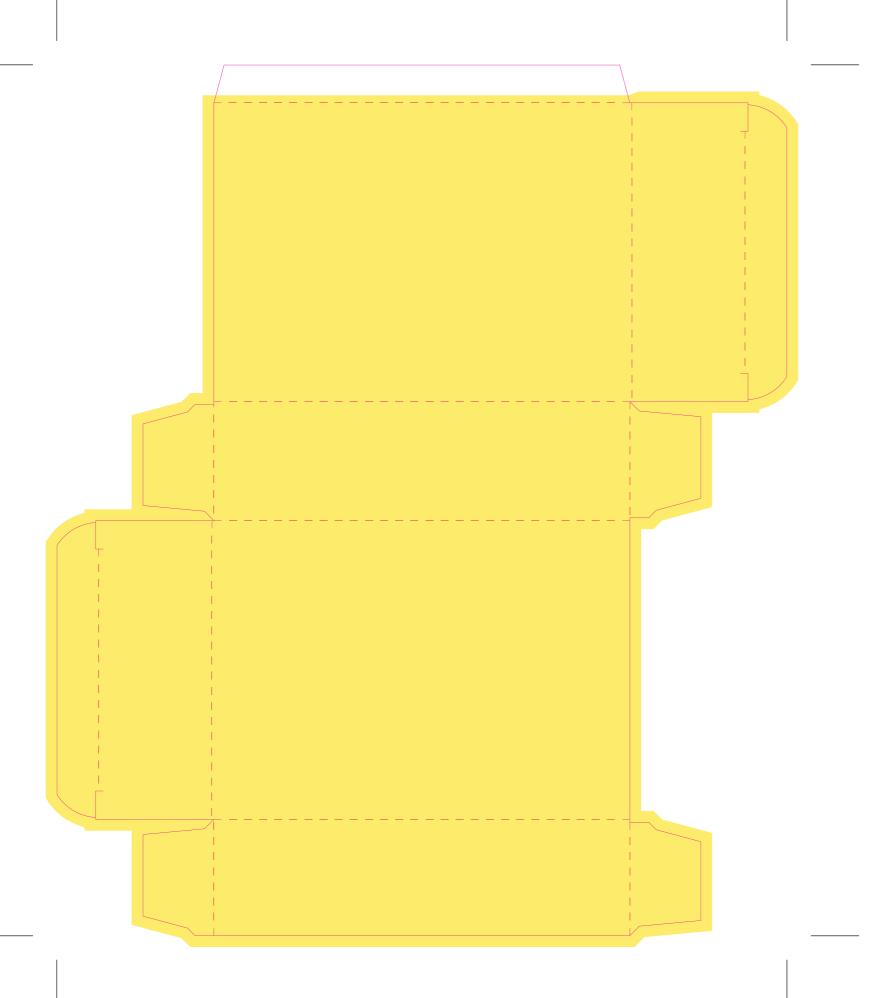

RBH Artwork and Print Specification

280

260

240

220

210

200

180

170

160

140

120

110

100

90

70

40

- 2

Trident Reference No: TR409761
Action / Version: M Action / Version: Brand: Strepsi**l**s Brand Platform: Sub Platform: Throatcare First Aid Medicine Sub Brand: Core Throat Format: Lozenge

Delivery: Sore Throat & Blocked Nose Pack Size: Country:

Date Created: Date Modified: 01/09/10 17/04/12

RBH Contact: Victoria Bondarenko

Artwork Type: Commercial Print Component Code (2D if applicable): 0301285


D0279139

Parent Technical Packaging Specification:

Bulk Code (if applicable): na

CAD Cam Ref: S-Crt-FB-S4-79x110.5x31.5mm-D0279139-(Lotti Printer: Chesapeake (Nottingham, UK)
Substrate: Carton Board - White

Edgemark Position: 1,E, w Pharmacode No/NE: 1001010011(1618)



Print and Technical Colours

Process Yellow		Varnish-Water Based Emu l sion		Process Black		
	1		2		3	
	LTH		LTH		LTH	
Emboss	Emboss		PANTONE 321 C			
	4		5			
	LTH		LTH			

COLOURS TO MATCH RECOGNISED STANDARDS

BARCODE INFO

Barcode Type: 5000158101814 **Barcode Number** Magnification: 100% BWR: 0 microns Truncated by (smallest Bar): 0.0 mm

Encoded Data:

All other aspects of the bar code to conform to the current GS1 Operating Manual or other agreed commercial standard.



Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England. T: +44 (0) 1482 828100

Please note that any low resolution paper Canon colour copies associated with this job should be referred to for content, layout and colour separation only.

STUDIO USE ONLY Leanne Clarke

Sm•Art check results: G=0; O=3; R=0; - LC - 17/04/12 09:39:15


ARTWORK APPROVAL

UNDER NO CIRCUMSTANCES SHOULD THIS ARTWORK BE ALTERED WITHOUT PRIOR PERMISSION FROM TRIDENT.

Tel. Alan Smith: +44 (0)1482 710304 NOT APPROVED FOR COLOUR

Minimum Point Size = 7 pt

CUSTOMER INFO:

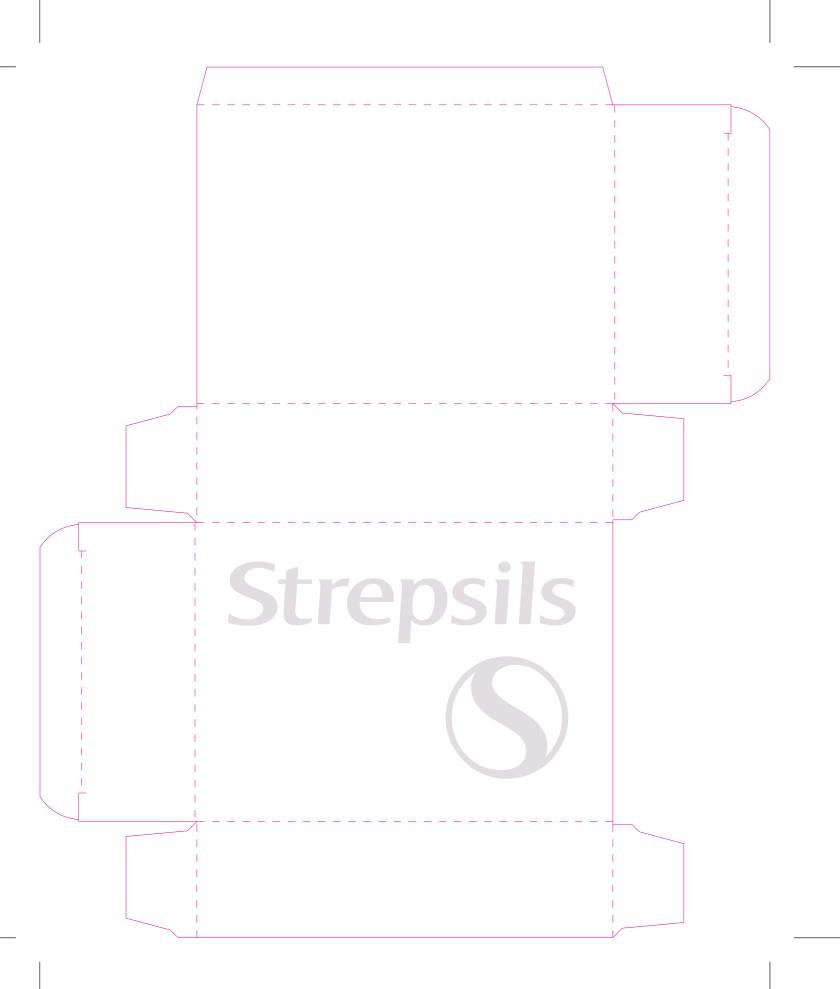

RBH Artwork and Print Specification

Trident Reference No: TR409761
Action / Version: M
Brand: Strepsils
Brand Platform: First Aid Medicine
Sub Brand: Core Throat
Format: Lozence

Delivery: Sore Throat & Blocked Nose Pack Size: 36 Country: Russia

 Date Created:
 01/09/10

 Date Modified:
 17/04/12

Artwork Type: Commercial Print

Component Code (2D if applicable):
Parent Technical Packaging
Specification:

Ode): 0301285 D0279139

Victoria Bondarenko

280

240

210

200

180

170

140

120

100

90

- 2

Bulk Code (if applicable):

RBH Contact:

CAD Cam Ref: S-Crt-F8-54-79x110.5x31.5mm-D0279139-(Lotti Printer: Chesapeake (Nottingham, UK) Substrate: Carton Board - White

Substrate: Carton Board - White Edgemark Position: 1,E, w

Pharmacode No/NE: 1001010011(1618)



Print and Technical Colours

Process Yellow		Varnish-Water Based Emu l sion		Process Black		
	1		2		3	
	LTH		LTH		LTH	
Emboss		PANTONE 321	С			
	4		5			
	LTH		LTH			

COLOURS TO MATCH RECOGNISED STANDARDS

BARCODE INFO

Barcode Type: EAN 13
Barcode Number: 5000158101814
Magnification: 100%
BWR: 0 microns

Truncated by (smallest Bar): 0.0 mm
Encoded Data: N/A

All other aspects of the bar code to conform to the current GS1 Operating Manual or other agreed commercial standard.



Connaught House, Connaught Road, Kingswood Business Park, Hull, HU7 3AP, England T: +44 (0) 1482 828100

Please note that any low resolution paper Canon colour copies associated with this job should be referred to for content, layout and colour separation only.

STUDIO USE ONLY Leanne Clarke

Sm•Art check results: G=0; 0=3; R=0; -LC - 17/04/12 09:39:15

ARTWORK APPROVAL

UNDER NO CIRCUMSTANCES SHOULD THIS ARTWORK BE ALTERED WITHOUT PRIOR PERMISSION FROM TRIDENT. Tel. Alan Smith: +44 (0)1482 710304

NOT APPROVED FOR COLOUR

CUSTOMER INFO: Minimum Point Size = 7 pt

Production line
Manufacturing site
Pack Tech approver
Date Check Critoria
Check Criteria
Approvals
Market Approval
Regulatory Approval
3rd Party Approval
Technical Drawing/Cutter ref n
PPI component code correct or
Correct drawing for the produc
Profile shape & dimensions
Graphics layout/orientation
Unwind diagram (PPTD1022/1-
Printable areas/bleed
Varnish free areas
Variable coding position & dim
Varnish and print requirements
Pre-printed headers (alignmen
Embossing, Braille & Foil Block
Separations on artwork
Alignment within cutter
Braille structure
Verification Code Type; Pharma
Bar sequence and/or number c
Size (height, width, spacing, fo
Direction of read
Light margins and print free ar
Colour
Repeat distance (reeled materi
Bar code Type; EAN, ITF, Code3
Magnification / width and heigh
Colour (e.g. black print on whi
Light margins & indicators
Bearer bars & H gauges (if req
Symbol grade (Pass = A,B,C; Ac
Bar code number (human read
Bar code number (encoded & h
Confirm bar code number from
Cross check related docs (JDE/I
Photo-electric cell mark / edge
Present & per Tech drawing?
Correct pitch?
Additional markings
e-mark, recycle logo etc
Legend box (RB specification)
Correct component code
Correct D spec
Correct printer
Correct Substrate
A/W is set up appropriately for
Edge mark details
Pharmacode details
Colours & print process
Varnish Barcode information
General details are correct
Pass / Fail comments and Sign
By approving the artwork refe
Additional Comments
/ dutitional comments
Version 001 14/2/2011

Production line				
Manufacturing site				and Print S
Pack Tech approver	1 st	2 nd		Trident Reference No: T
Date				Action / Version: N
Check Criteria	Details & Comments		cks	Brand: Si Brand Platform: The
Approvals		1 st	2 nd	Sub Platform:
Market Approval				Sub Brand: C
Regulatory Approval				Format: Lo Delivery: So
3rd Party Approval				Pack Size: 3
Technical Drawing/Cutter ref no.				Country: R Date Created: 0
PPI component code correct on artwork?				Date Modified:
Correct drawing for the production line?				RBH Contact:
Profile shape & dimensions				Artwork Type: C
Graphics layout/orientation				Component Code (2D if app
Unwind diagram (PPTD1022/1-20)				Parent Technical Packagii
Printable areas/bleed				Specification:
Varnish free areas				Bulk Code (if applicable): n:
Variable coding position & dimensions				
Varnish and print requirements				CAD Cam Ref: S-Crt-FB-S4- Printer: Chesapeak
Pre-printed headers (alignment and suitability)				Substrate: Carton Bo
Embossing, Braille & Foil Blocking			П	Edgemark Position: 1,
Separations on artwork				Pharmacode No/NE: 10
Alignment within cutter			П	Cutter - Does not print Guides- Does not print
Braille structure			М	
Verification Code Type; Pharma Code / 2D / OCV				
Bar sequence and/or number correct Position				Print and Technical Colou Process Yellow Varnish-W
Size (height, width, spacing, font)				Emu
Direction of read				1 LTH
Light margins and print free areas				- Cili
Colour				Emboss PANTON
Repeat distance (reeled material)			\vdash	4
Bar code Type; EAN, ITF, Code39, etc			\vdash	LTH
Magnification / width and height			\vdash	
Colour (e.g. black print on white background)	1		\vdash	
Light margins & indicators	+			
Bearer bars & H gauges (if required)			\vdash	
Symbol grade (Pass = A,B,C; Action = D,F)	-		\vdash	
Bar code number (human readable)	1		\vdash	
			\vdash	
Bar code number (encoded & hidden data)			\vdash	COLOURS TO MATCH R
Confirm bar code number from source			\vdash	
Cross check related docs (JDE/PID)				BARCODE IN
Photo-electric cell mark / edge marks				Barcode Type:
Present & per Tech drawing?				Barcode Number:
Correct pitch?				Magnification:
Additional markings			Ш	BWR: Truncated by (smallest Bar):
e-mark, recycle logo etc				Encoded Data:
Legend box (RB specification)				All other aspects of th
Correct component code				to the current GS1 other agreed con
Correct D spec				
Correct printer				Π
Correct Substrate				1 19
A/W is set up appropriately for this substrate				TRII
Edge mark details				Connaught House
Pharmacode details				Kingswood Business Park
Colours & print process				T: +44 (0) 1
Varnish				Please note that any low re
Barcode information				Please note that any low re- copies associated with this
General details are correct			М	content, layout and c
Pass / Fail comments and Signature				STUDIO USE ONLY Leans
By approving the artwork referenced within this Additional Comments	form I authorise it for release to	o the print supplier		Sm•Art check results: G=0; C
				ARTWORK A
				Approved by Sonoco Trident or
				Signed:
				Date:
				4

290 Artwork Specification 280 ΓR409761 Strepsils 270 Throatcare First Aid Medicine Core Throat 260 Lozenge Sore Throat & Blocked Nose Russia 01/09/10 17/04/12 250 /ictoria Bondarenko 240 Commercial Print 230 0301285 D0279139 220

4–79x110.5x31.5mm–D0279139-(Lottic ake (Nottingham, UK) Board – White

210

200

180

170

160

150

140

130

120

110

100

90

-8

- 02

-09


20

- 6

30

- 0

1,E, w 1001010011(1618)



RECOGNISED STANDARDS

NFO EAN 13 5000158101814 100% 0 microns : 0.0 mm

the bar code to conform Operating Manual or Ommercial standard.



e, Connaught Road, k, Hull, HU7 3AP, England. 1482 828100

esolution paper Canon colour s job should be referred to for colour separation only.

0=3; R=0; - LC - 17/04/12 09:39:15

APPROVAL

on behalf of Reckitt Benckiser

UNDER NO CIRCUMSTANCES SHOULD THIS ARTWORK BE ALTERED WITHOUT PRIOR PERMISSION FROM TRIDENT. Tel. Alan Smith: +44 (0)1482 710304

NOT APPROVED FOR COLOUR