



systemair

Systemair Havalandırma Endüstri San. ve Tic. A.Ş.
Adres : Demirciler Mah. MOSB (Makine Organize Sanayi Bölgesi)
5. Cadde No : 5, 41455 Kocaeli
Telefon :+90 (262) 460 49 81, Fax :+90 (262) 460 49 95
www.systemair.com.tr

Proje Name: EKOL SADA HASTANESİ KLİMA SANTRALİ ORDER 2
Order Number: 25351587
Unit Number: HKS_12

Supply Fan Air Volume: 8.550 [m³/h]
Return Fan Air Volume: 8.350 [m³/h]
Supply Fan Motor Power: 7.5 [kW] (1x1)
Return Fan Motor Power: 4 [kW] (1x1)
Rotor Heat Recovery Unit Motor Power: -
Electrical Heater (Total) Power/ Stage Number: 6 [kW]/ 1 STAGE

Unit Total Power: 12.5 [kW]

Edit Date : 28.08.2026



SAFETY REGULATIONS



GENERAL SAFETY REGULATIONS



TEHLİKE !

During plant operation certain items are under dangerous voltage!
Non-observance of safety instructions can result in death, serious injuries or material damage.

Only specialist personnel may carry out transport, installation and commissioning work.

The applicable valid standards as well as the national and / or company-specific accident prevention regulations are to be observed.

The following safety instructions are to be observed:

The erection, commissioning, troubleshooting as well as repair of the plant may only be carried out by qualified personnel that is familiar with the corresponding operating instructions.

Mounting of the devices has to be effected in accordance with the valid standards, state and local regulations.
Proper grounding and conductor dimensioning as well as proper short-circuit proofing have to be ensured.
These measures serve to ensure the safety of the plant and of the operating personnel.

Before carrying out safety checks, maintenance work and repair measures ensure that all the power supplies are switched off, are secured against being switched on unintentionally and are marked correspondingly.

Only test devices that are in a technically perfect condition and are suitable for the respective measurement may be used to carry out measurements!

The instructions specified in the respective operating instructions are to be followed strictly!
It is mandatory that hazard, warning and safety instructions be observed!

All doors and covers are to be kept closed during the plant operation.
If cooling devices are installed in the plant, ensure that these systems operate trouble-free.
These include the regular cleaning of the filters, in as far as they exist.

TECHNICAL IMPLEMENTATION REGULATIONS



WIRING REGULATIONS

WIRING COLORS

Main Current AC (L1)	Black (BK)	Control Circuit 230V AC (Phase)	Black (BK)
Main Current AC (L2)	Black (BK)	Control Circuit 230V AC (Neutral)	Blue (BU)
Main Current AC (L3)	Black (BK)		
Main Current DC (L1)	Black (BK)	Control Circuit 24V AC (Phase)	Brown (BN)
Main Current DC (L2)	Black (BK)	Control Circuit 24V AC (Neutral)	White (WH)
Main Current DC (L3)	Black (BK)		
Neutral Conductor (N)	Blue (BU)	Control Circuit 24V DC (+)	Brown (BN)
Protective Wire (PE)	Green - Yellow (GNYE)	Control Circuit 24V DC (-)	White (WH)
		Analog Signal (+)	Green (GN) - Purple (PR)
		Analog Signal (-)	Green (GN) - Purple (PR)
		Digital Input/Output (-)	Green (GN) - Purple (PR)

MINIMUM CROSS-SECTIONS

Main Current AC (L1)	$\geq 2,5 \text{ mm}^2$	Control Circuit 230V AC (Phase)	$\geq 0,75 \text{ mm}^2$
Main Current AC (L2)	$\geq 2,5 \text{ mm}^2$	Control Circuit 230V AC (Neutral)	$\geq 0,75 \text{ mm}^2$
Main Current AC (L3)	$\geq 2,5 \text{ mm}^2$		
Main Current DC (L1)	$\geq 2,5 \text{ mm}^2$	Control Circuit 24V AC (Phase)	$\geq 0,75 \text{ mm}^2$
Main Current DC (L2)	$\geq 2,5 \text{ mm}^2$	Control Circuit 24V AC (Neutral)	$\geq 0,75 \text{ mm}^2$
Main Current DC (L3)	$\geq 2,5 \text{ mm}^2$		
Neutral Conductor (N)	$\geq 2,5 \text{ mm}^2$	Control Circuit 24V DC (+)	$\geq 0,75 \text{ mm}^2$
Protective Wire (PE)	$\geq 2,5 \text{ mm}^2$	Control Circuit 24V DC (-)	$\geq 0,75 \text{ mm}^2$
		Analog Signal (+)	$\geq 0,75 \text{ mm}^2$
		Analog Signal (-)	$\geq 0,75 \text{ mm}^2$

COLOR CODE ACCORDING TO DIN 47100

(Without Color Repetition)




No	Color	Abbreviation
01	White	WH
02	Brown	BN
03	Green	GN
04	Yellow	YE
05	Grey	GY
06	Pink	PK
07	Blue	BU
08	Red	RD
09	Black	BK
10	Purple	VT
11	Gray - Pink	GYPK
12	Red - Blue	RDBU
13	White - Green	WHGN
14	Brown - Green	BNGN
15	White - Yellow	WHYE
16	Yellow - Brown	YEBN
17	White - Gray	WHGY
18	Gray - Brown	GYBN
19	White - Pink	WHPK
20	Pink - Brown	PKBN
21	White - Blue	WHBU
22	Brown - Blue	BNBU
23	White - Red	WHRD
24	Brown - Red	BNRD
25	White - Black	WHBK
26	Brown - Black	BNBK
27	Gray - Green	GYGN


No	Color	Abbreviation
28	Yellow - Gray	YEGY
29	Pink - Green	PKGN
30	Yellow - Pink	YEPK
31	Green - Blue	GNBU
32	Yellow - Blue	YEBU
33	Green - Red	GNRD
34	Yellow - Red	YERD
35	Green - Black	GNBK
36	Yellow - Black	YEBK
37	Gray - Blue	GYBU
38	Pink - Blue	PKBU
39	Gray - Red	GYRD
40	Pink - Red	PKRD
41	Gray - Black	GYBK
42	Pink - Black	PKBK
43	Blue - Black	BUBK
44	Red - Black	RDBK
45	White - Brown - Black	WHBNBK
46	Yellow - Green - Black	YEGNBK
47	Gray - Pink - Black	GYPKBK
48	Red - Blue - Black	RDBUBK
49	White - Green - Black	WHGNBK
50	Brown - Green - Black	BNGNBK
51	White - Yellow - Black	WHYEYBK
52	Yellow - Brown - Black	YEBNBK
53	White - Gray - Black	WHGYBK
54	Gray - Brown - Black	GYBNBK

No	Color	Abbreviation
55	White - Pink - Black	WHPKBK
56	Pink - Brown - Black	PKBNBK
57	White - Blue - Black	WHBUBK
58	Brown - Blue - Black	BNBUBK
59	White - Red - Black	WHRDBK
60	Brown - Red - Black	BNRDBK
61	Black - White	BKWH


Component Mounting

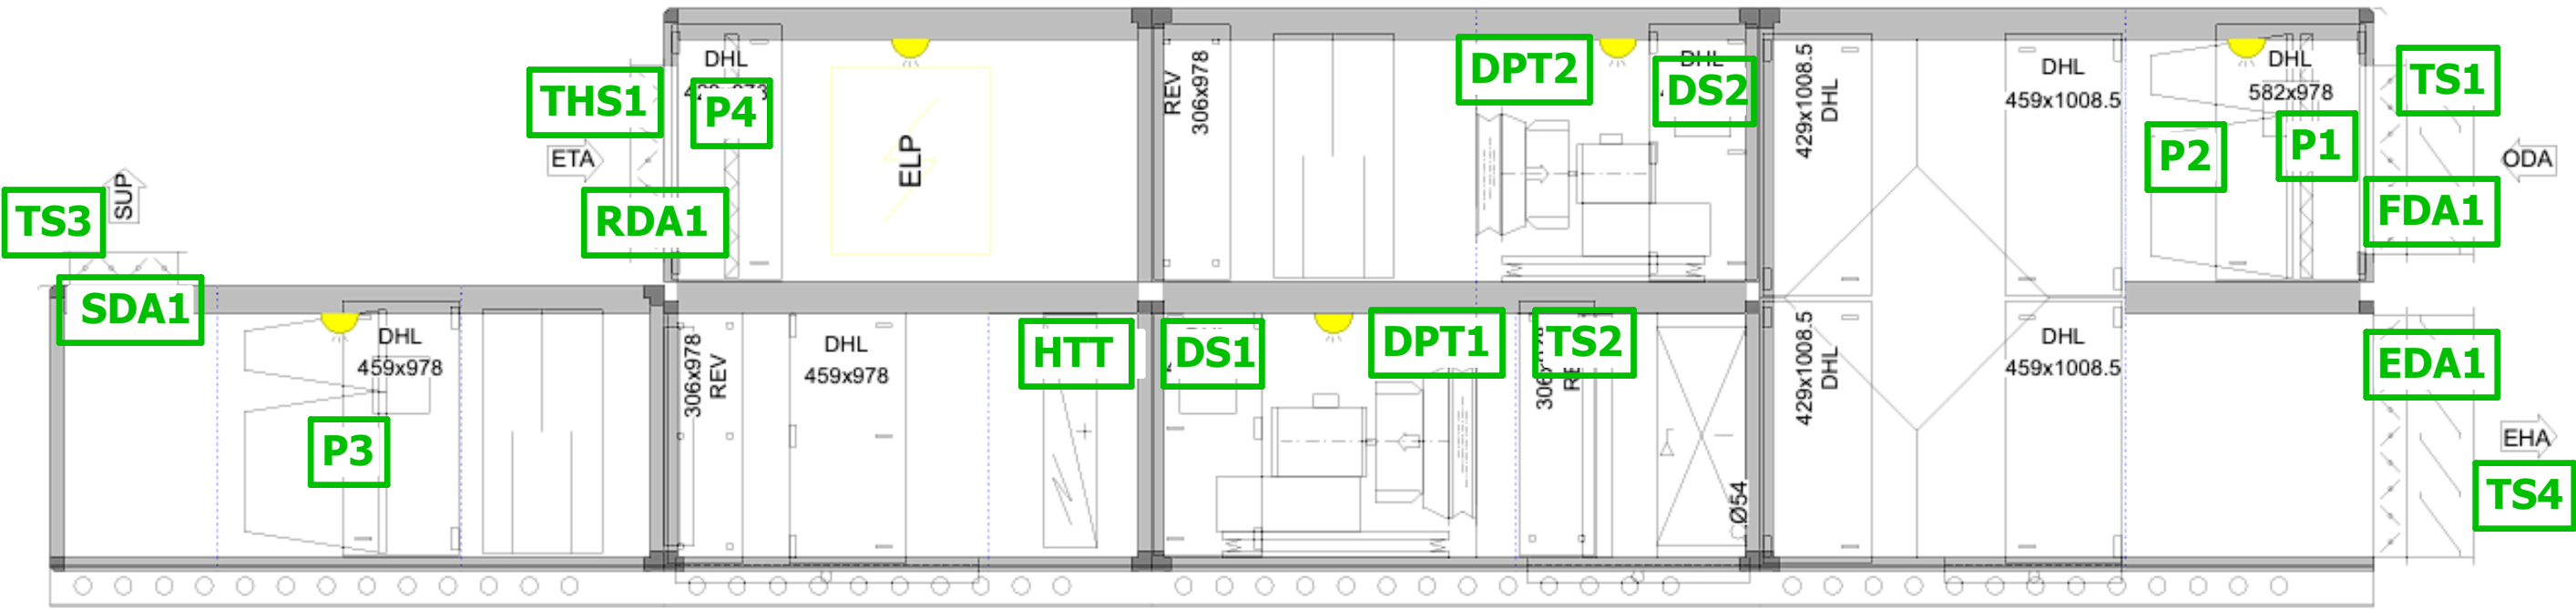



Modbus Sorting





PORT-1 (T14)
19200 8-E-1

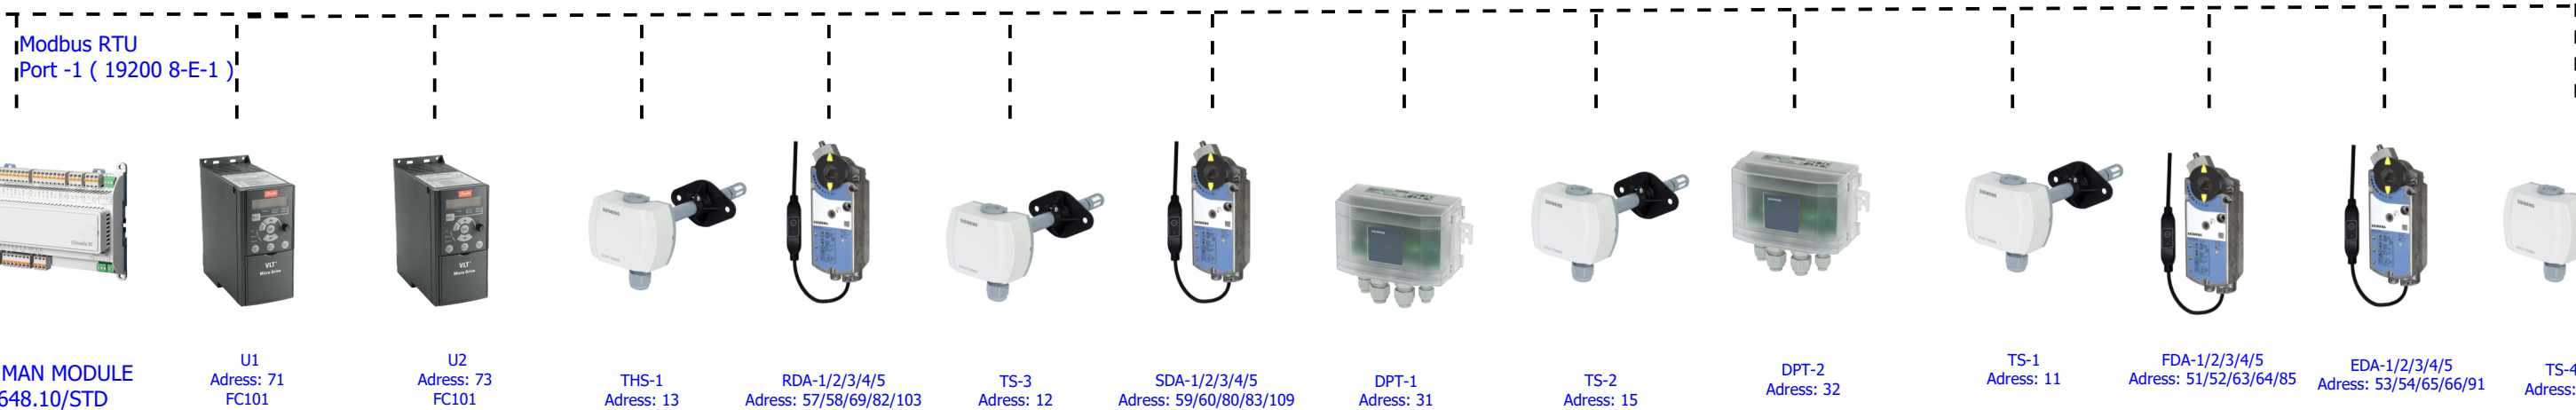


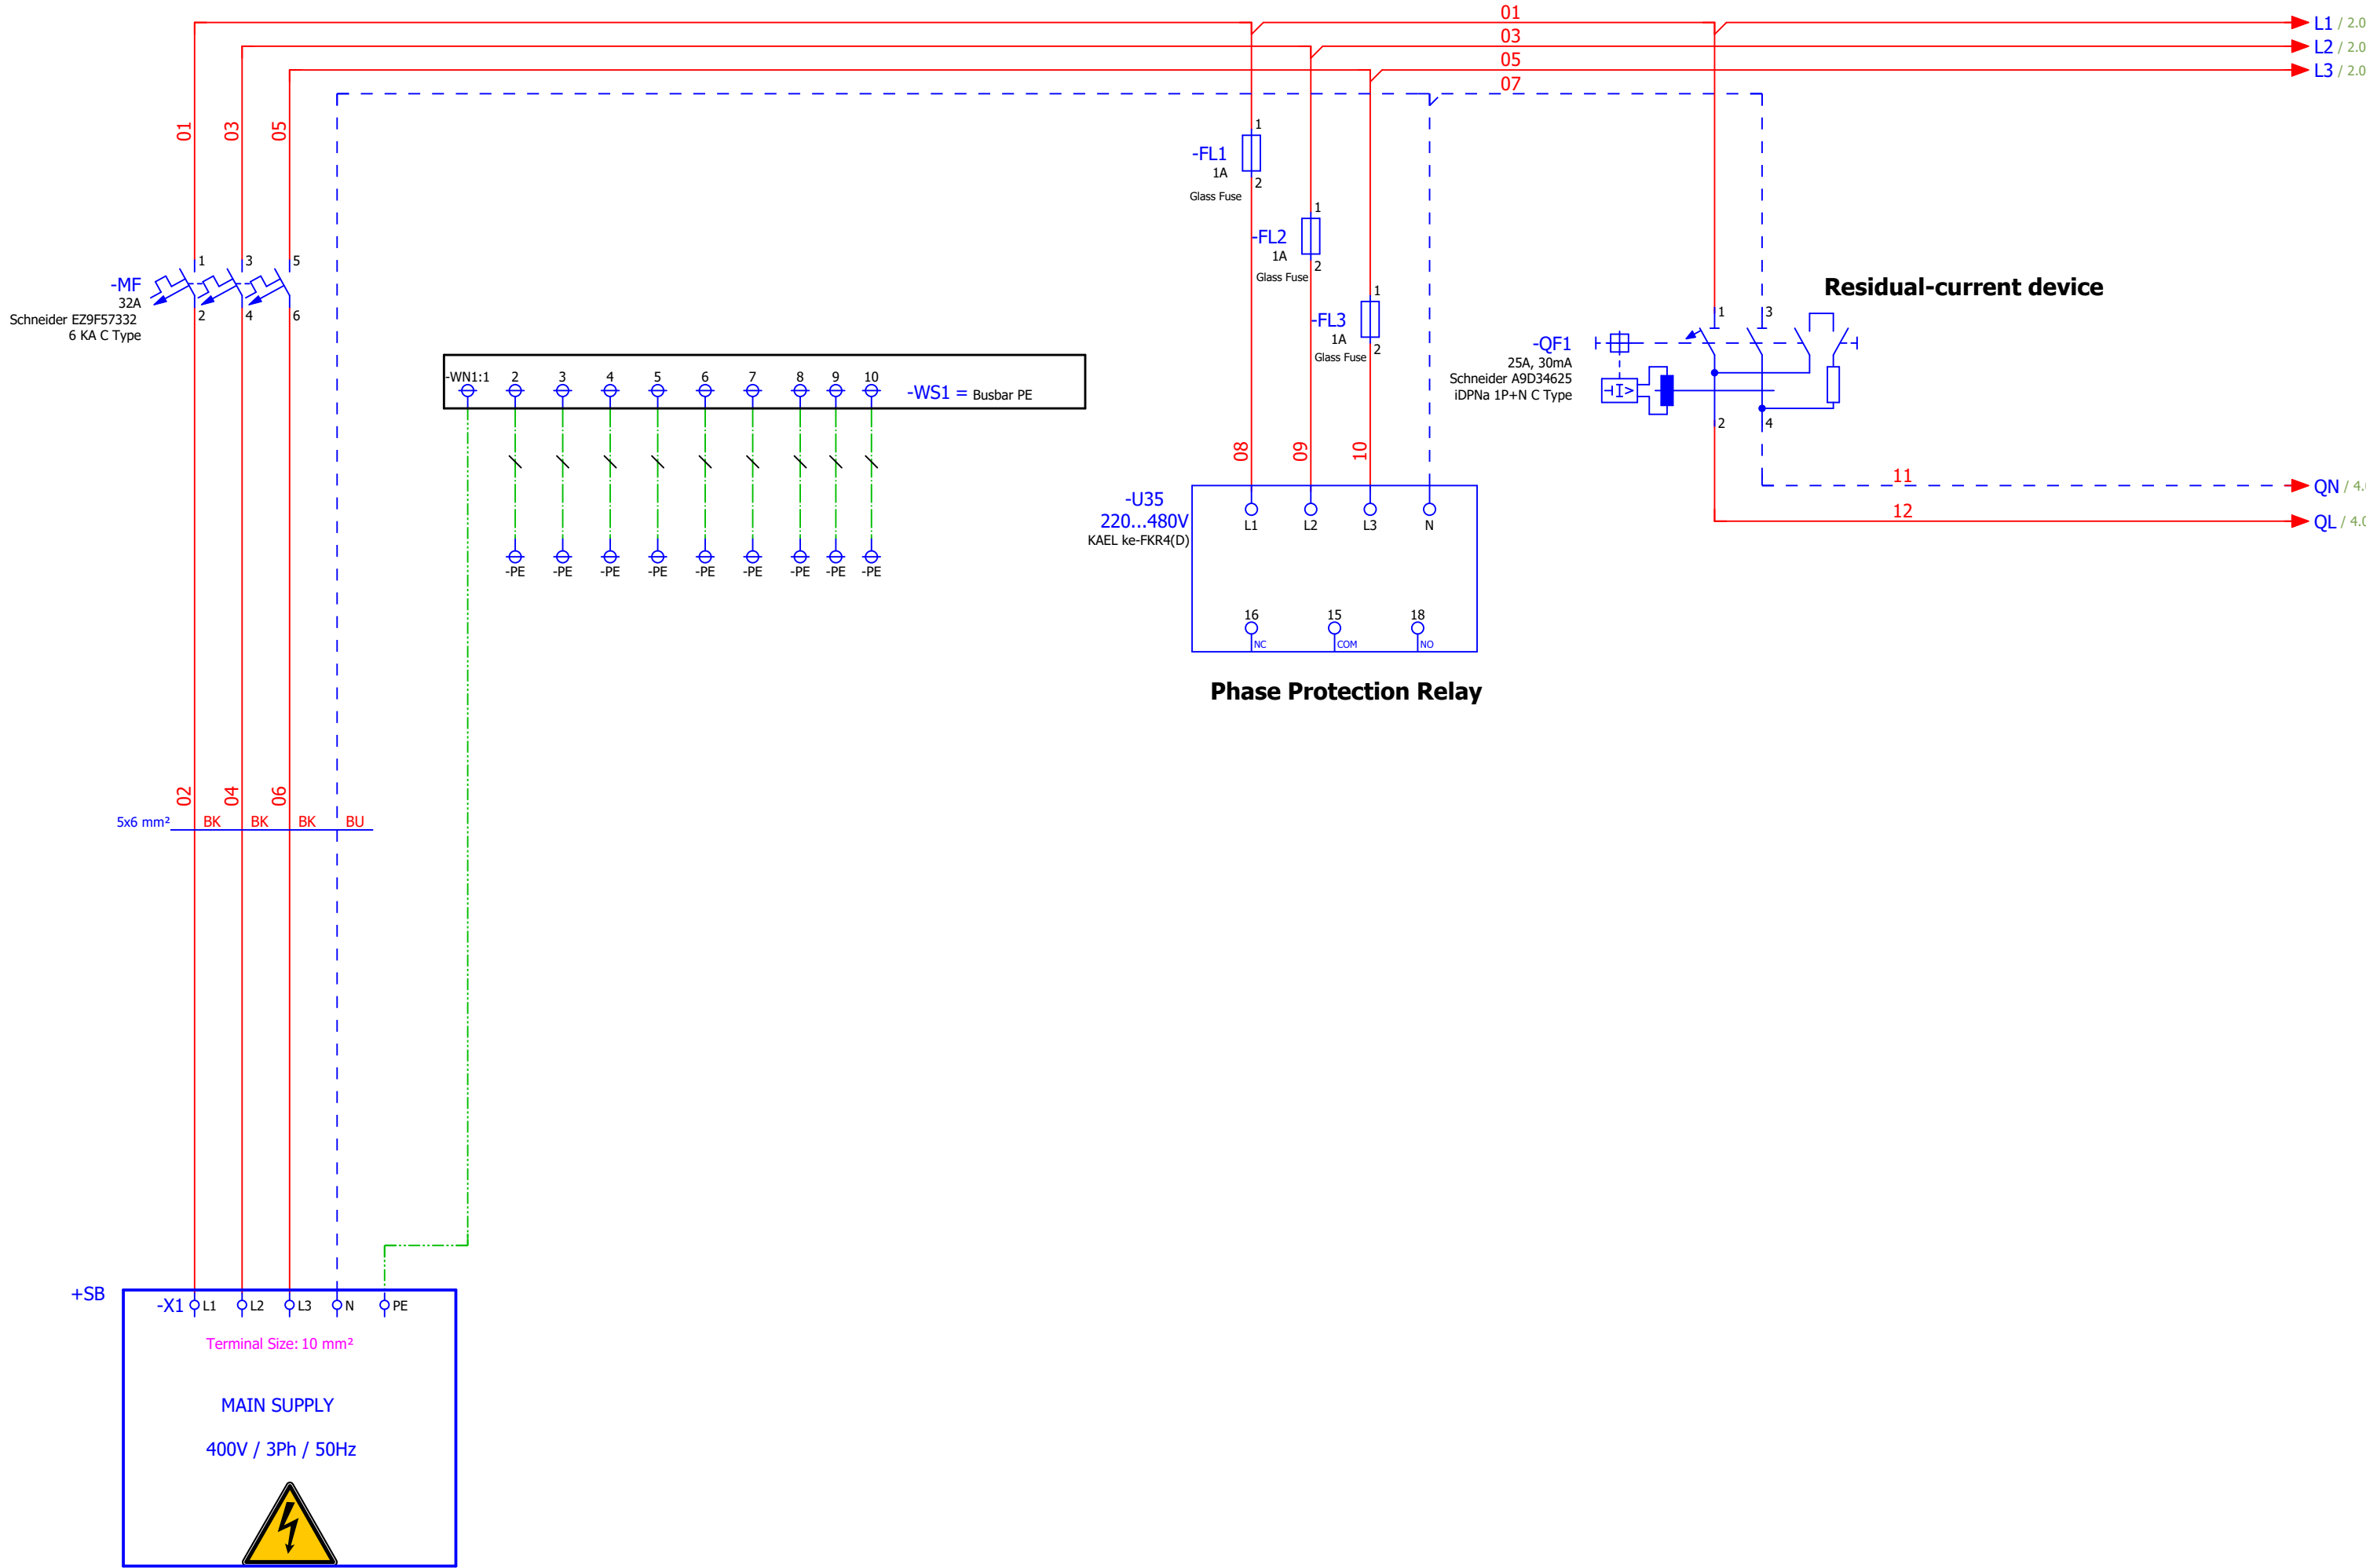


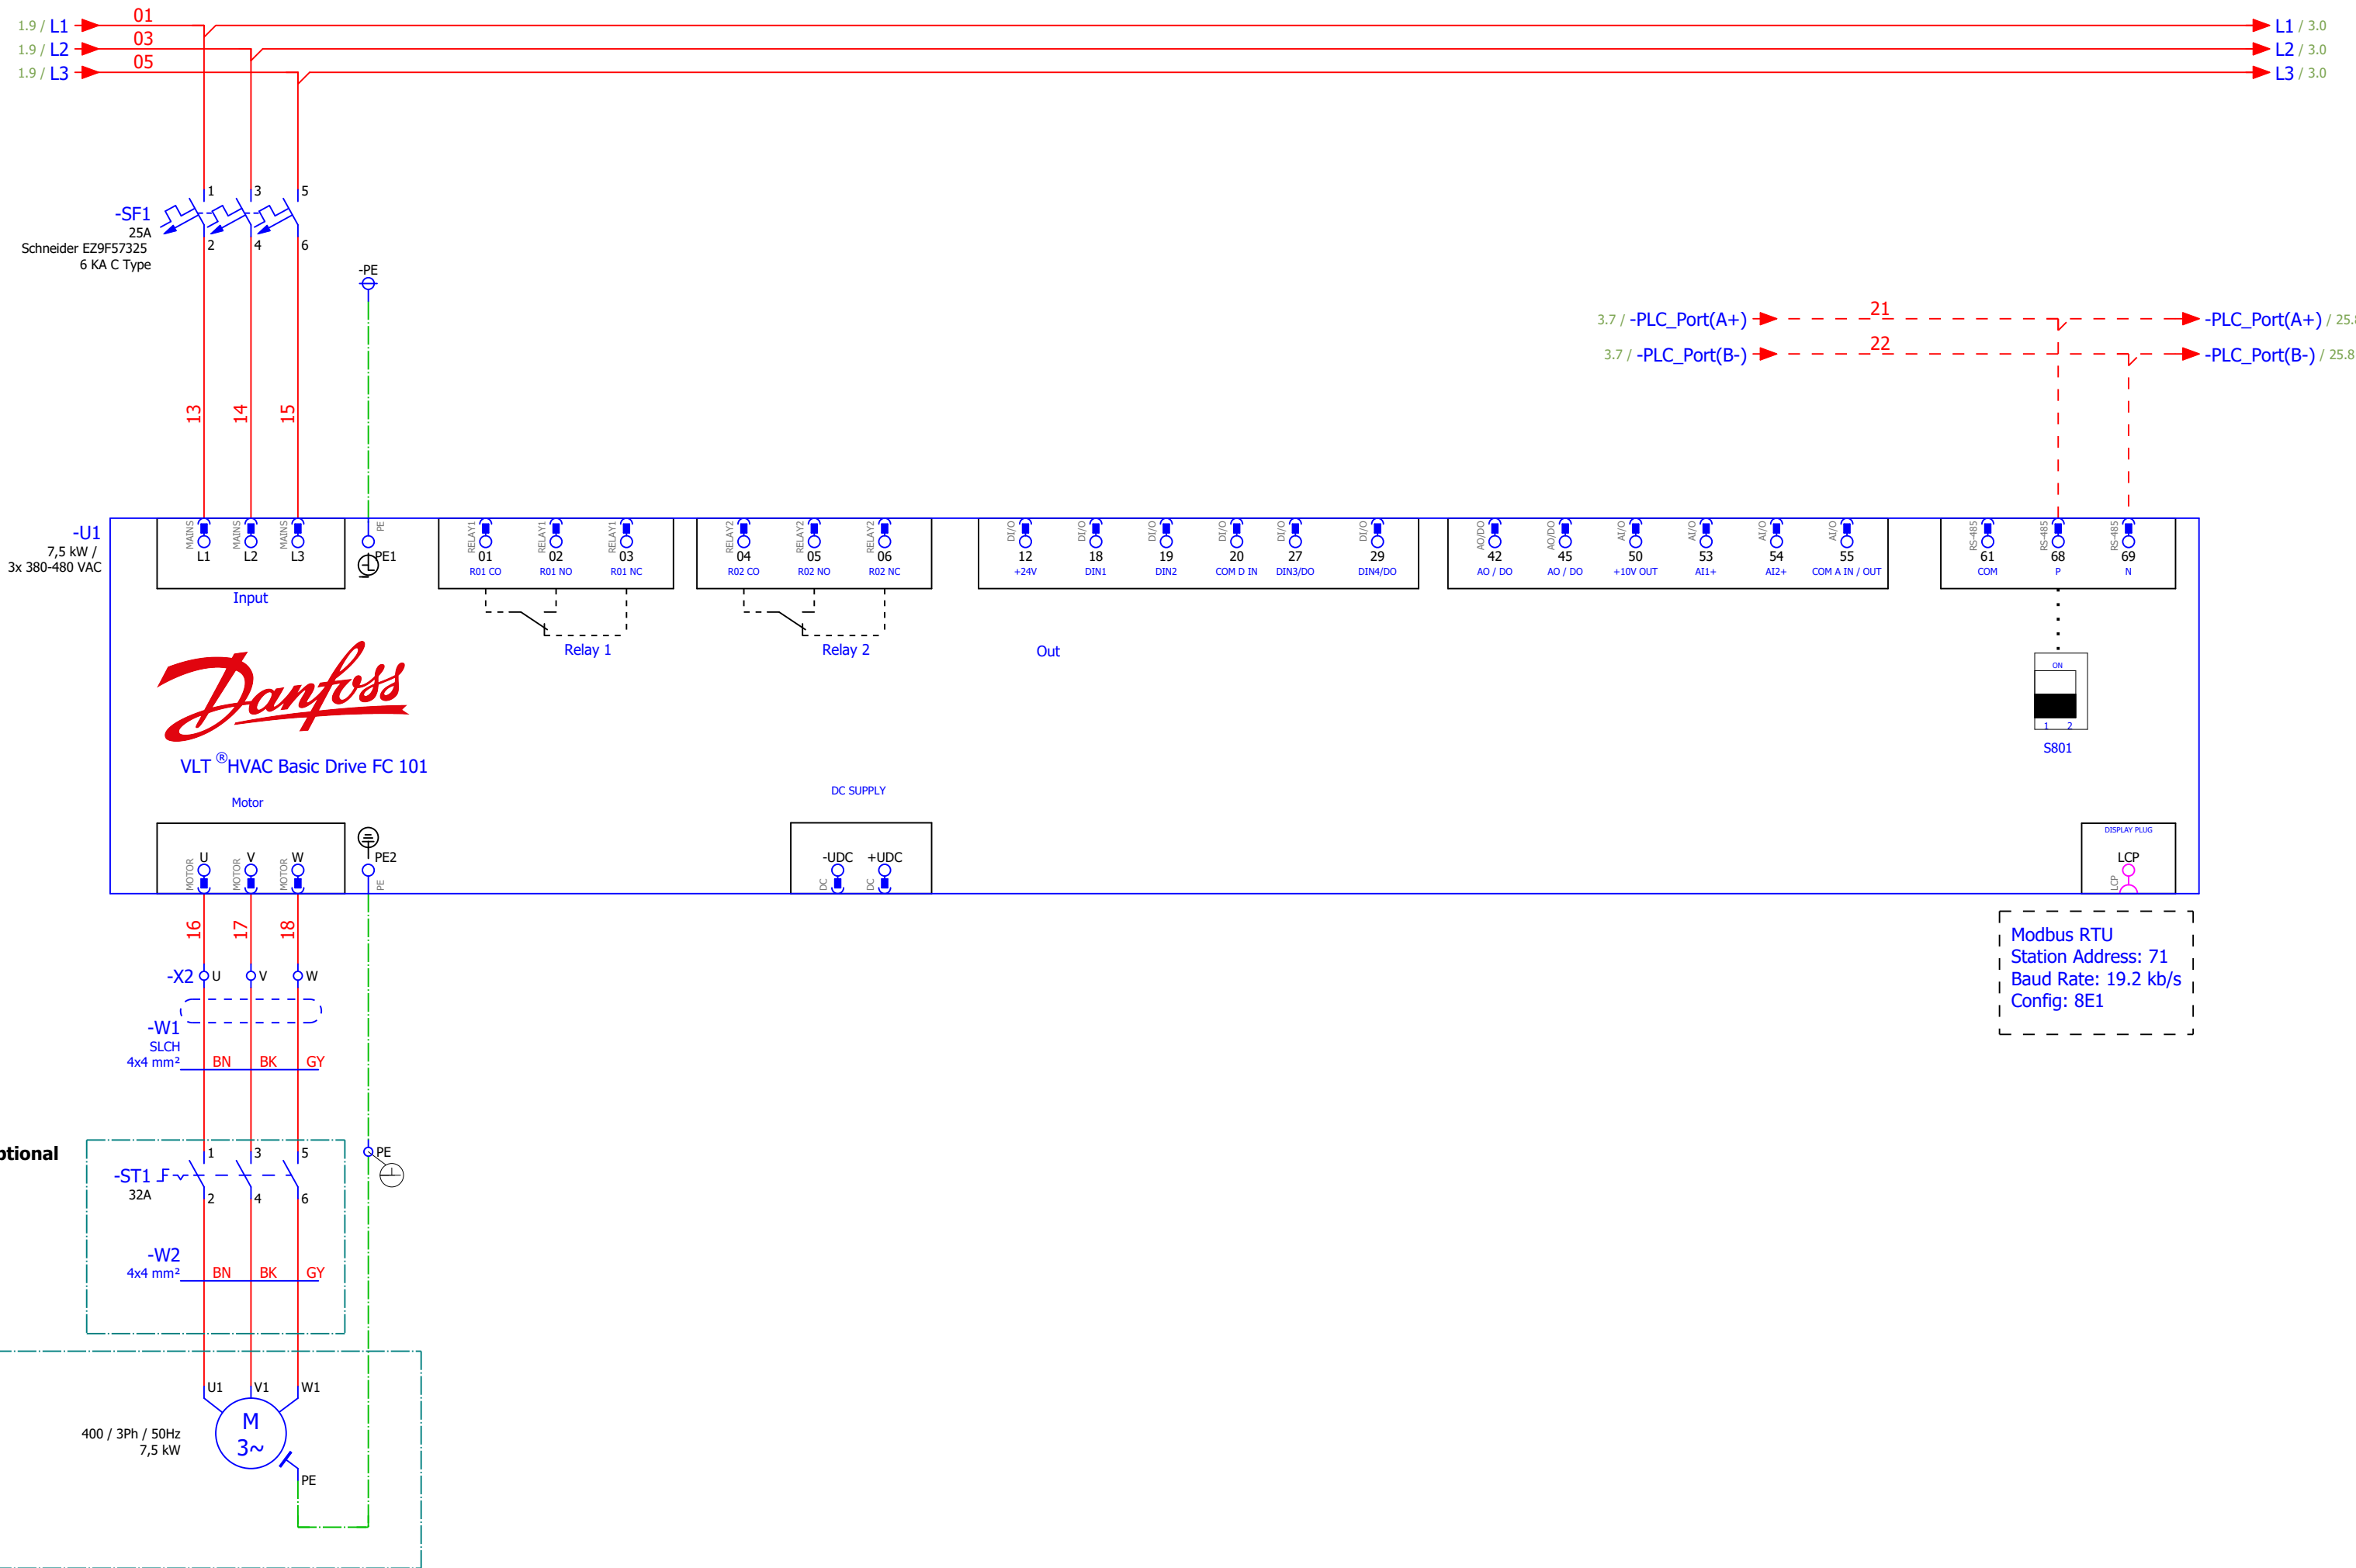


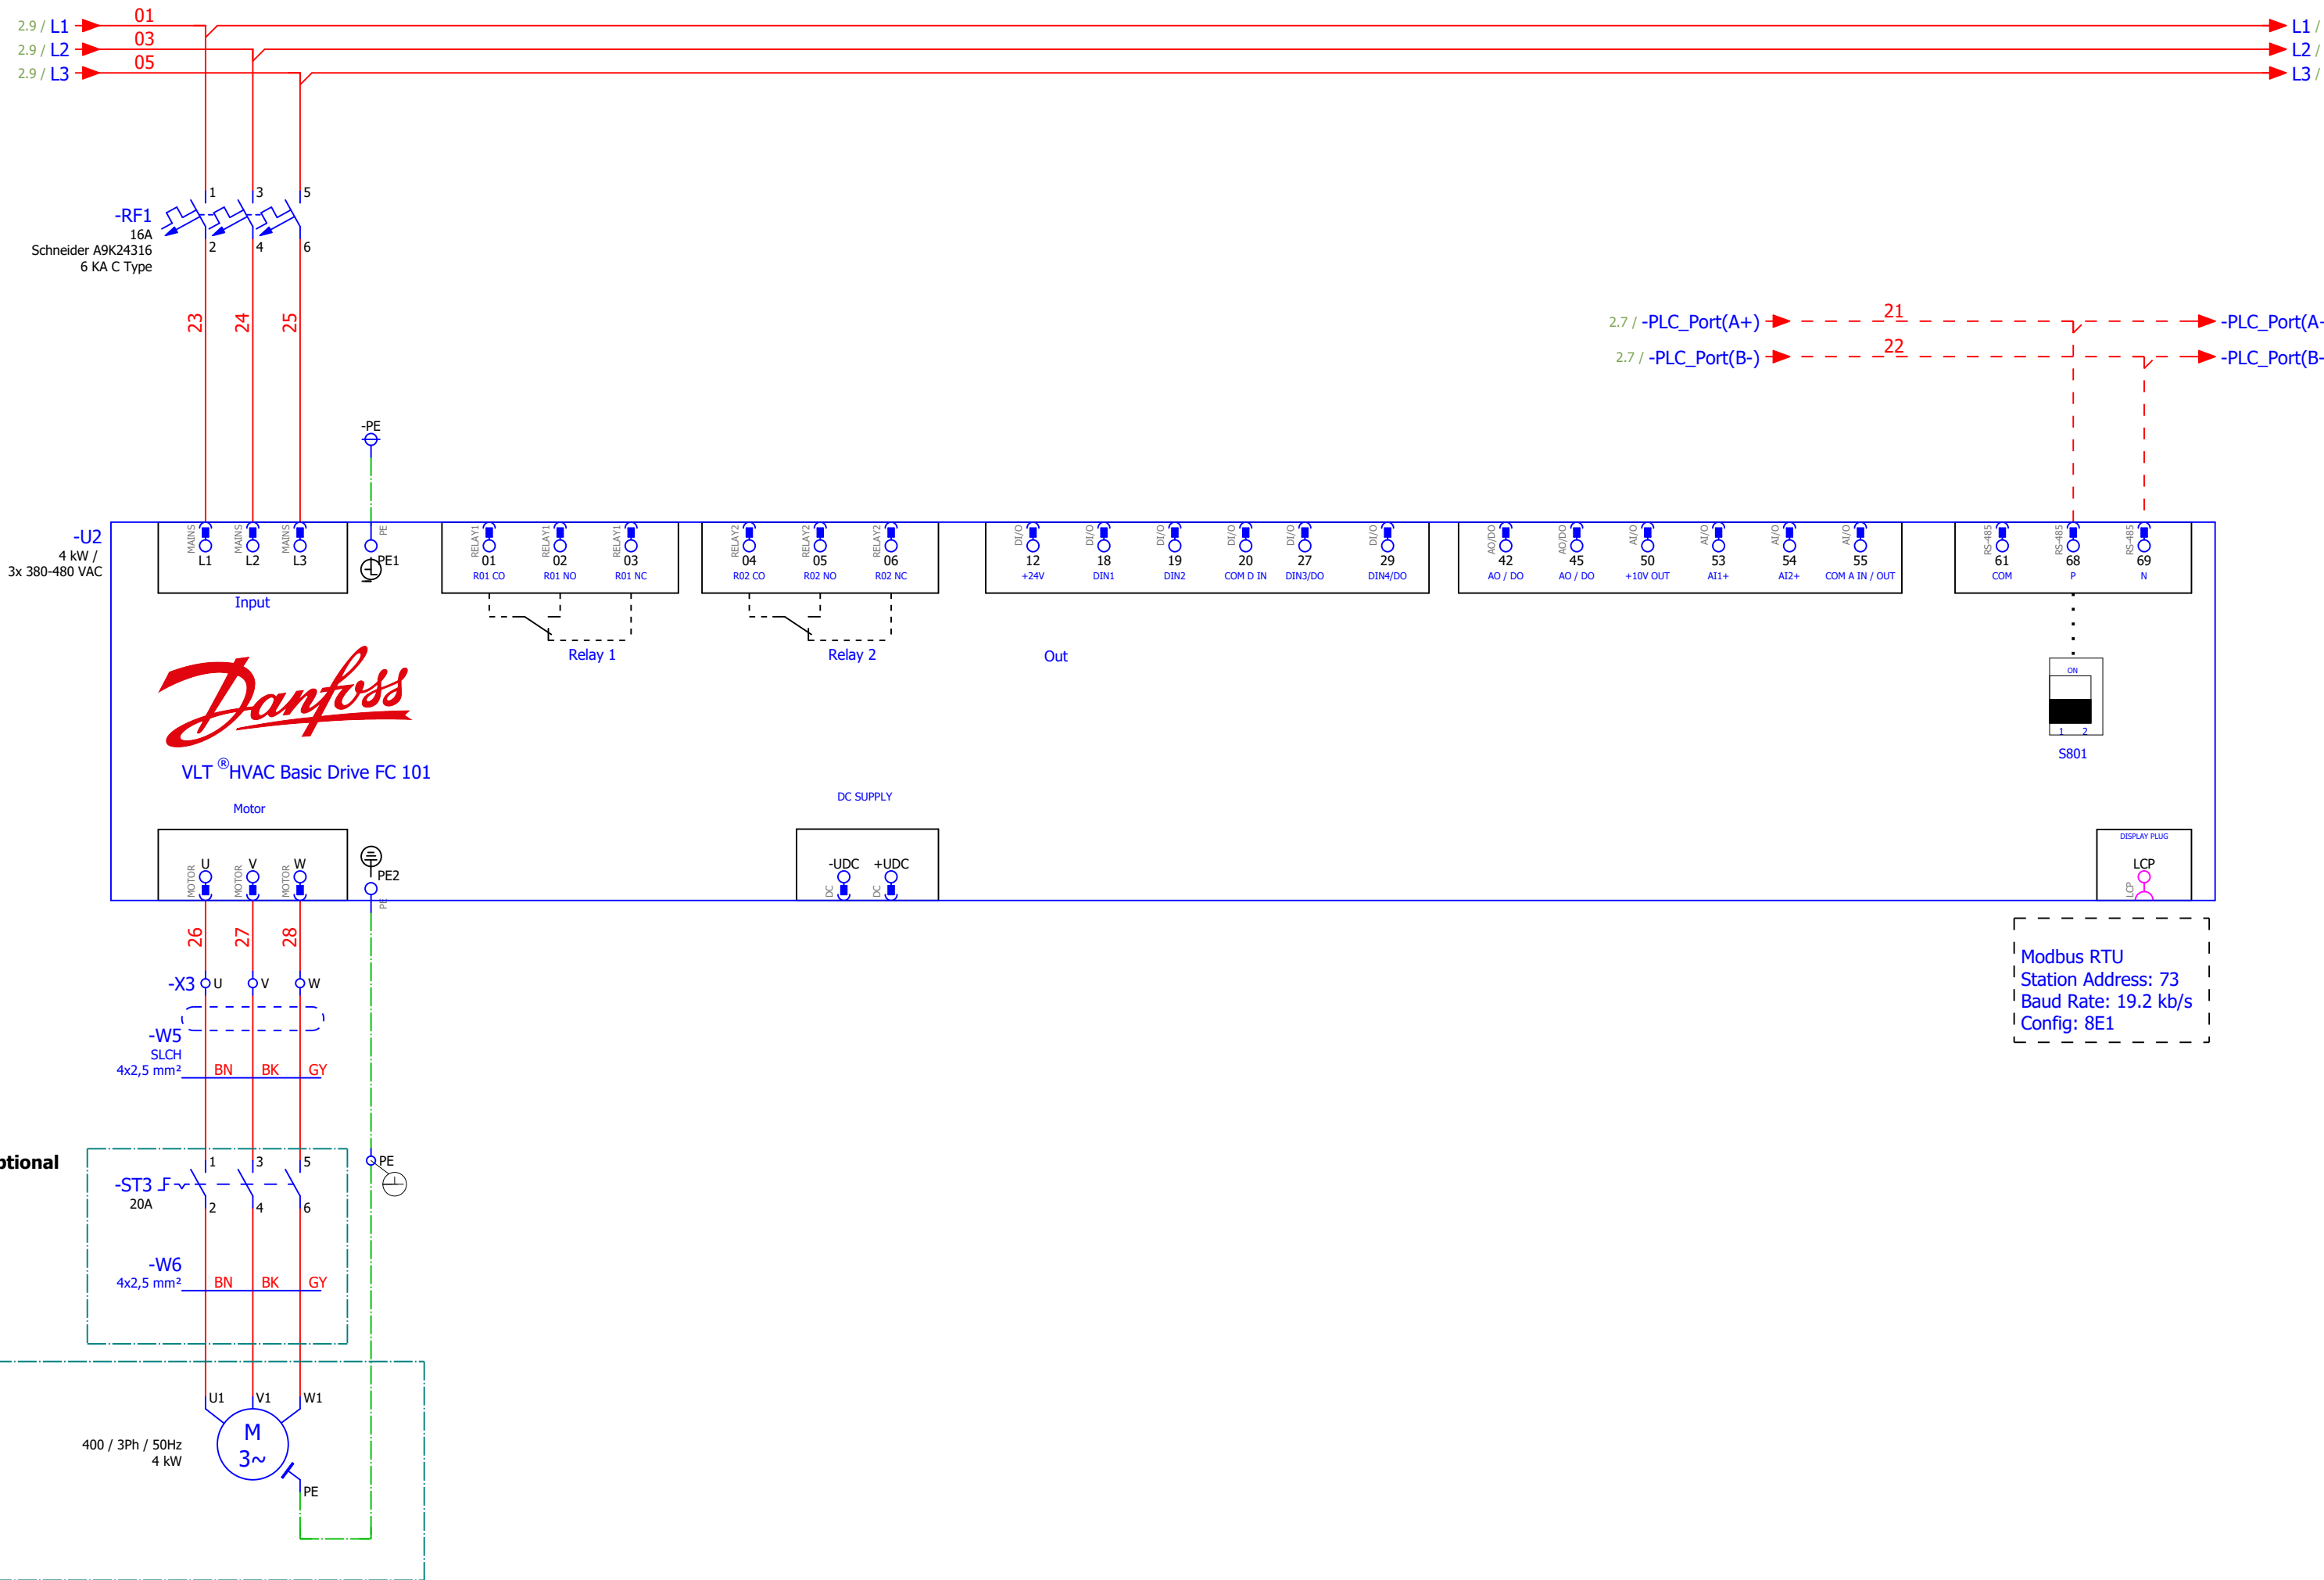



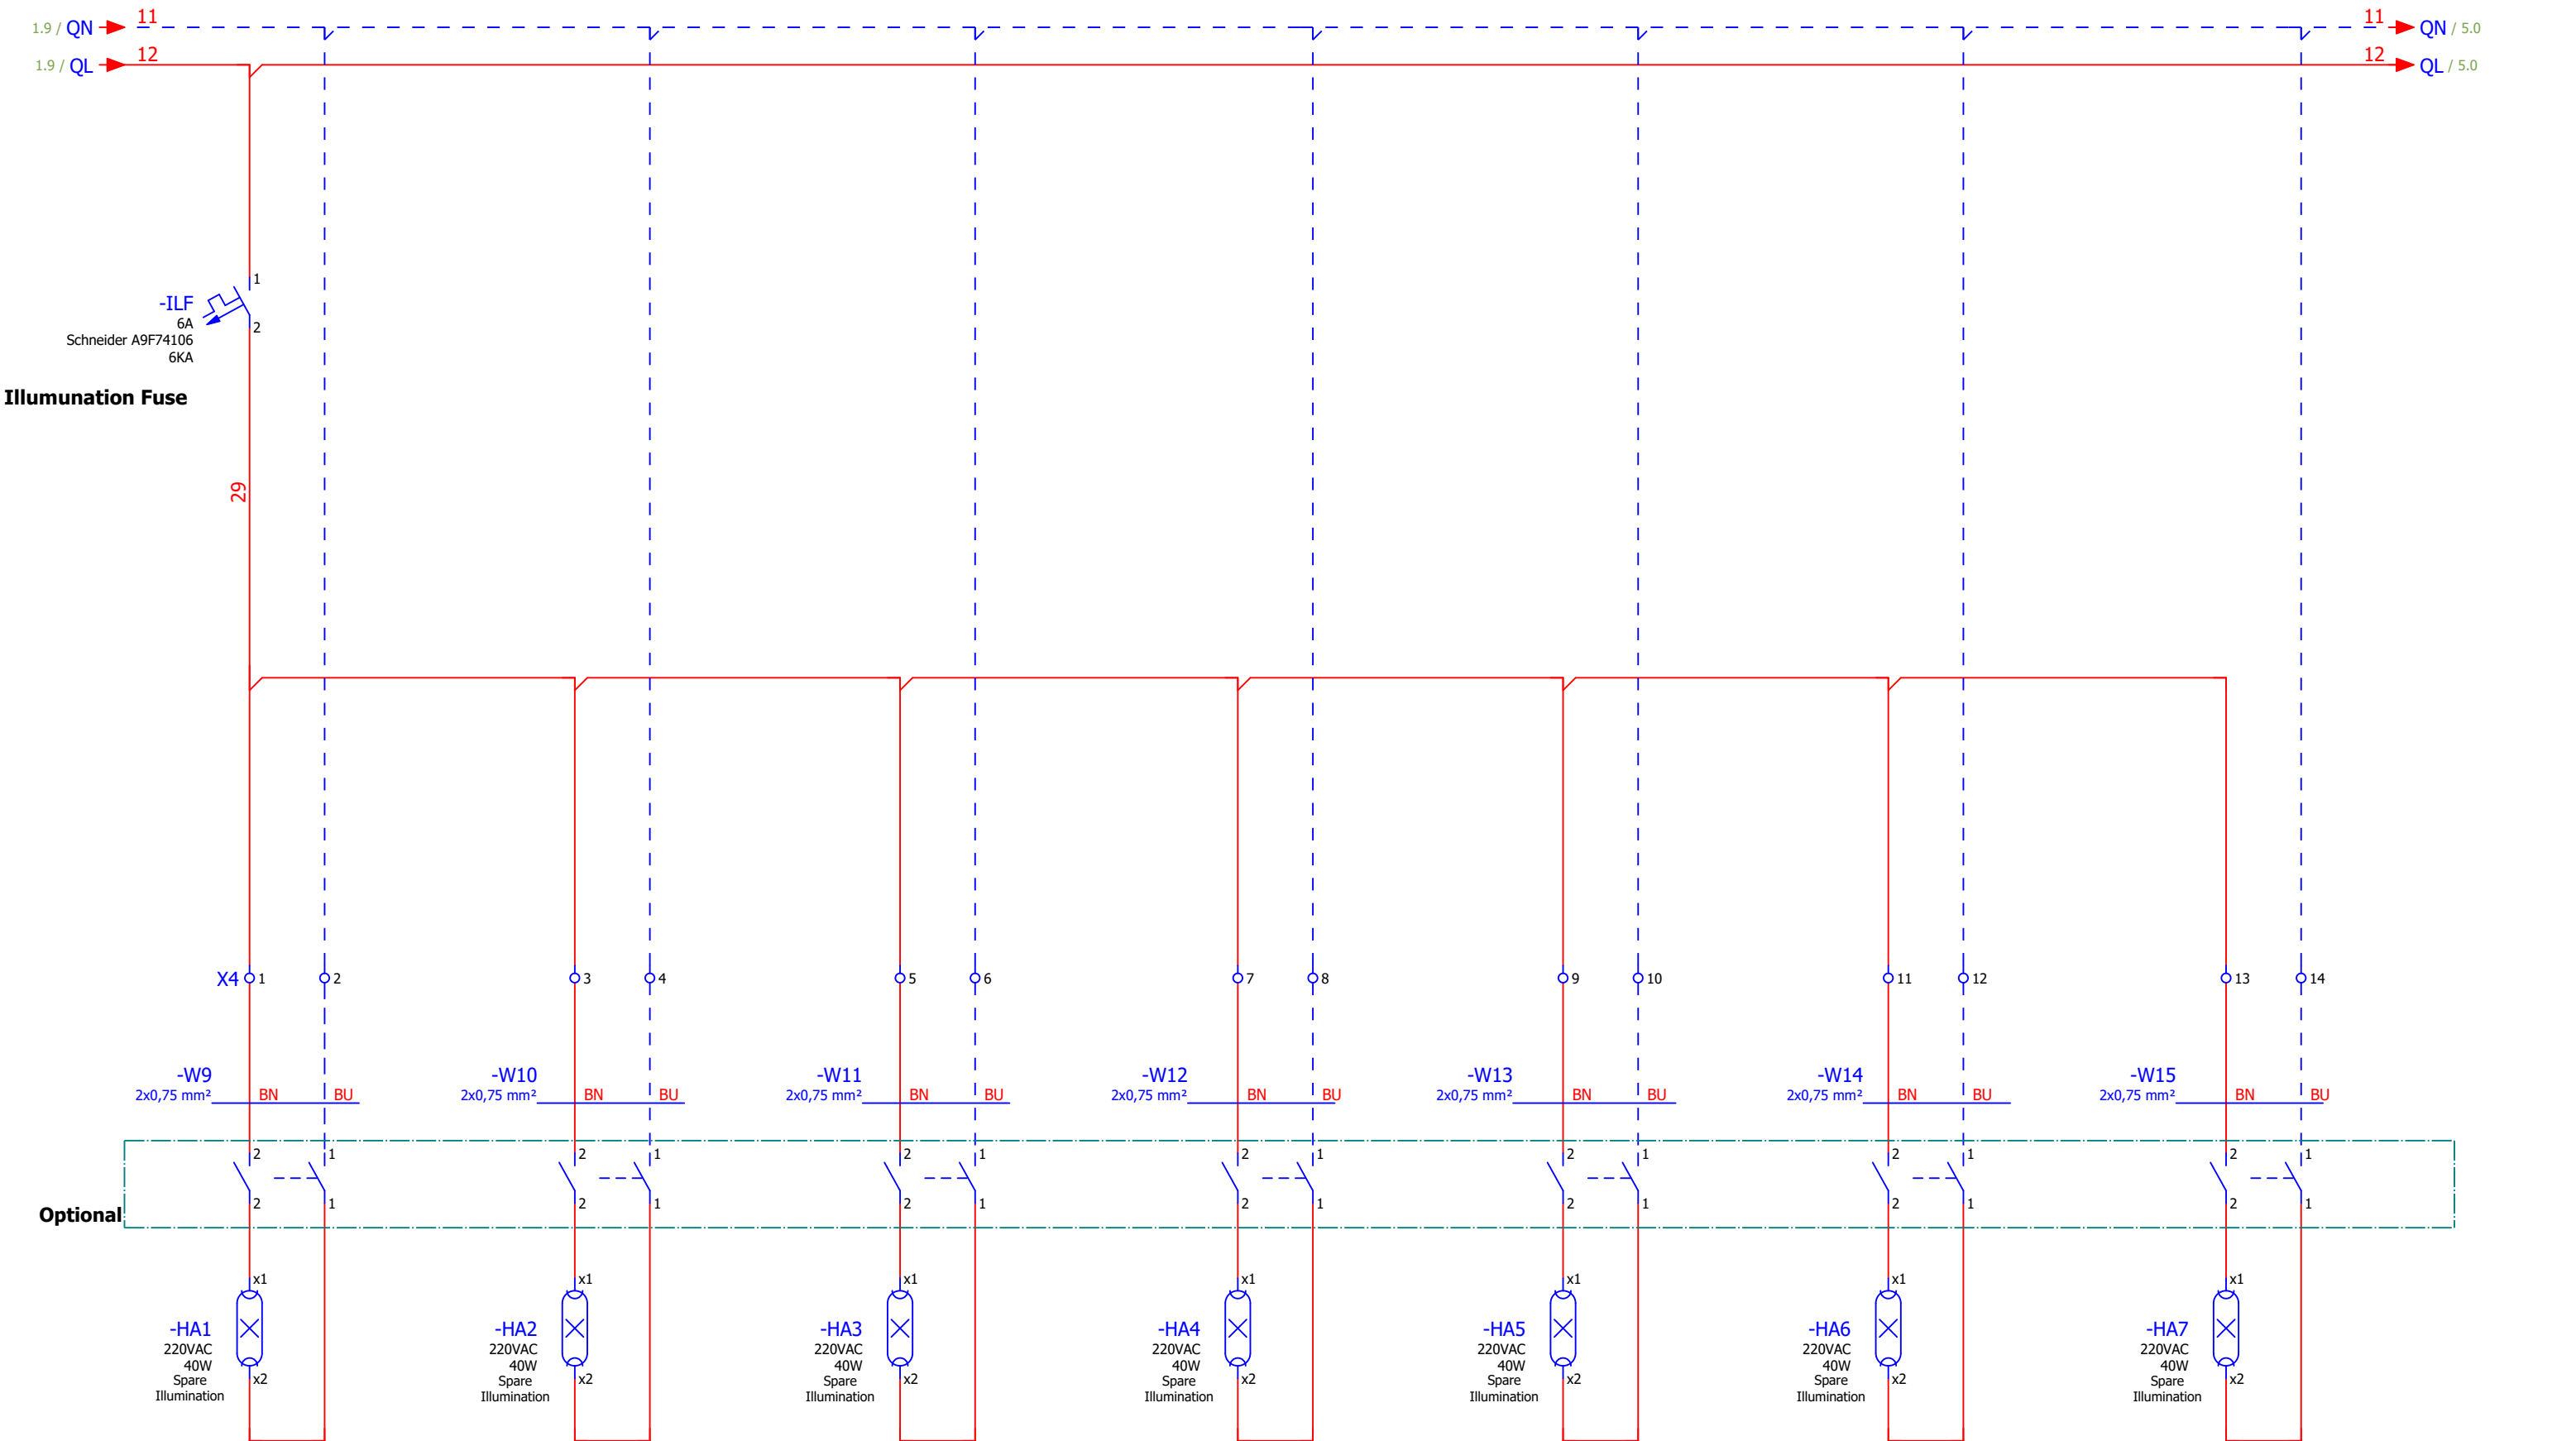


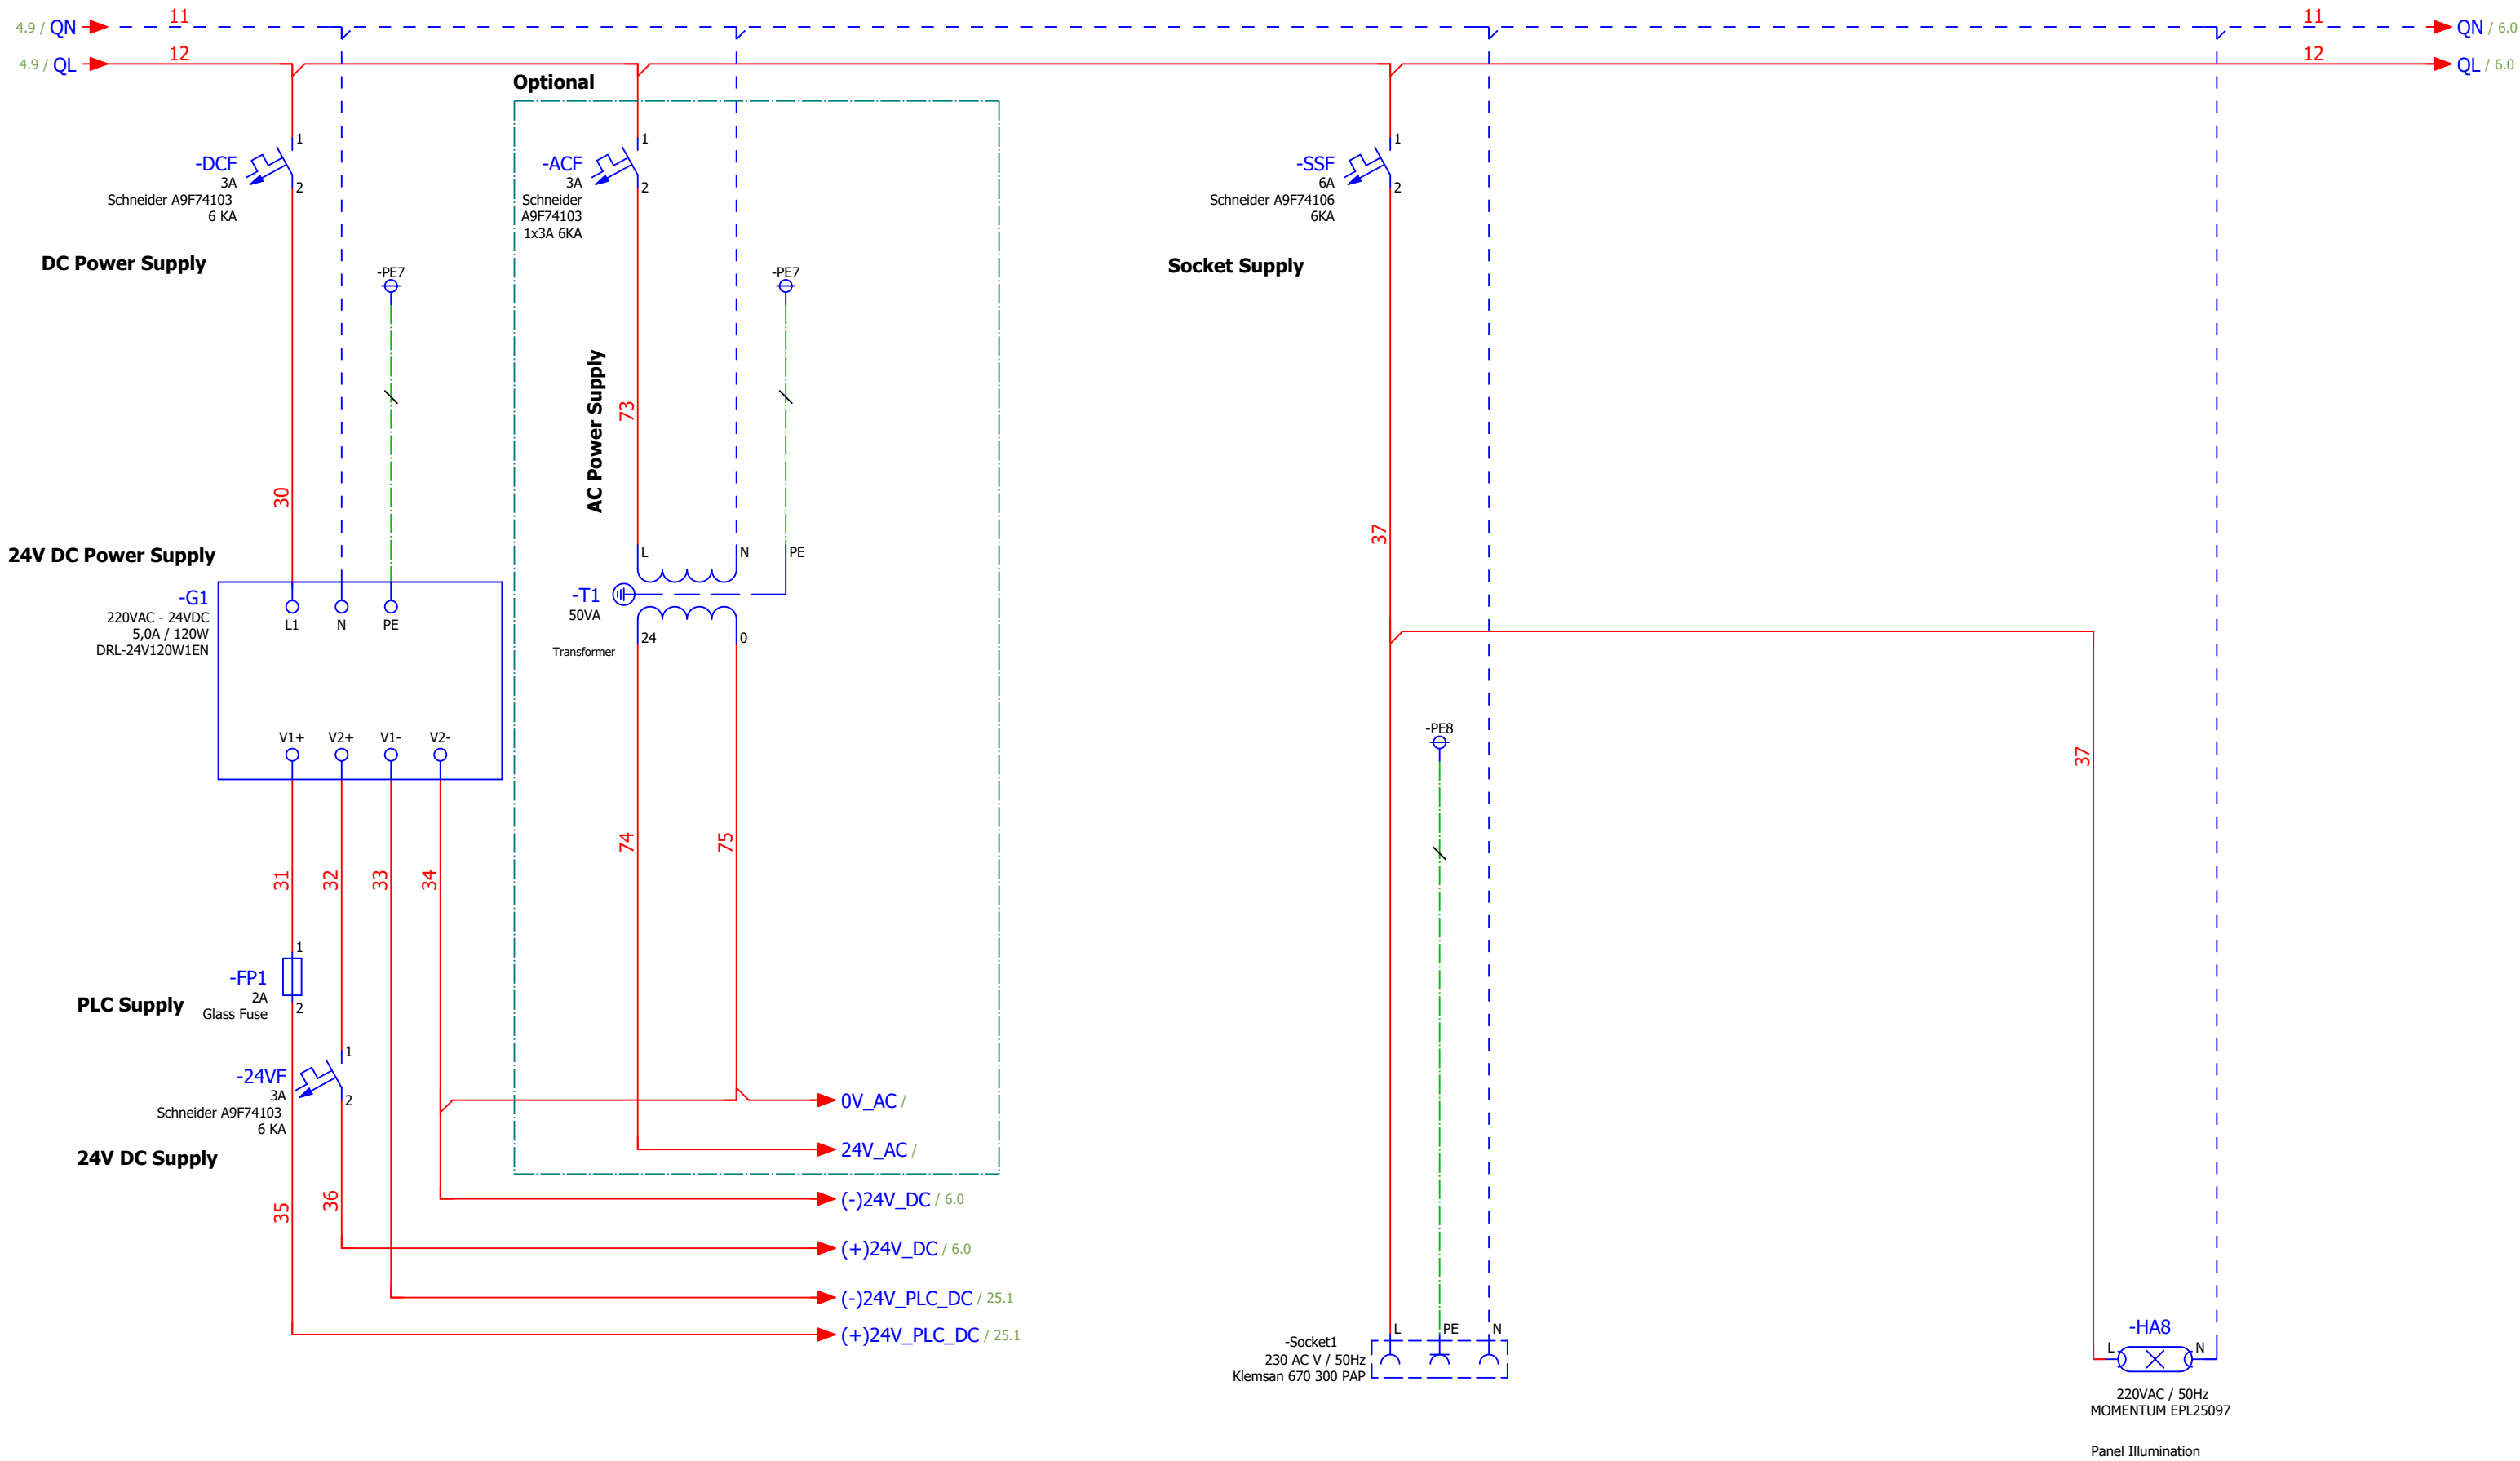

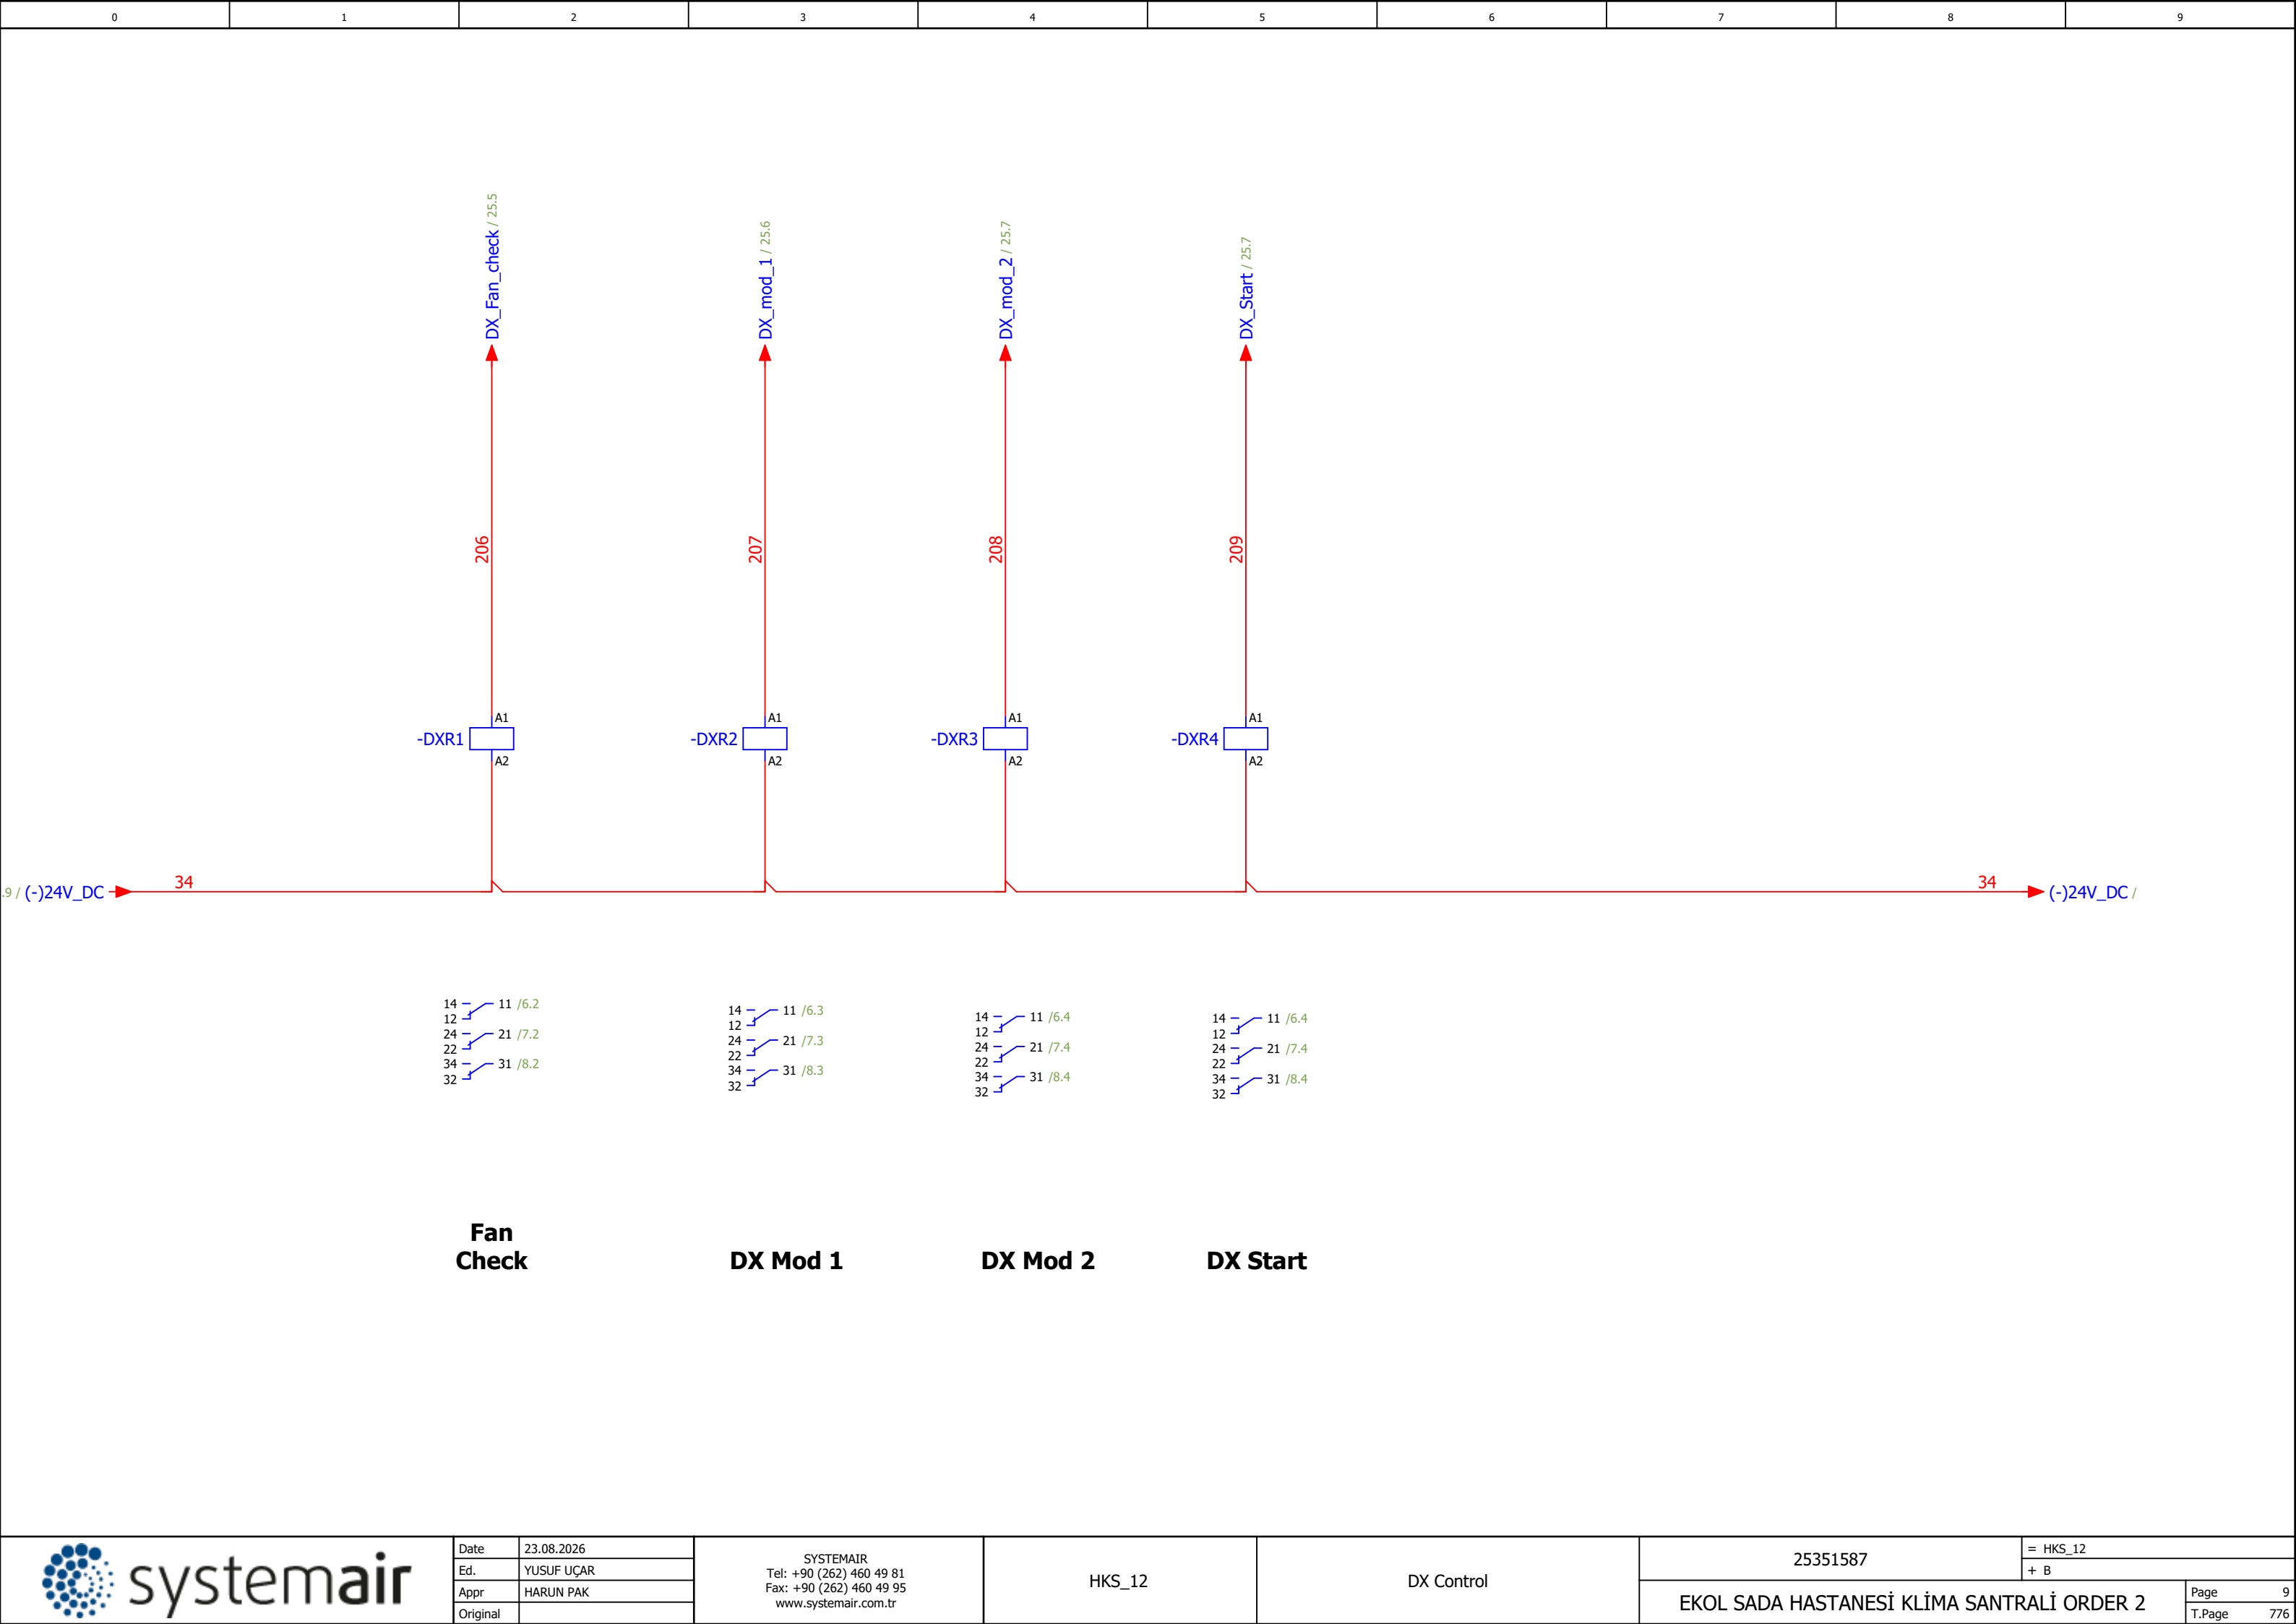




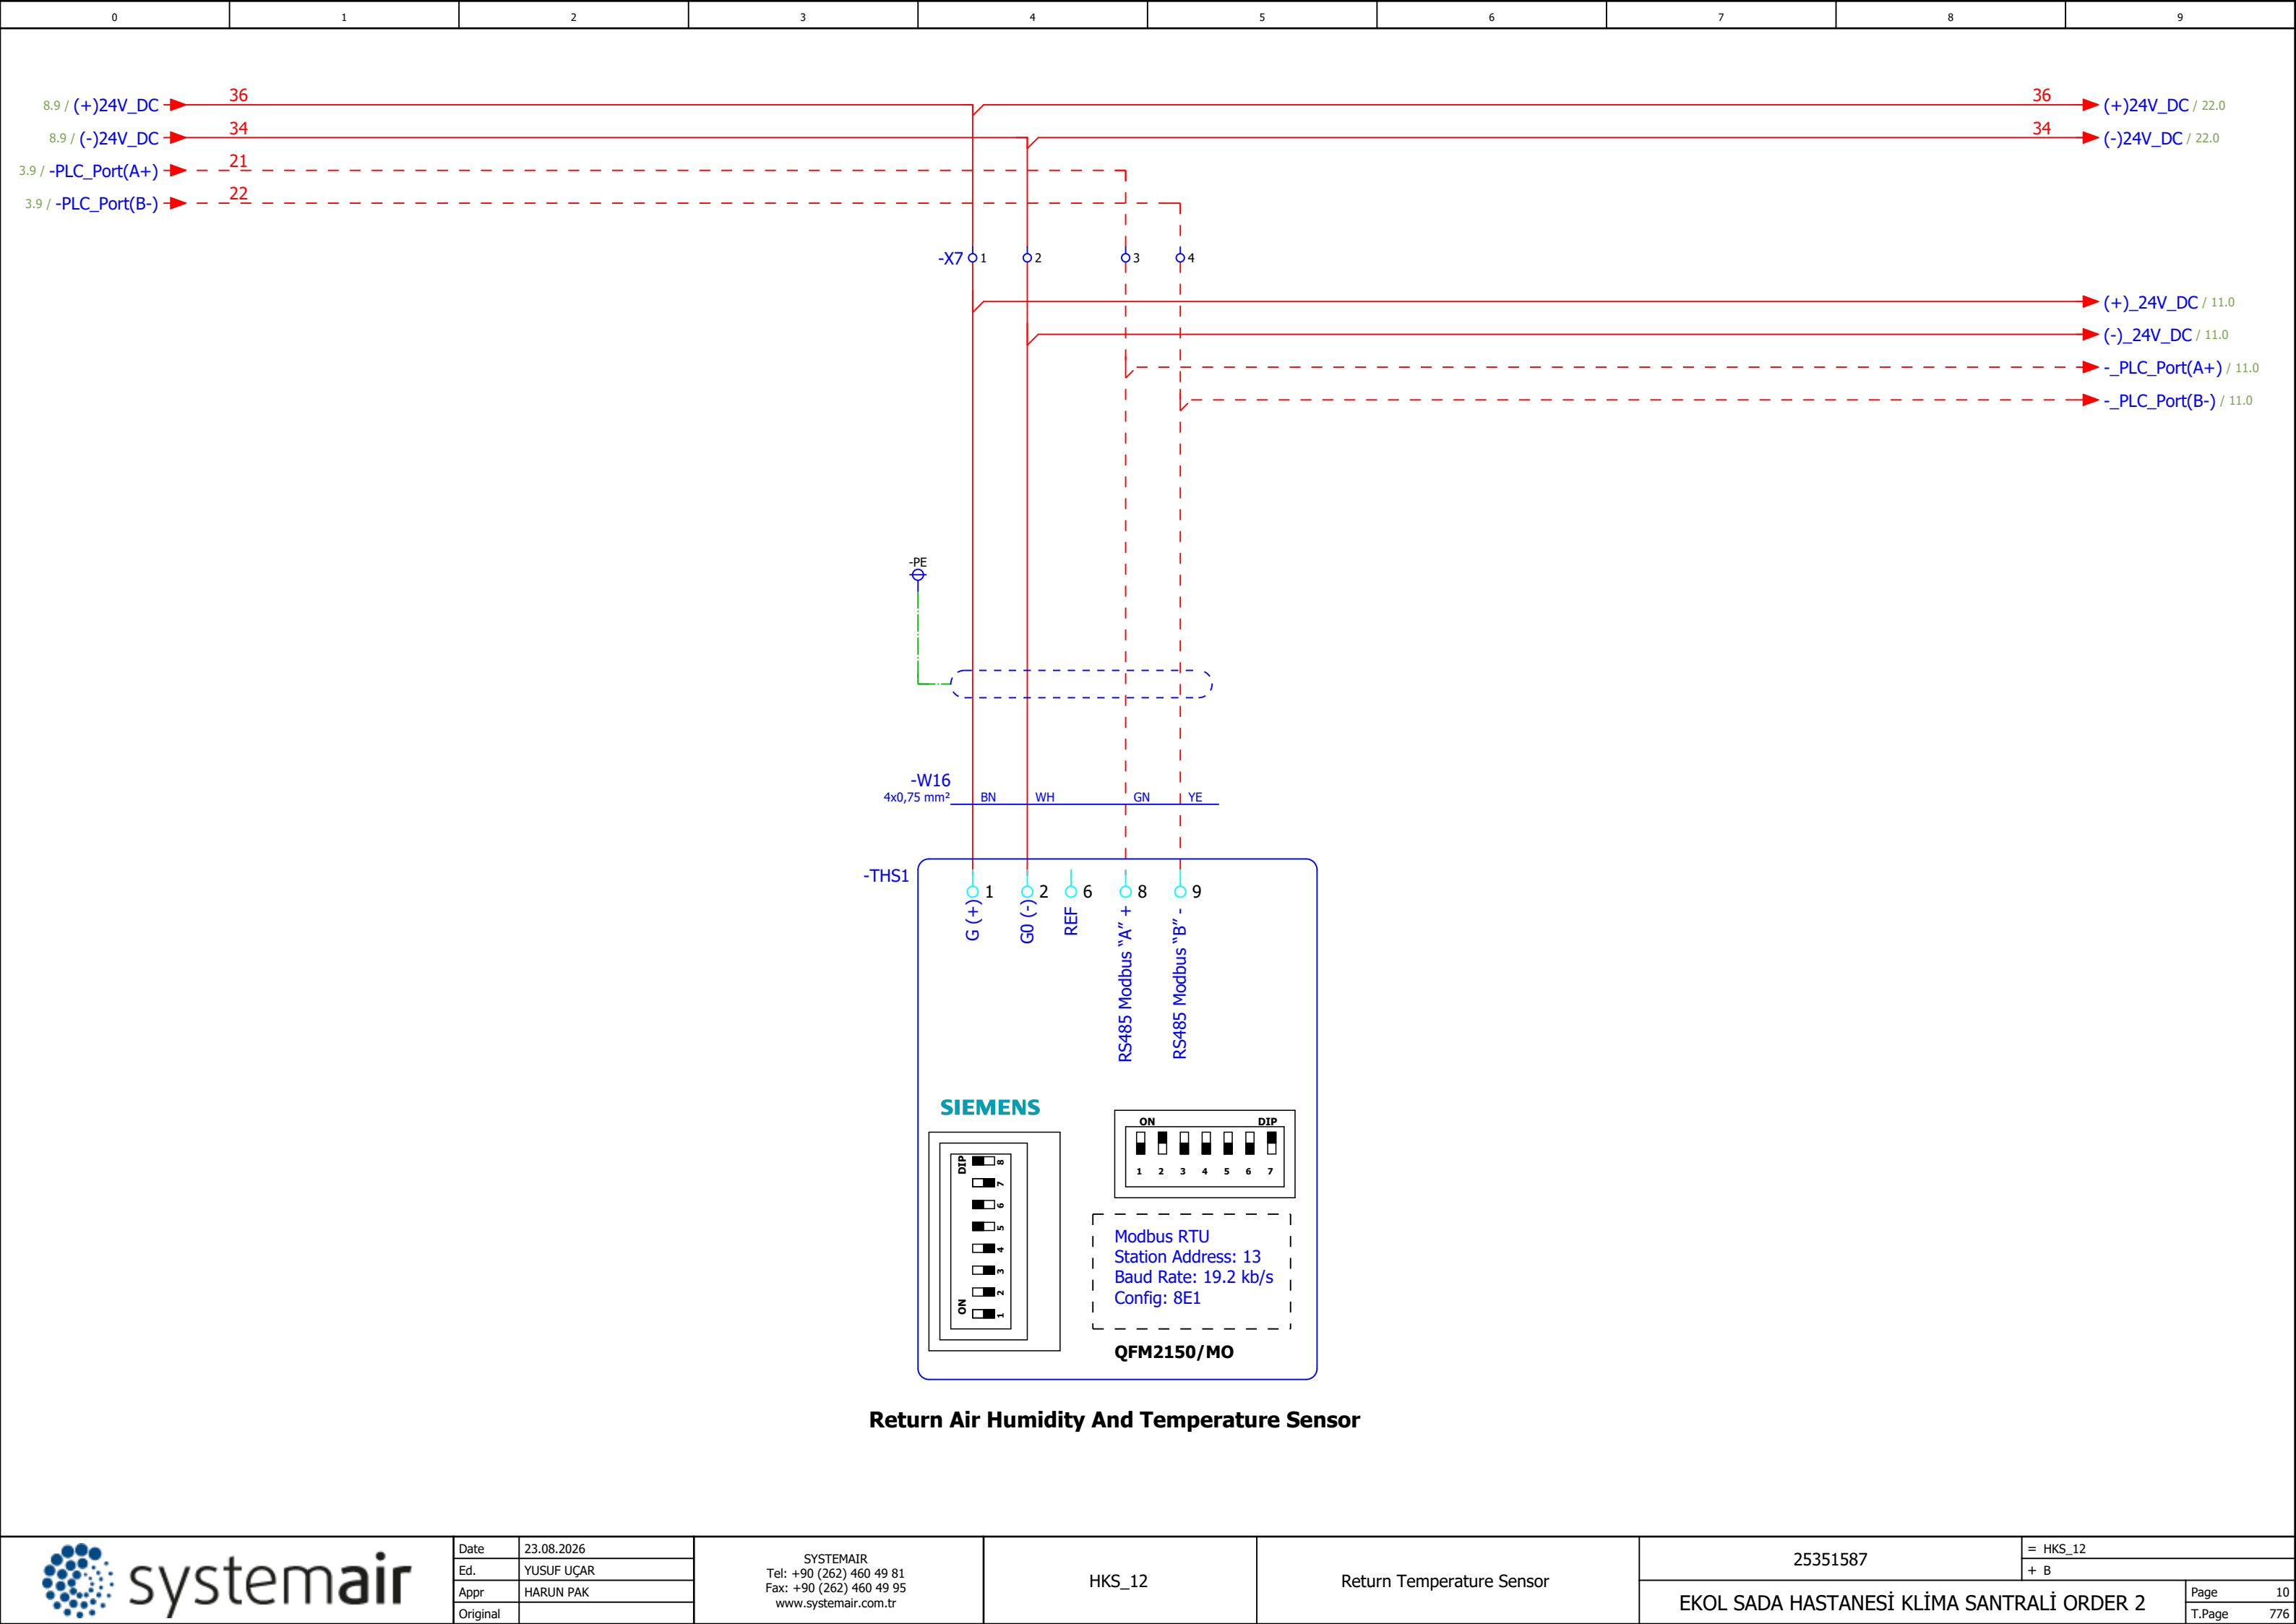


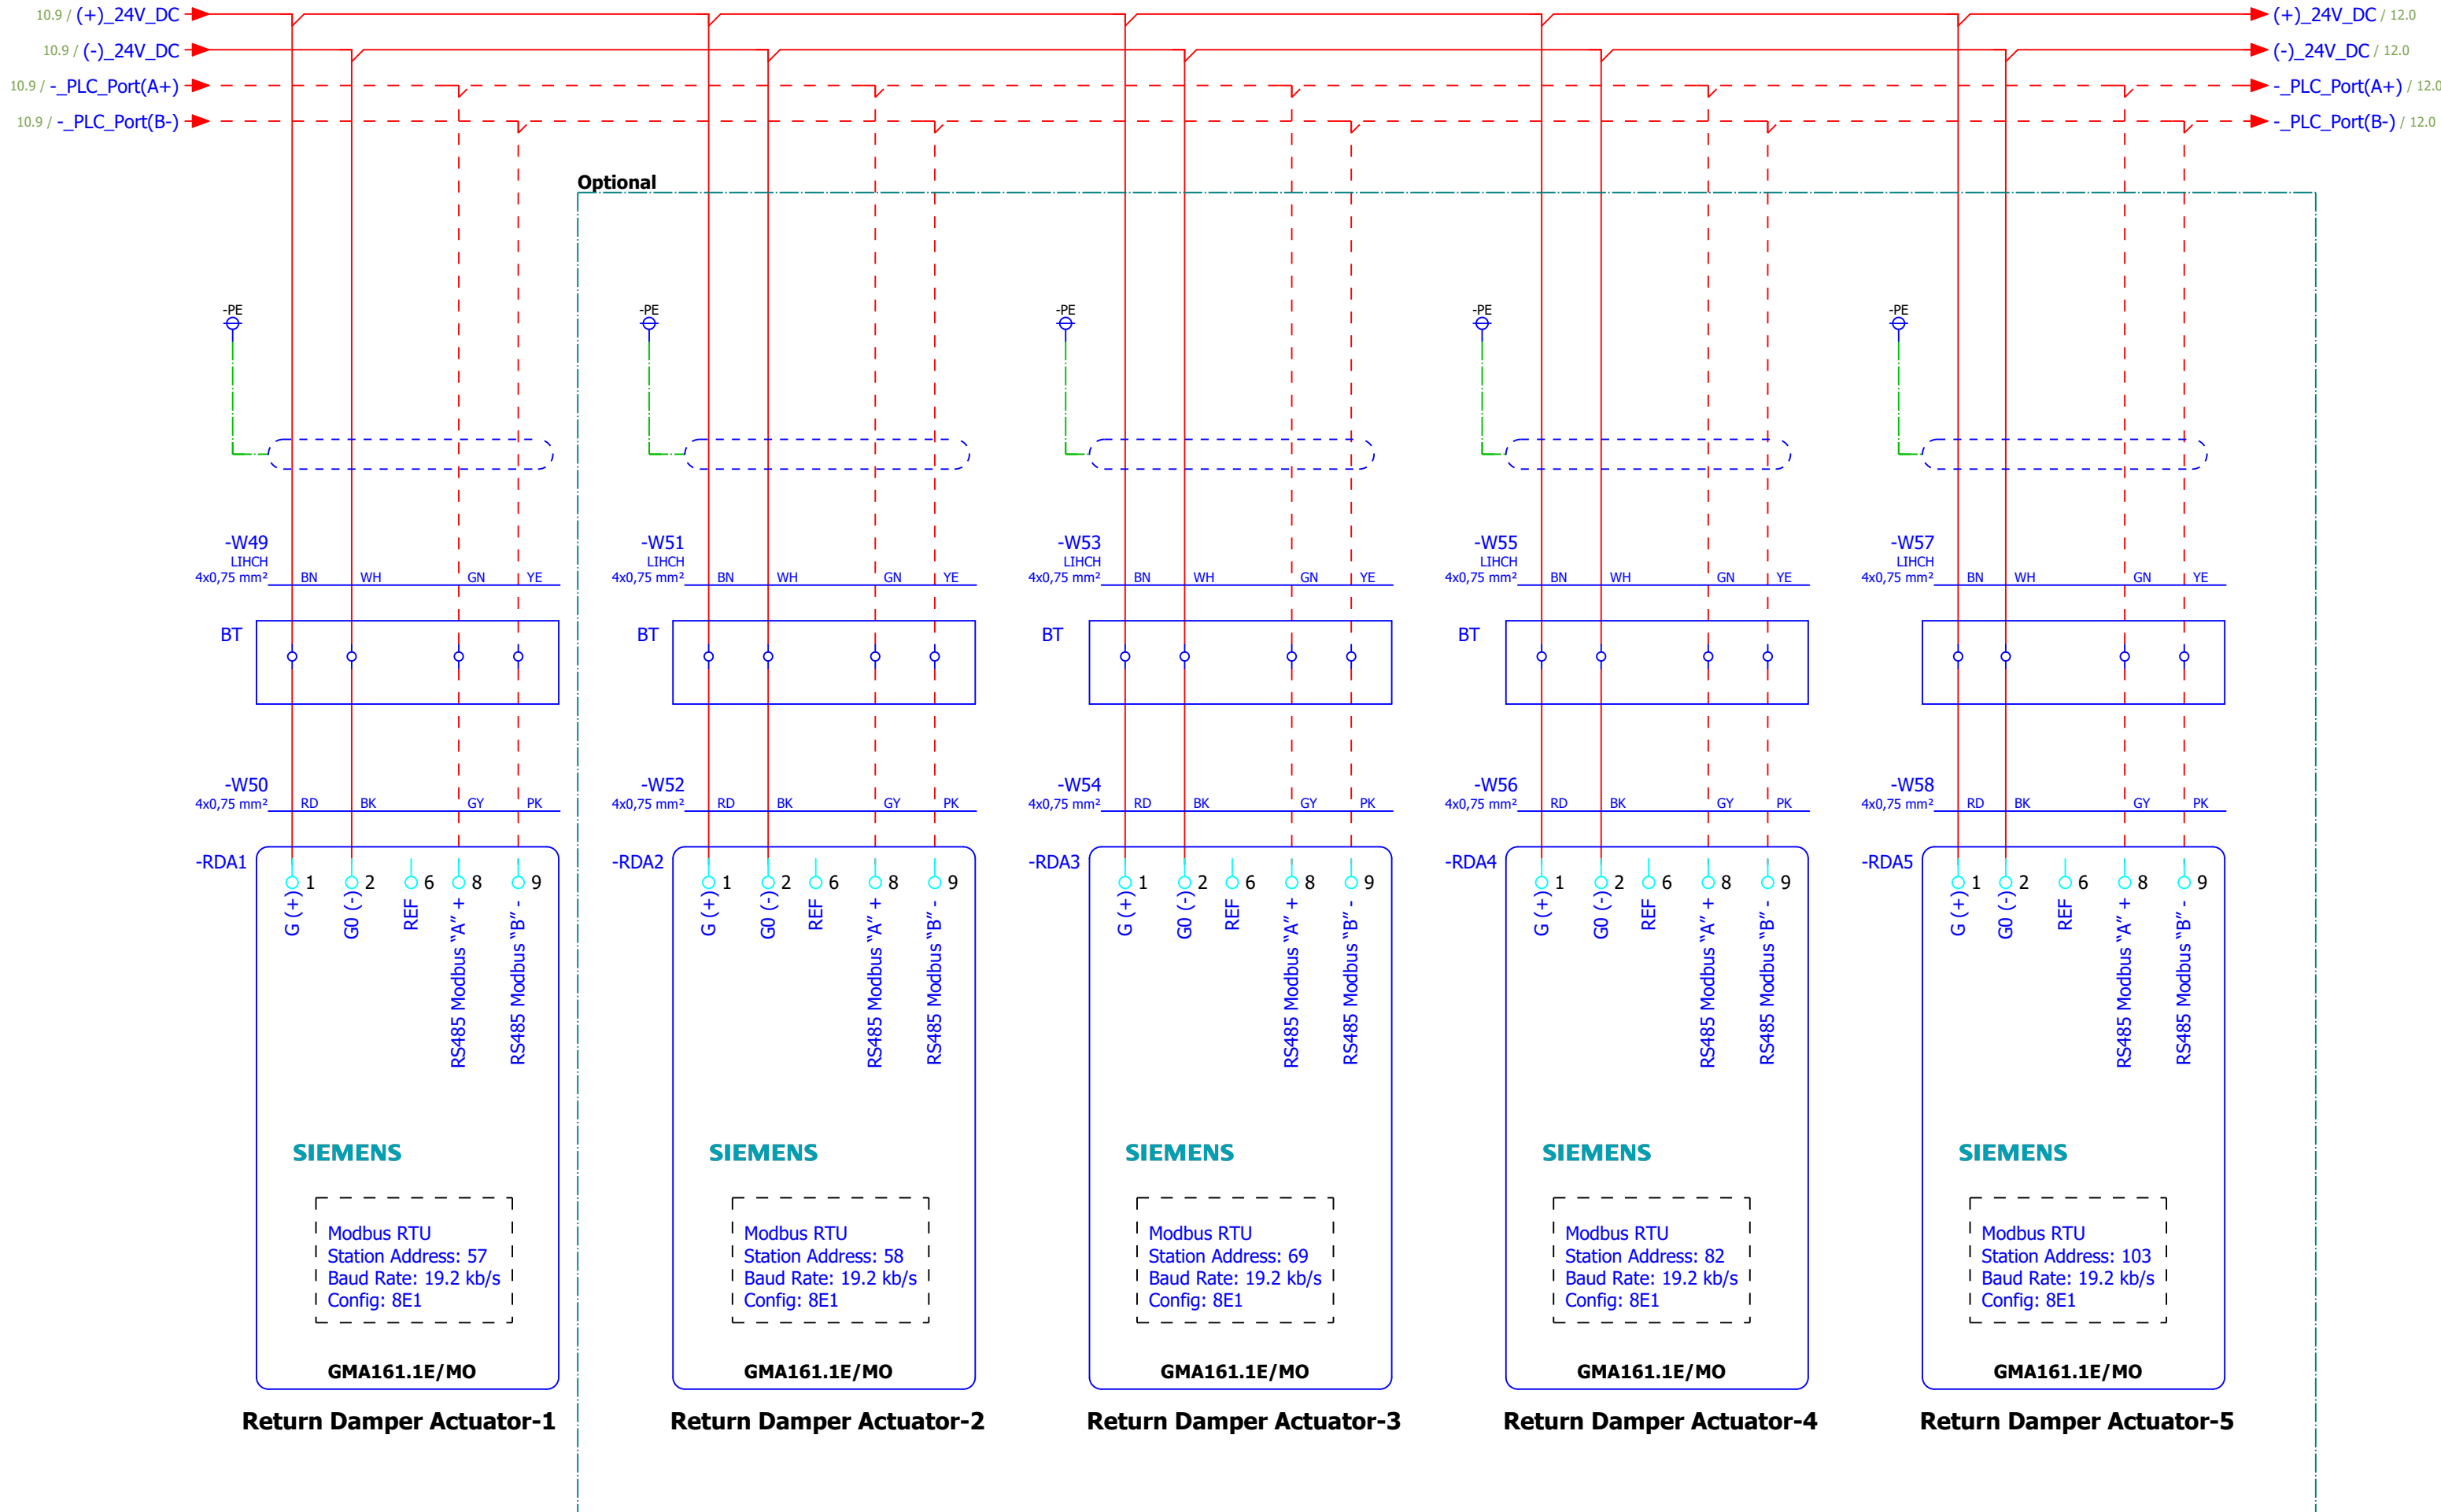

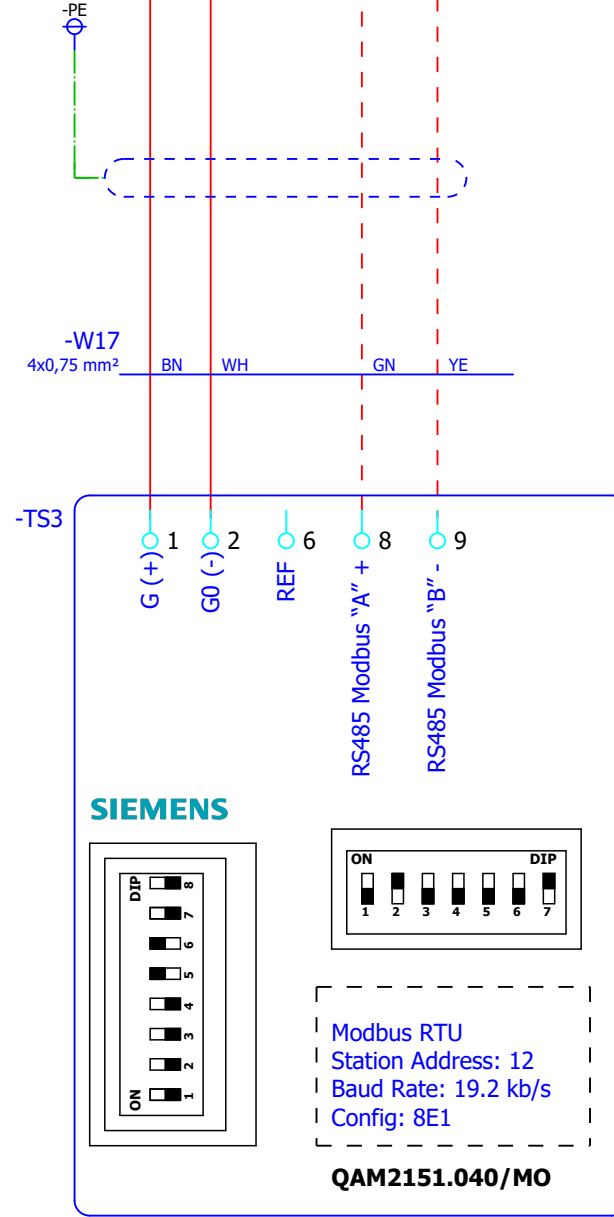
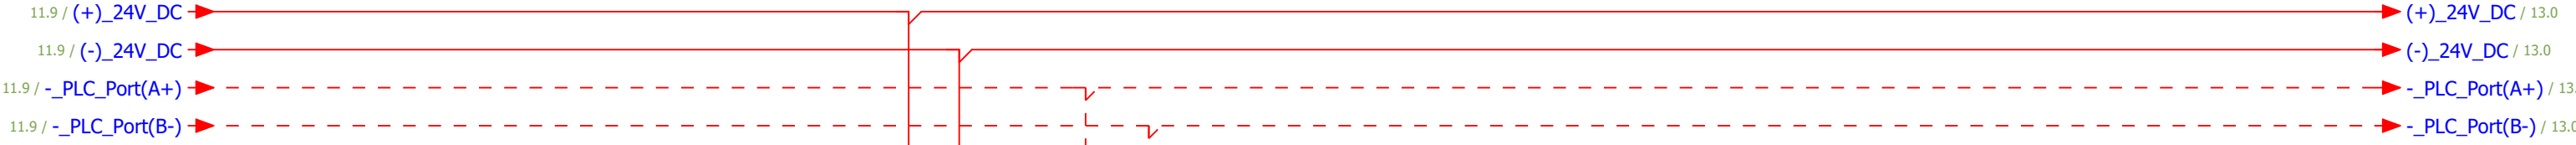


Supply Air Temperature Sensor



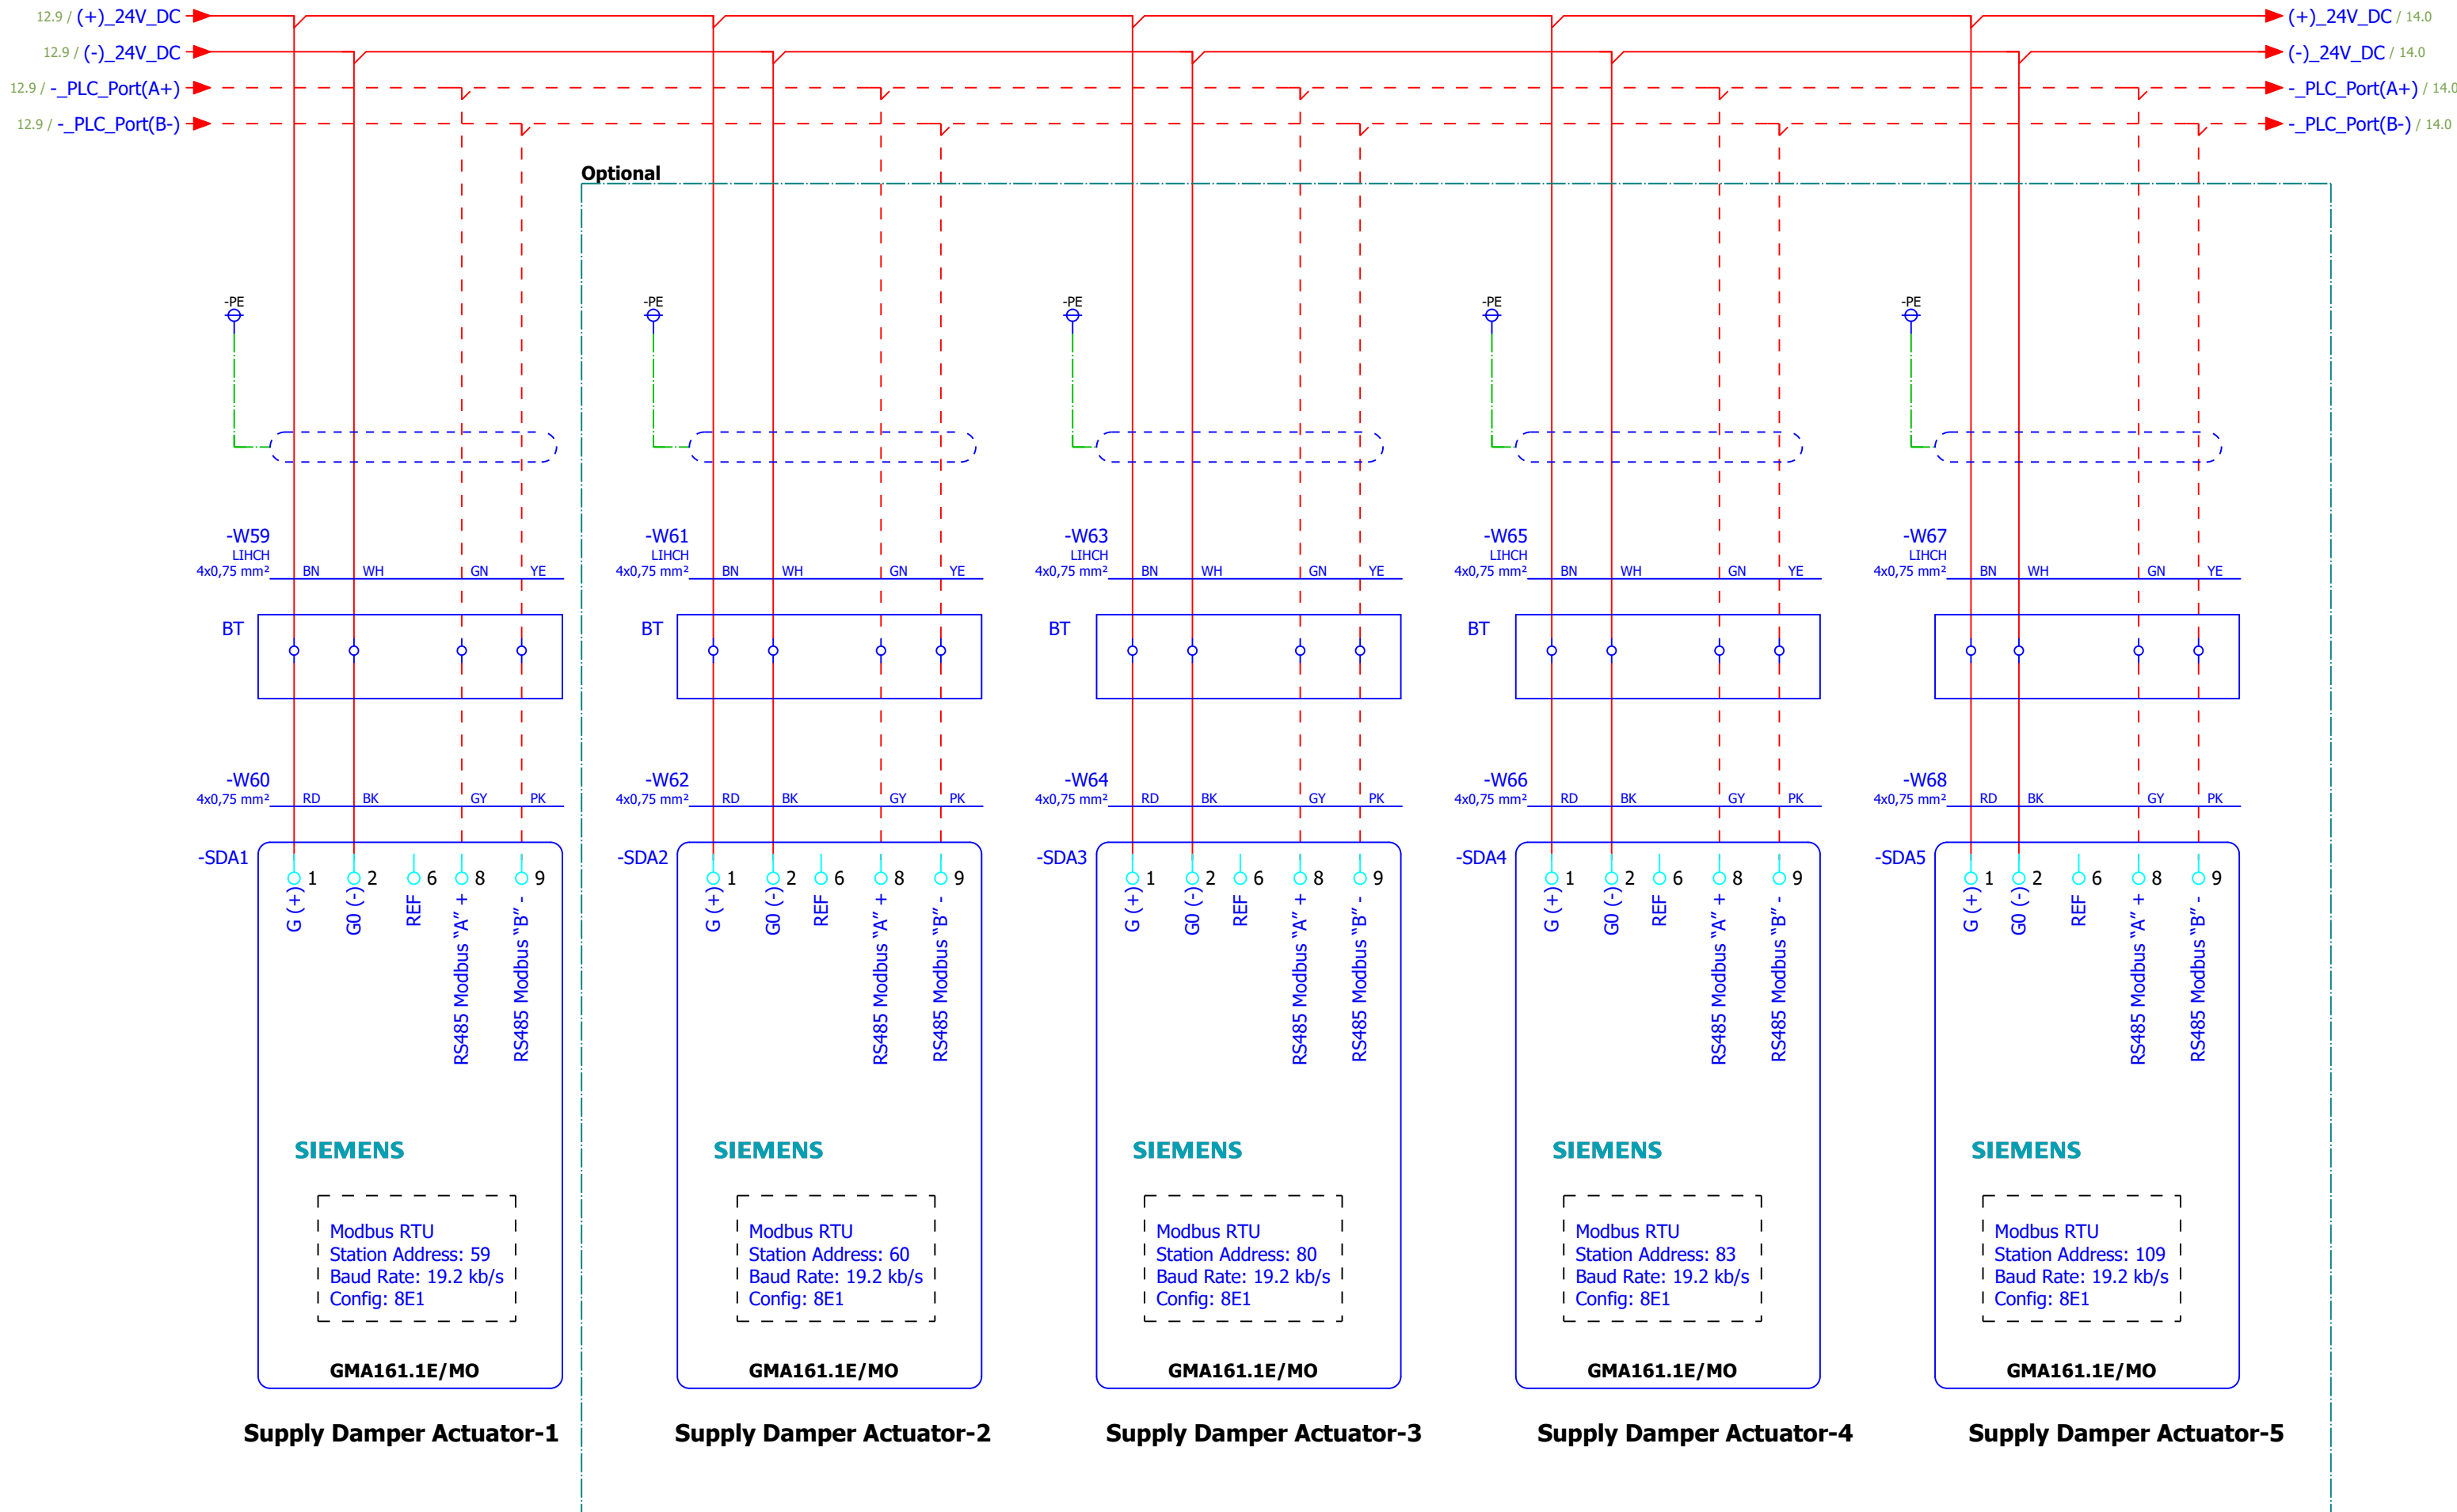


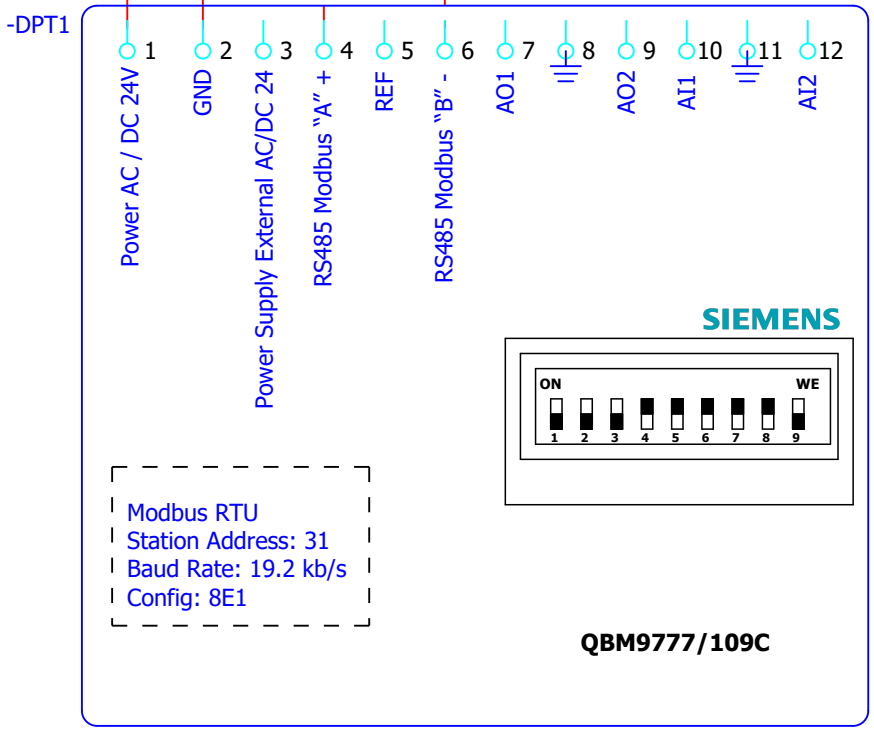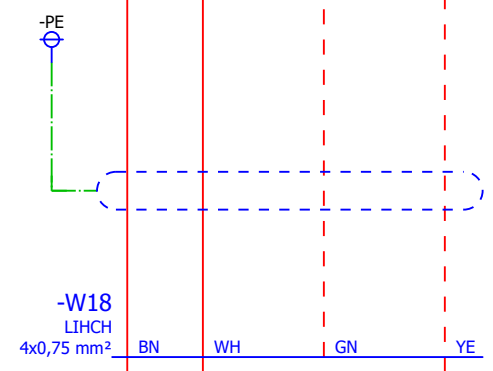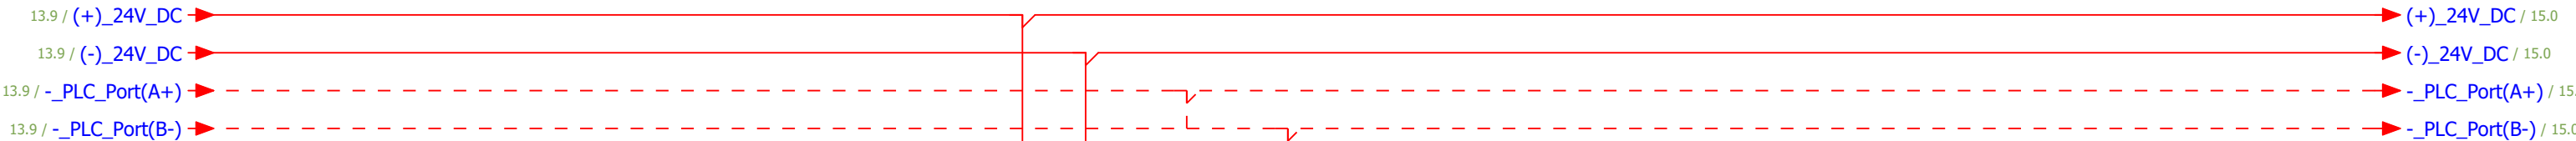


Supply Pressure Sensor

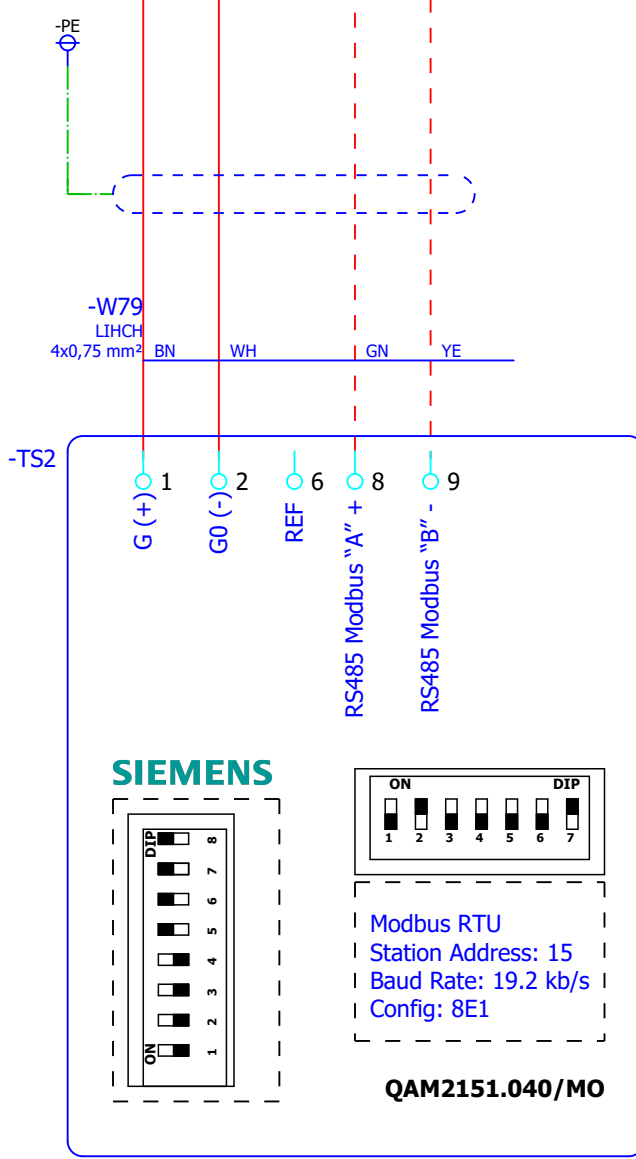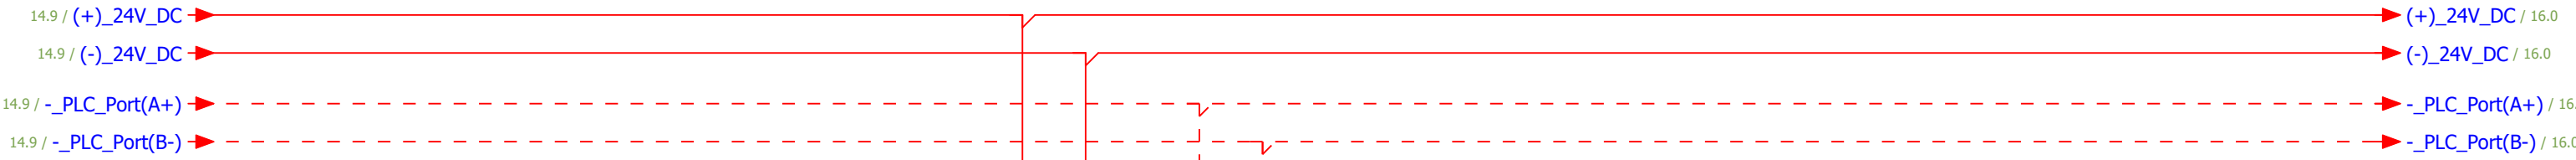



After DX Unit Temperature Sensor

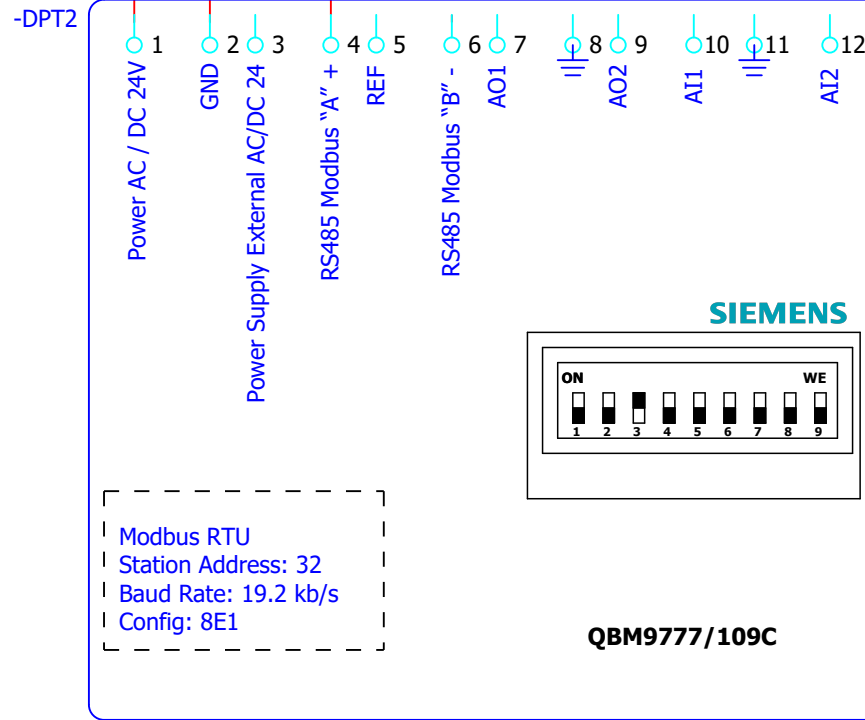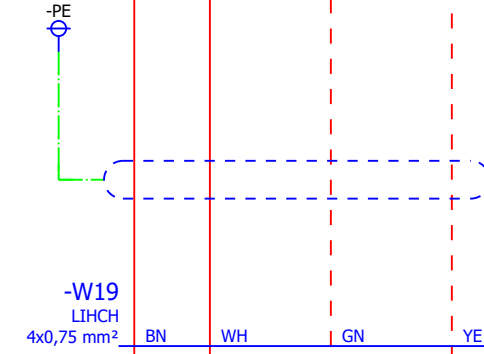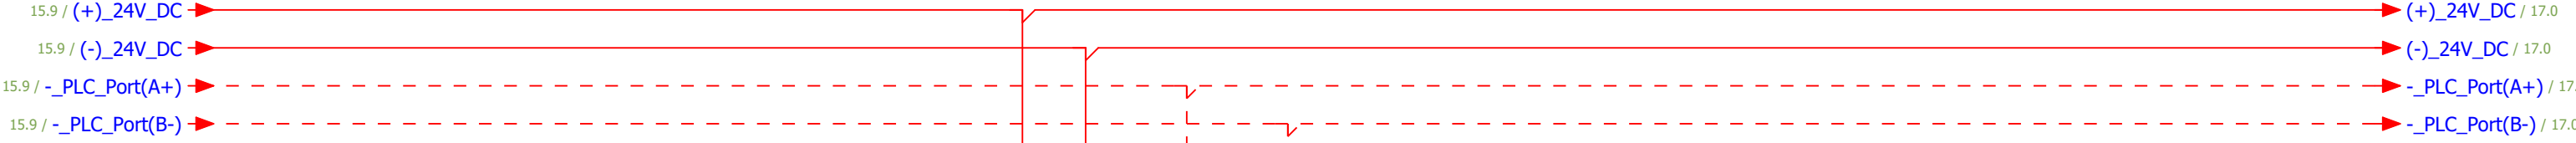


Return Pressure Sensor

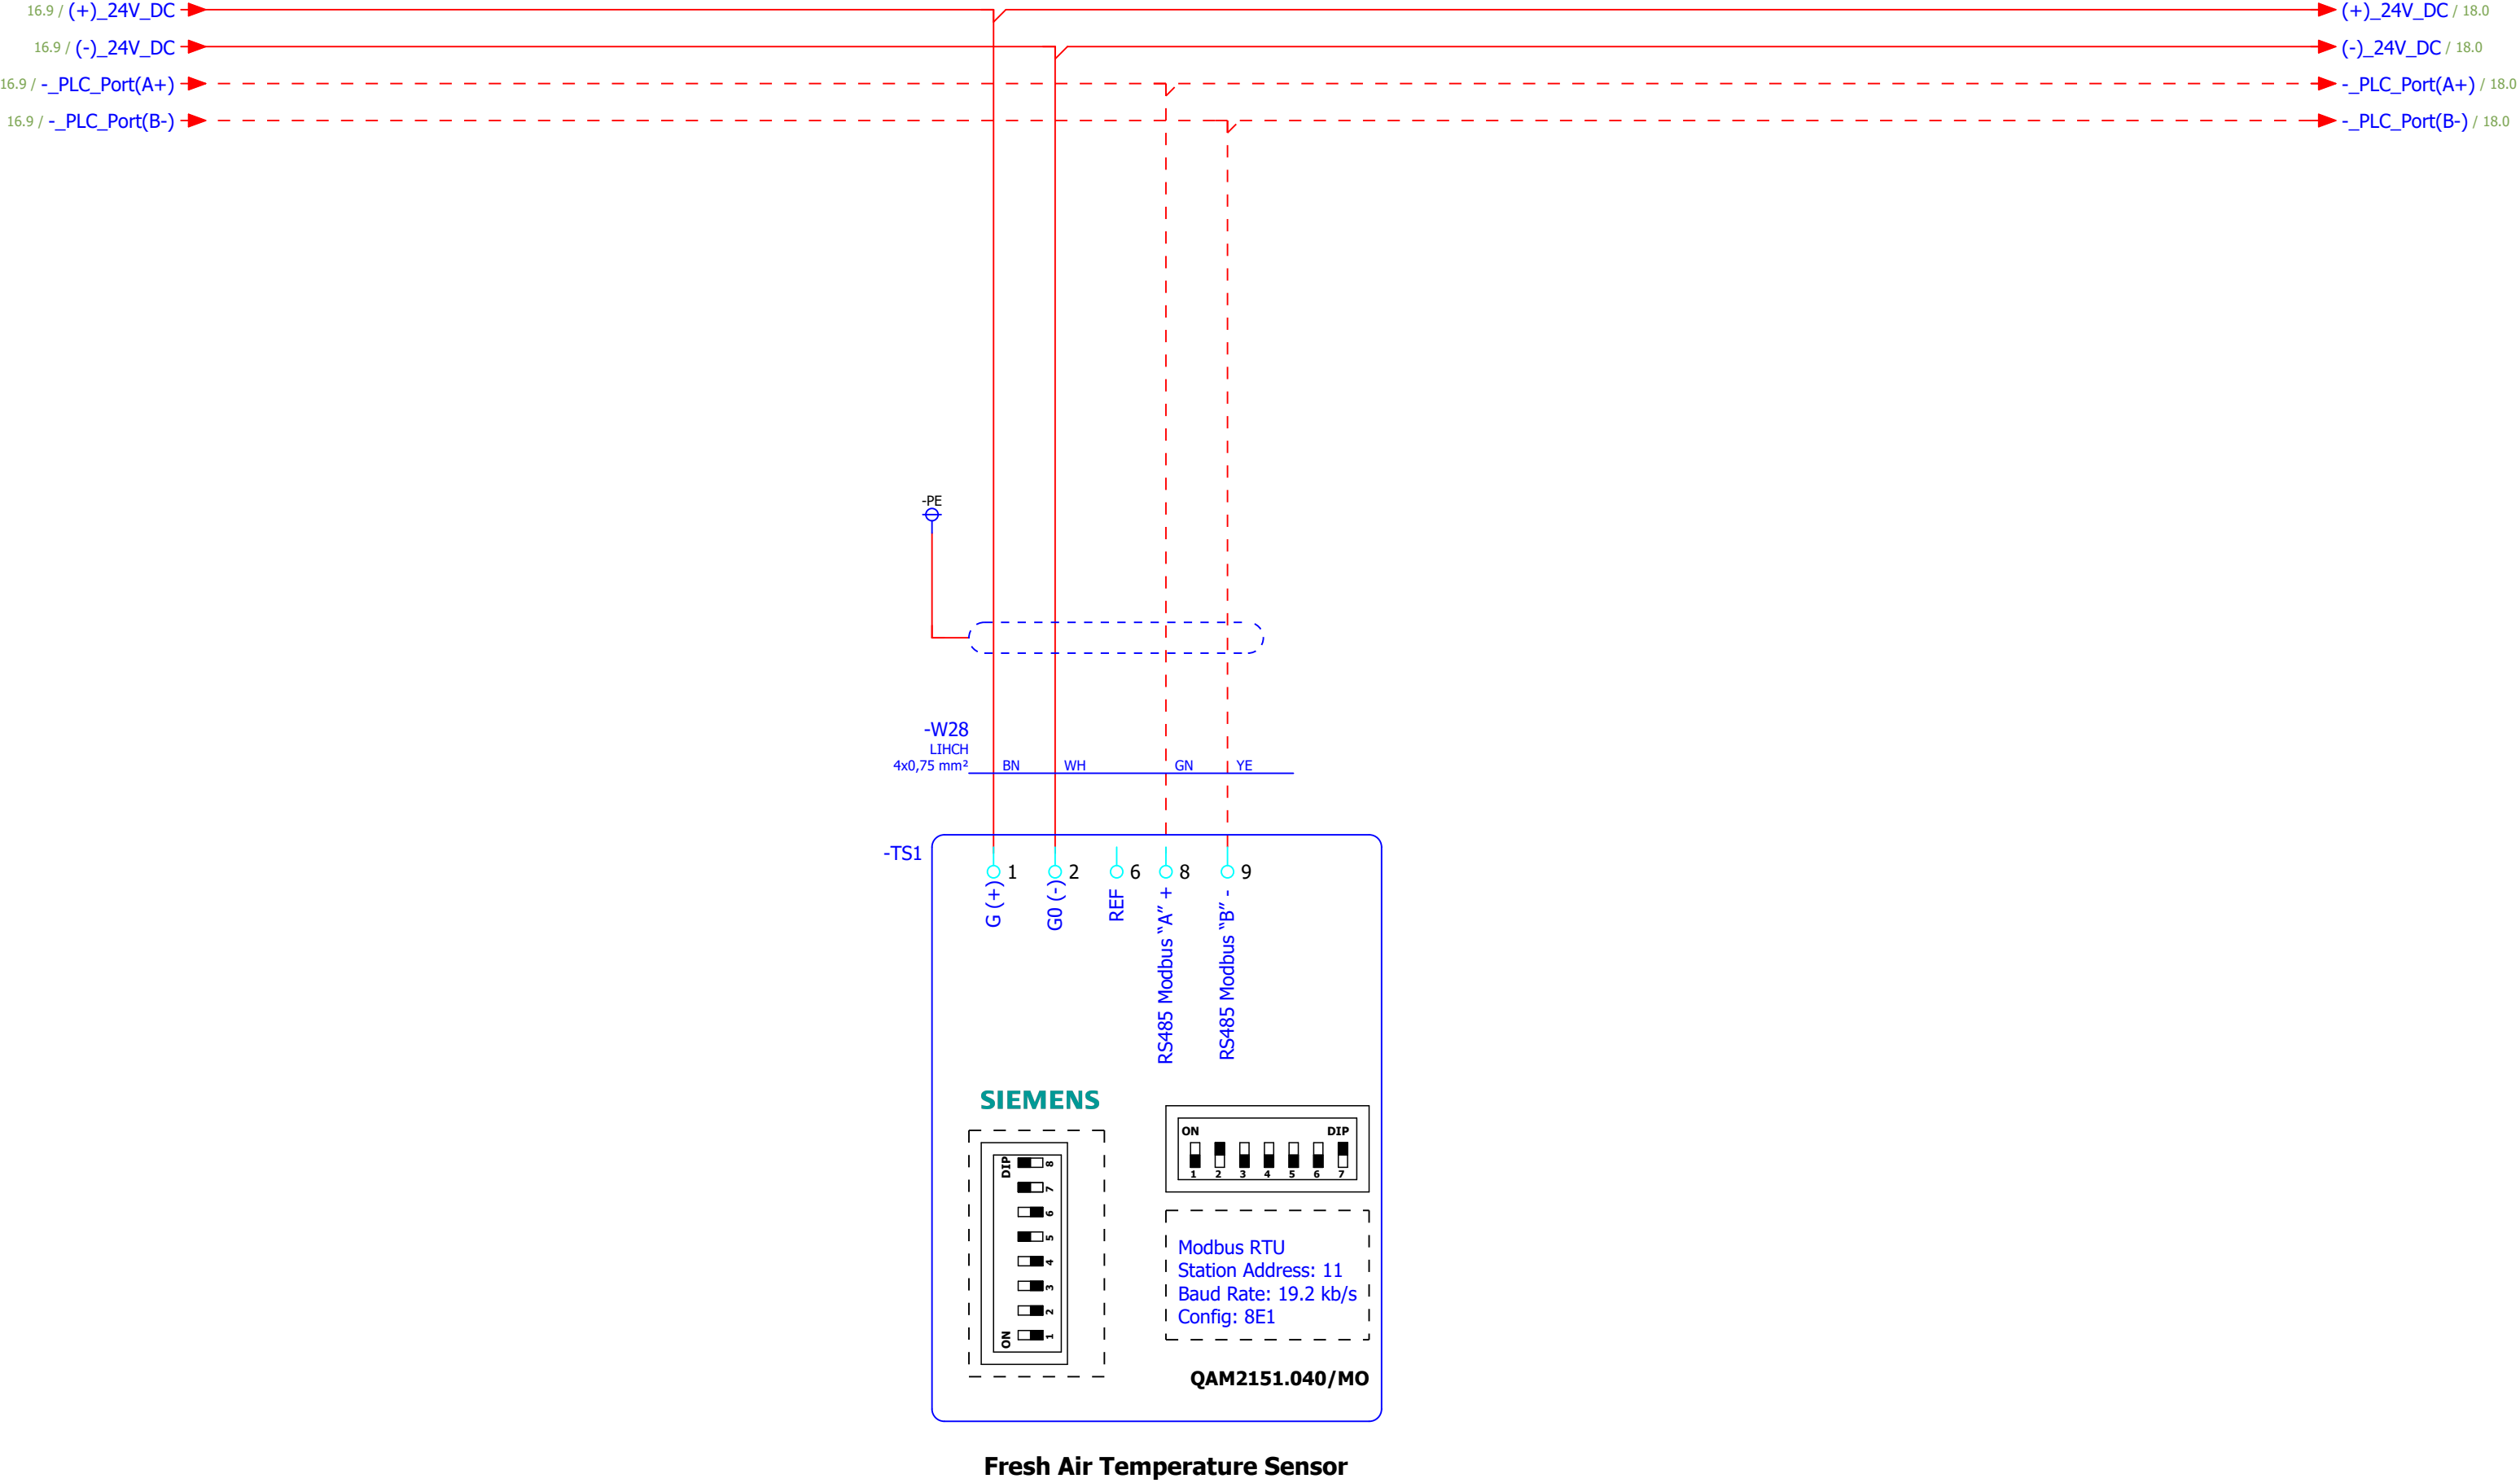


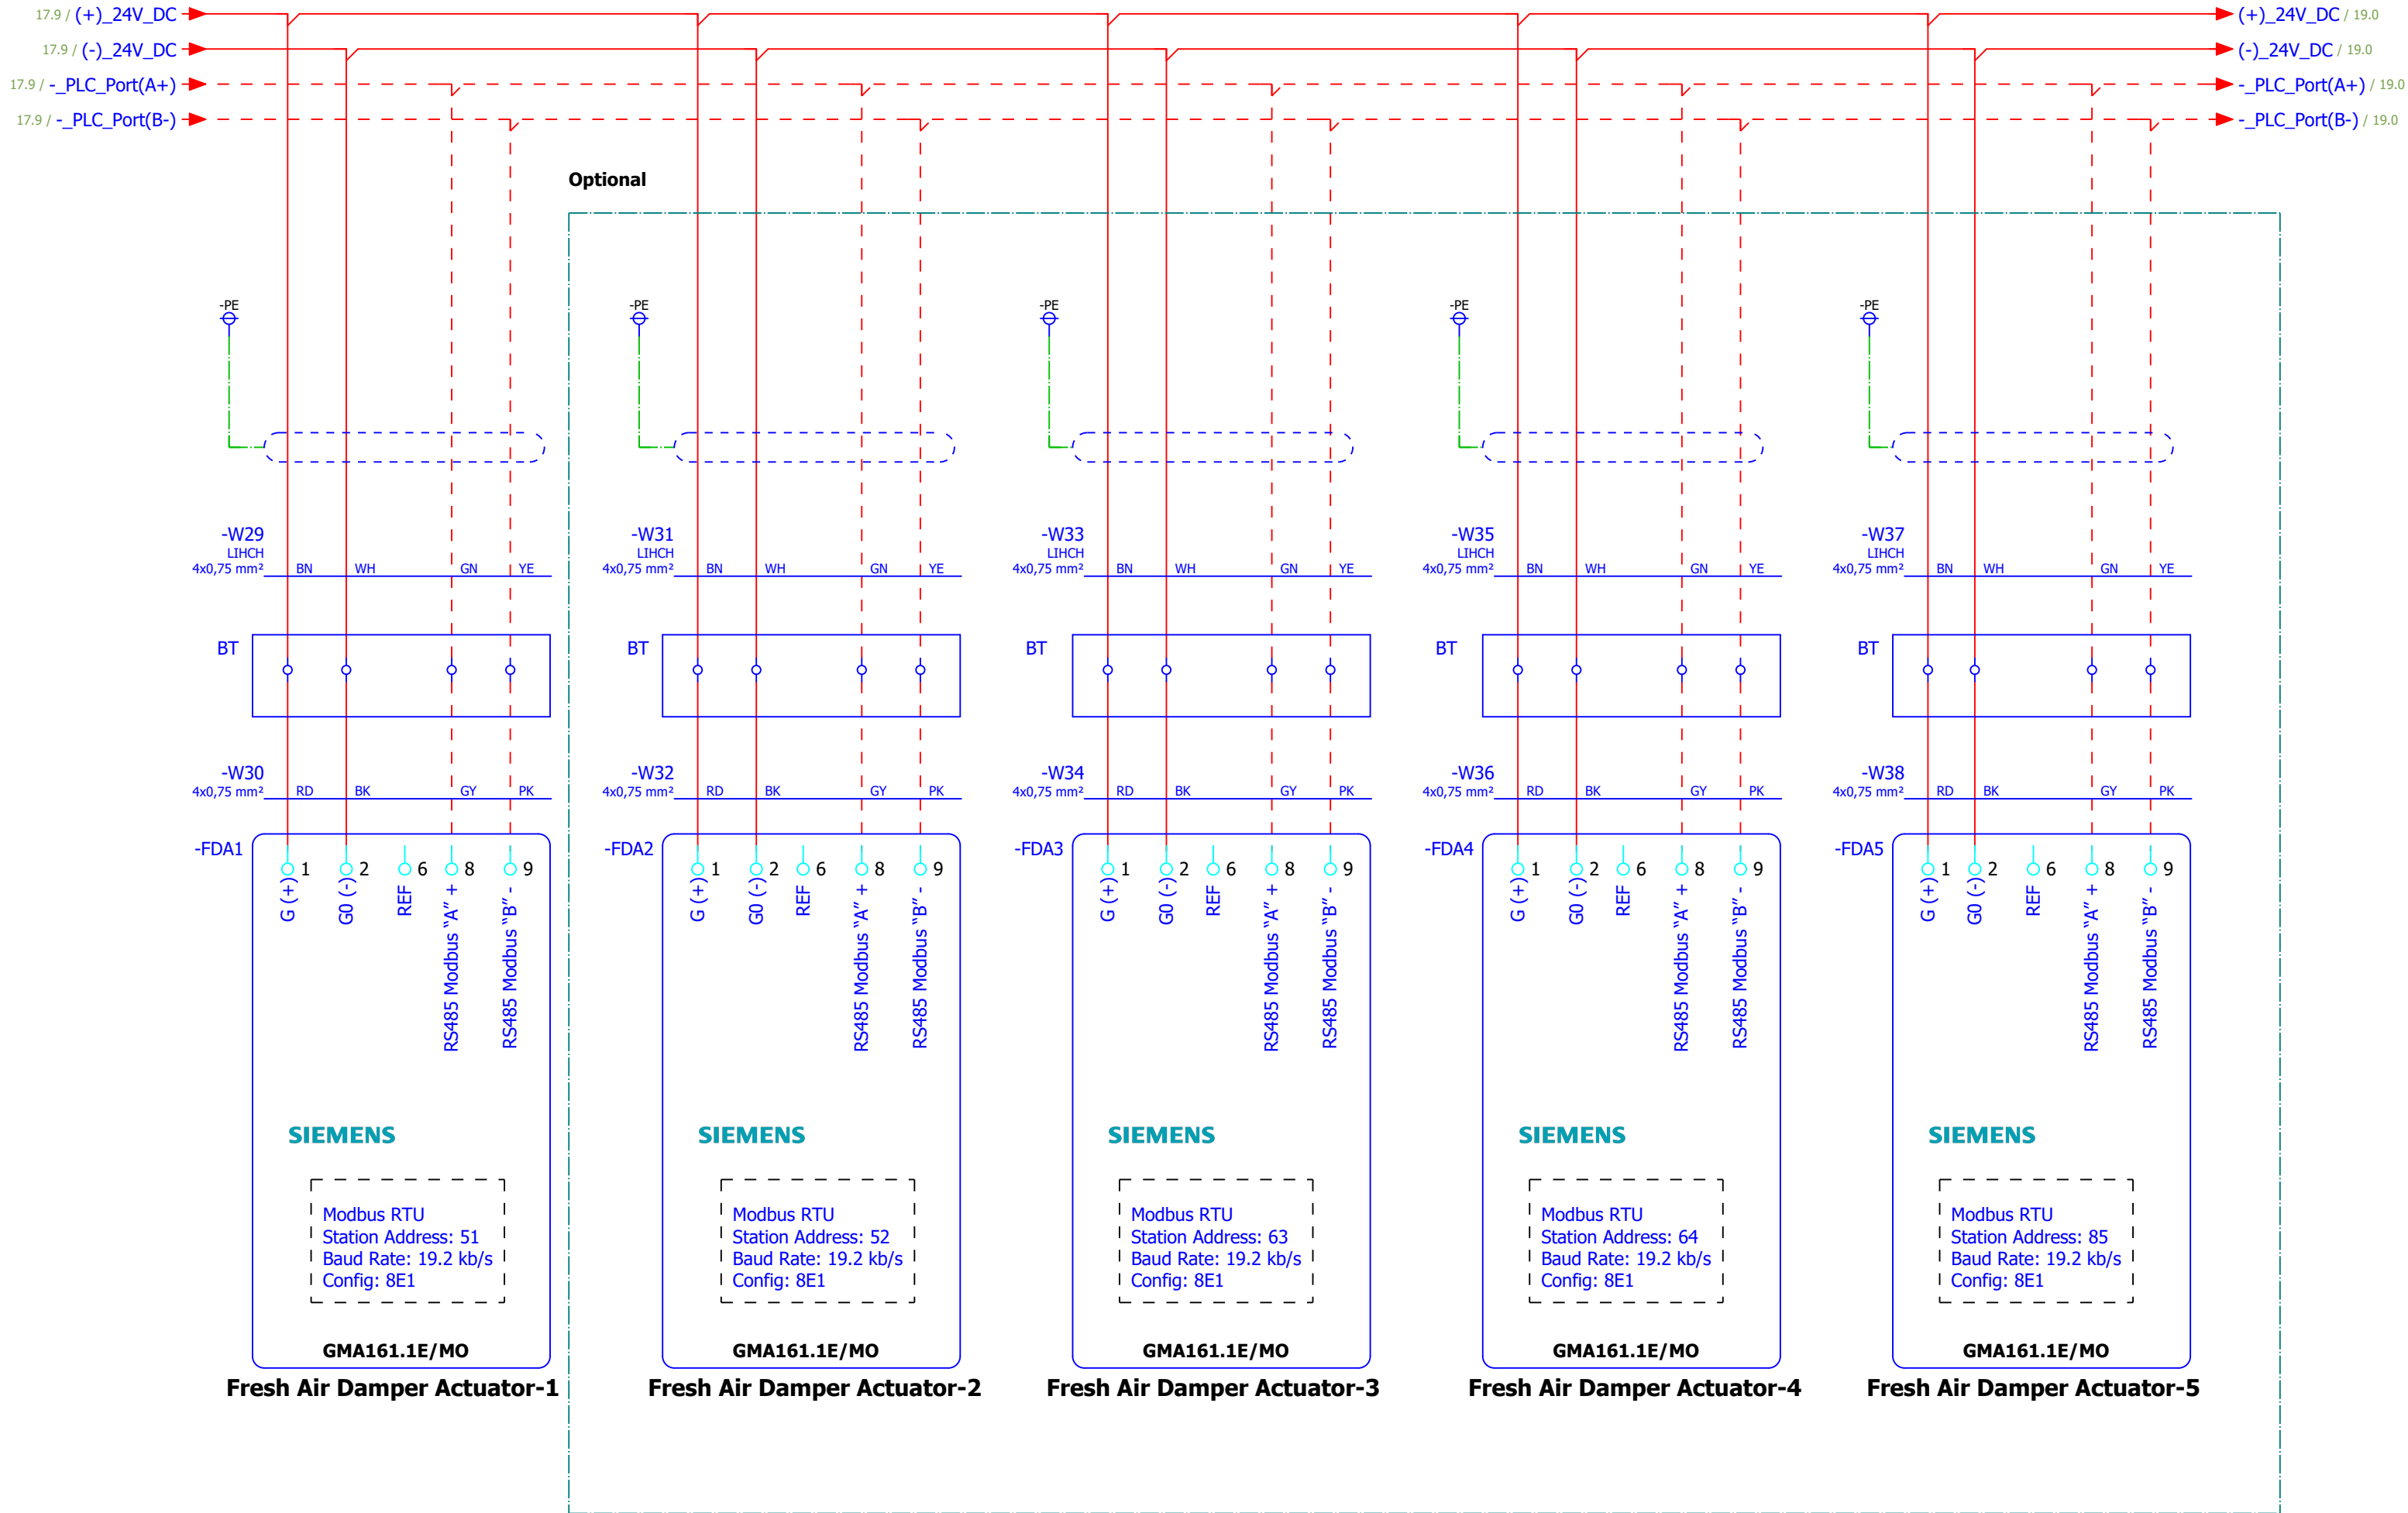

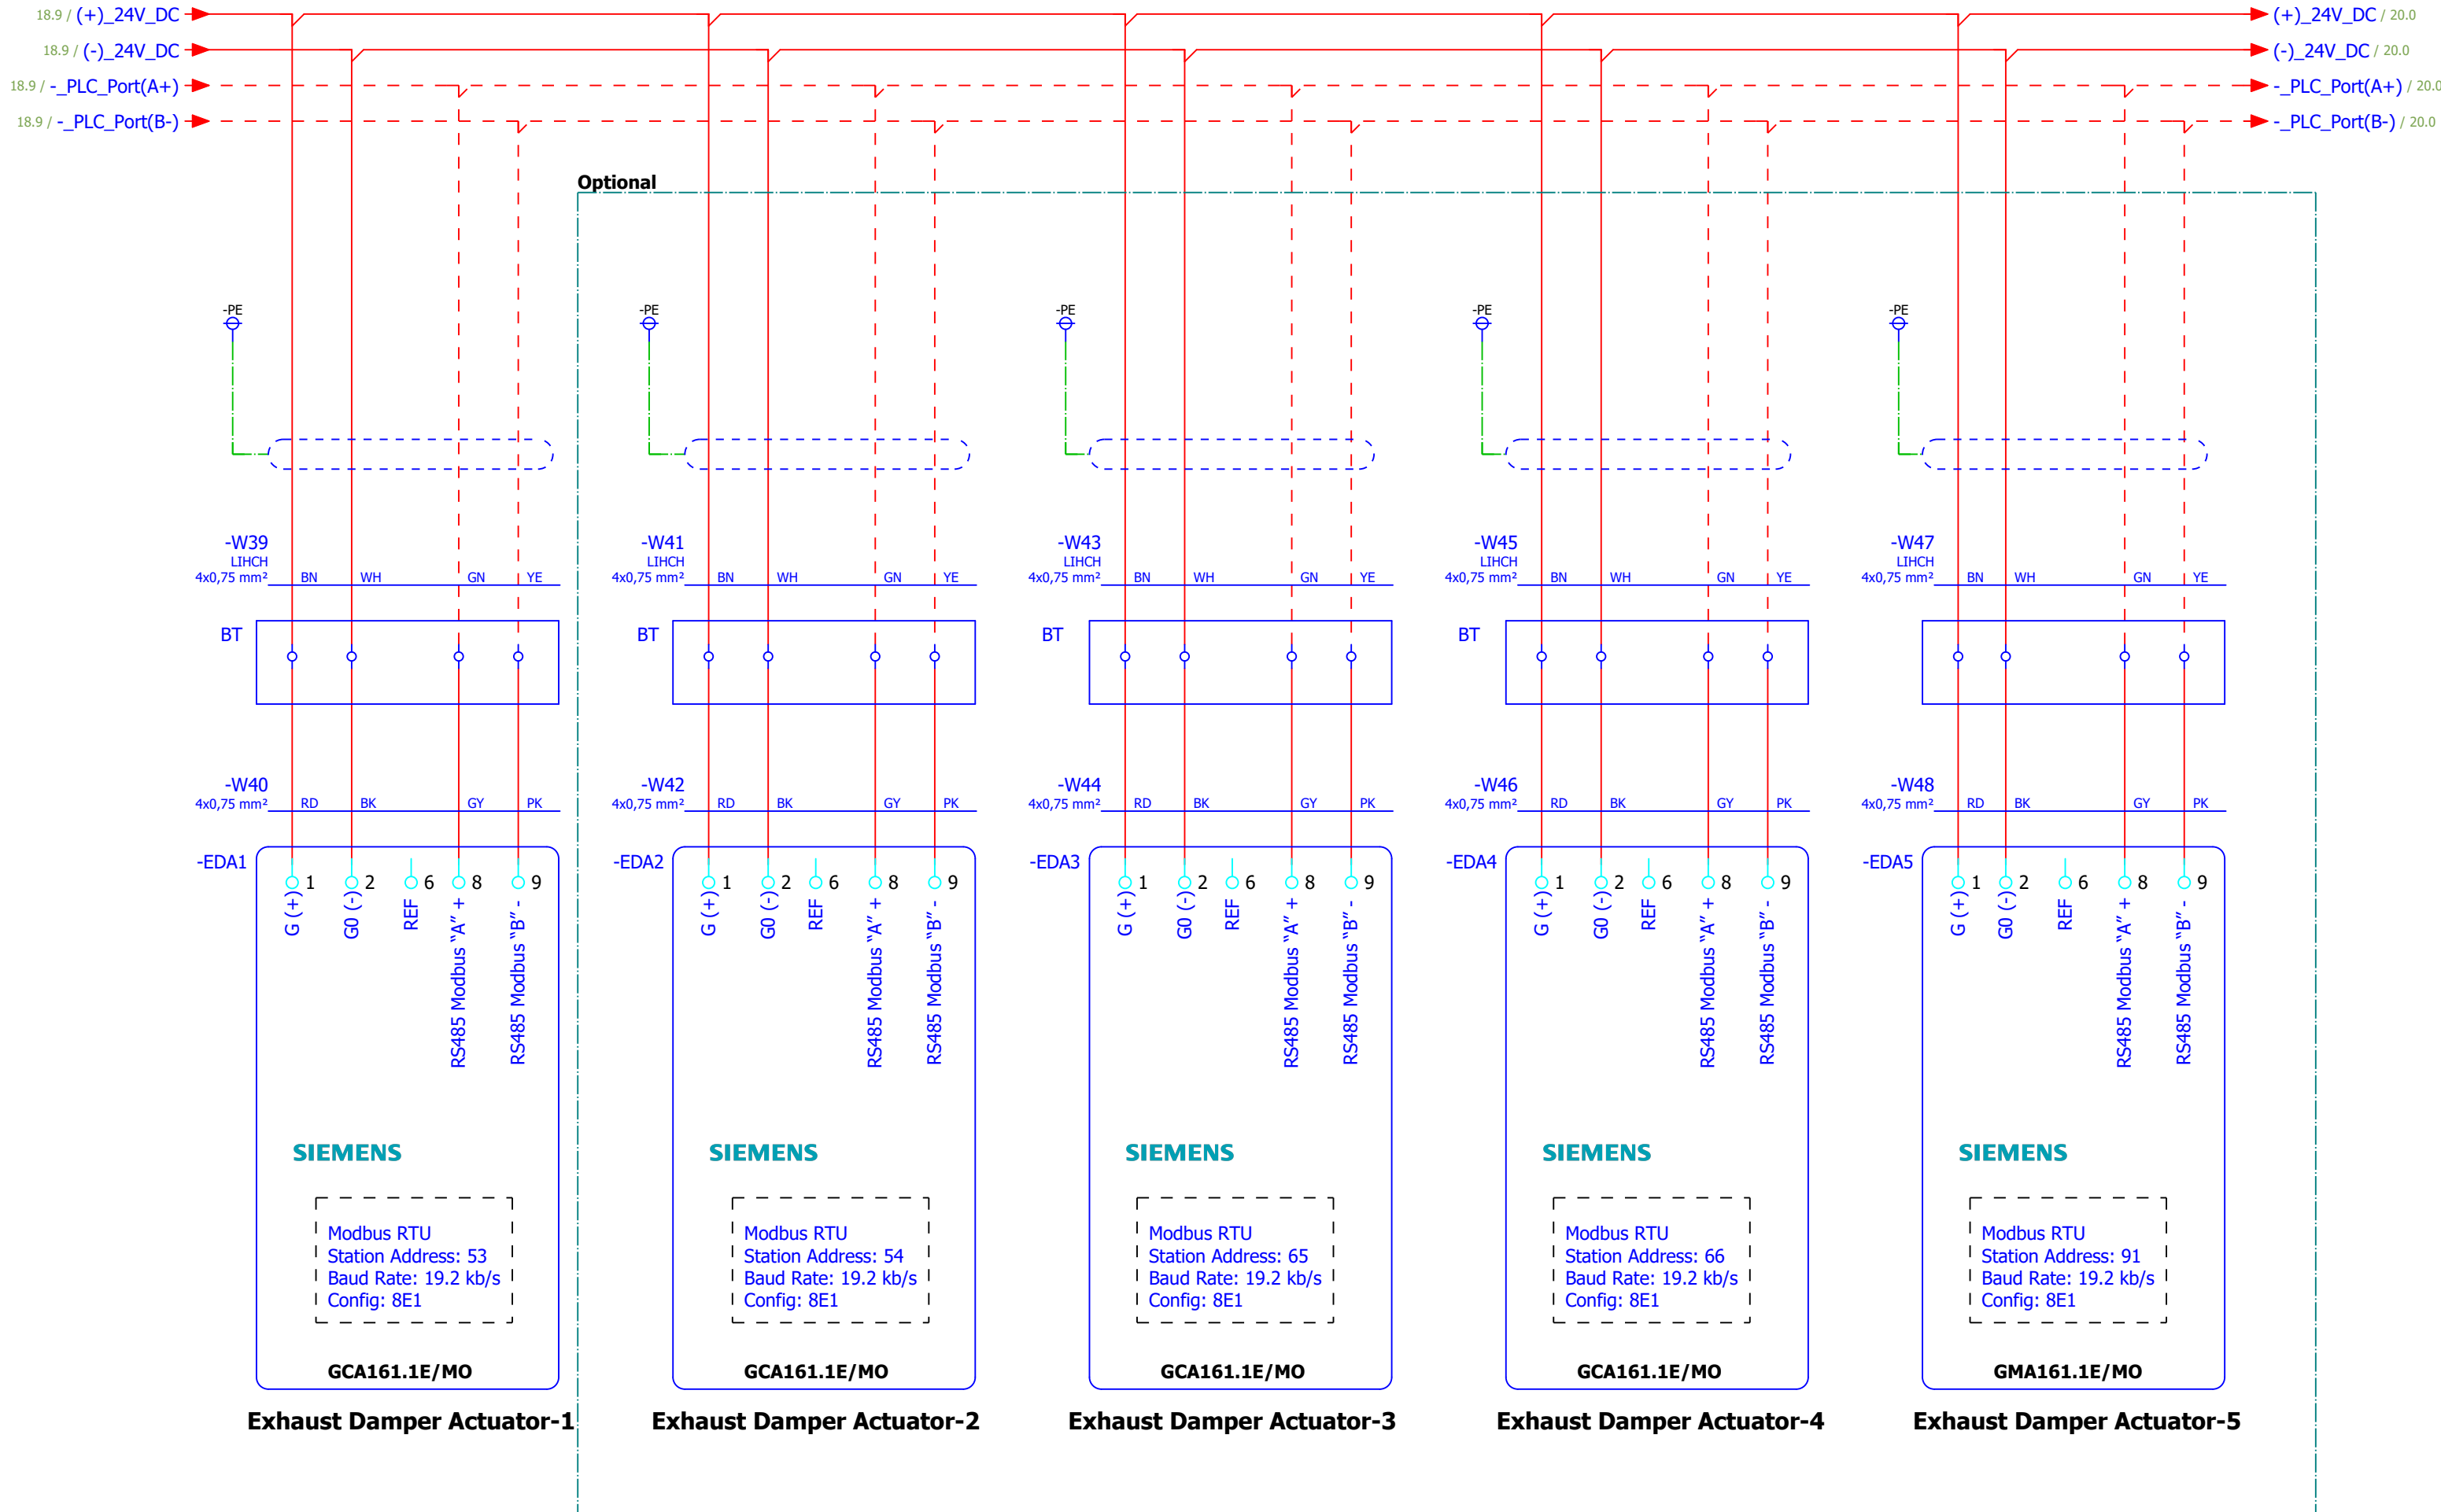


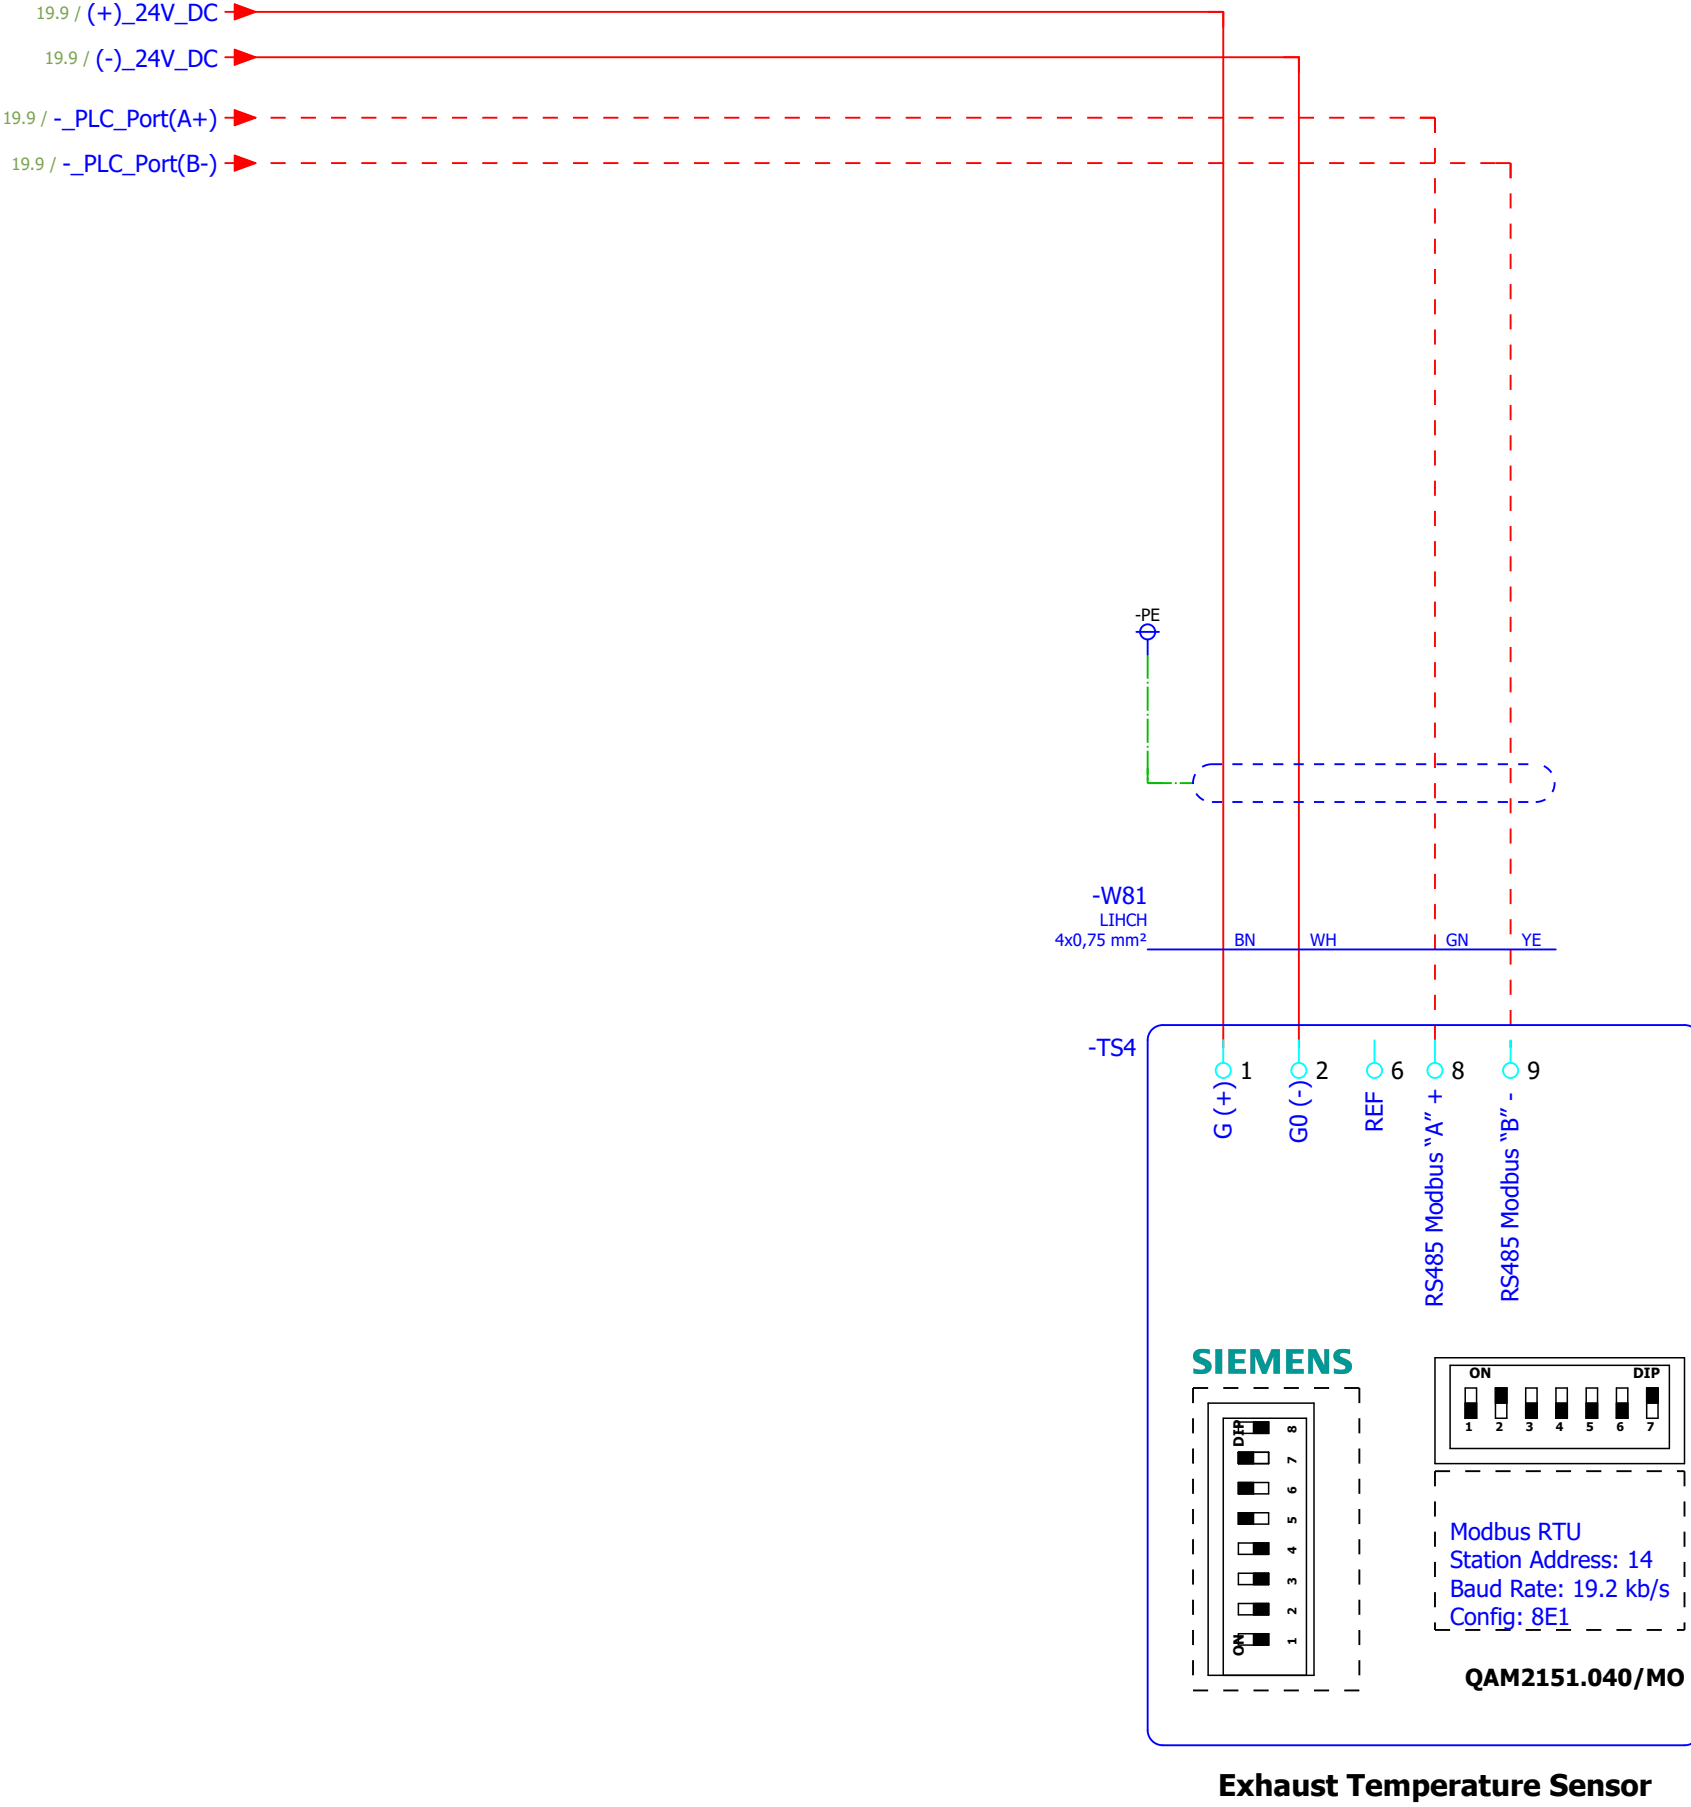





Exhaust Temperature Sensor

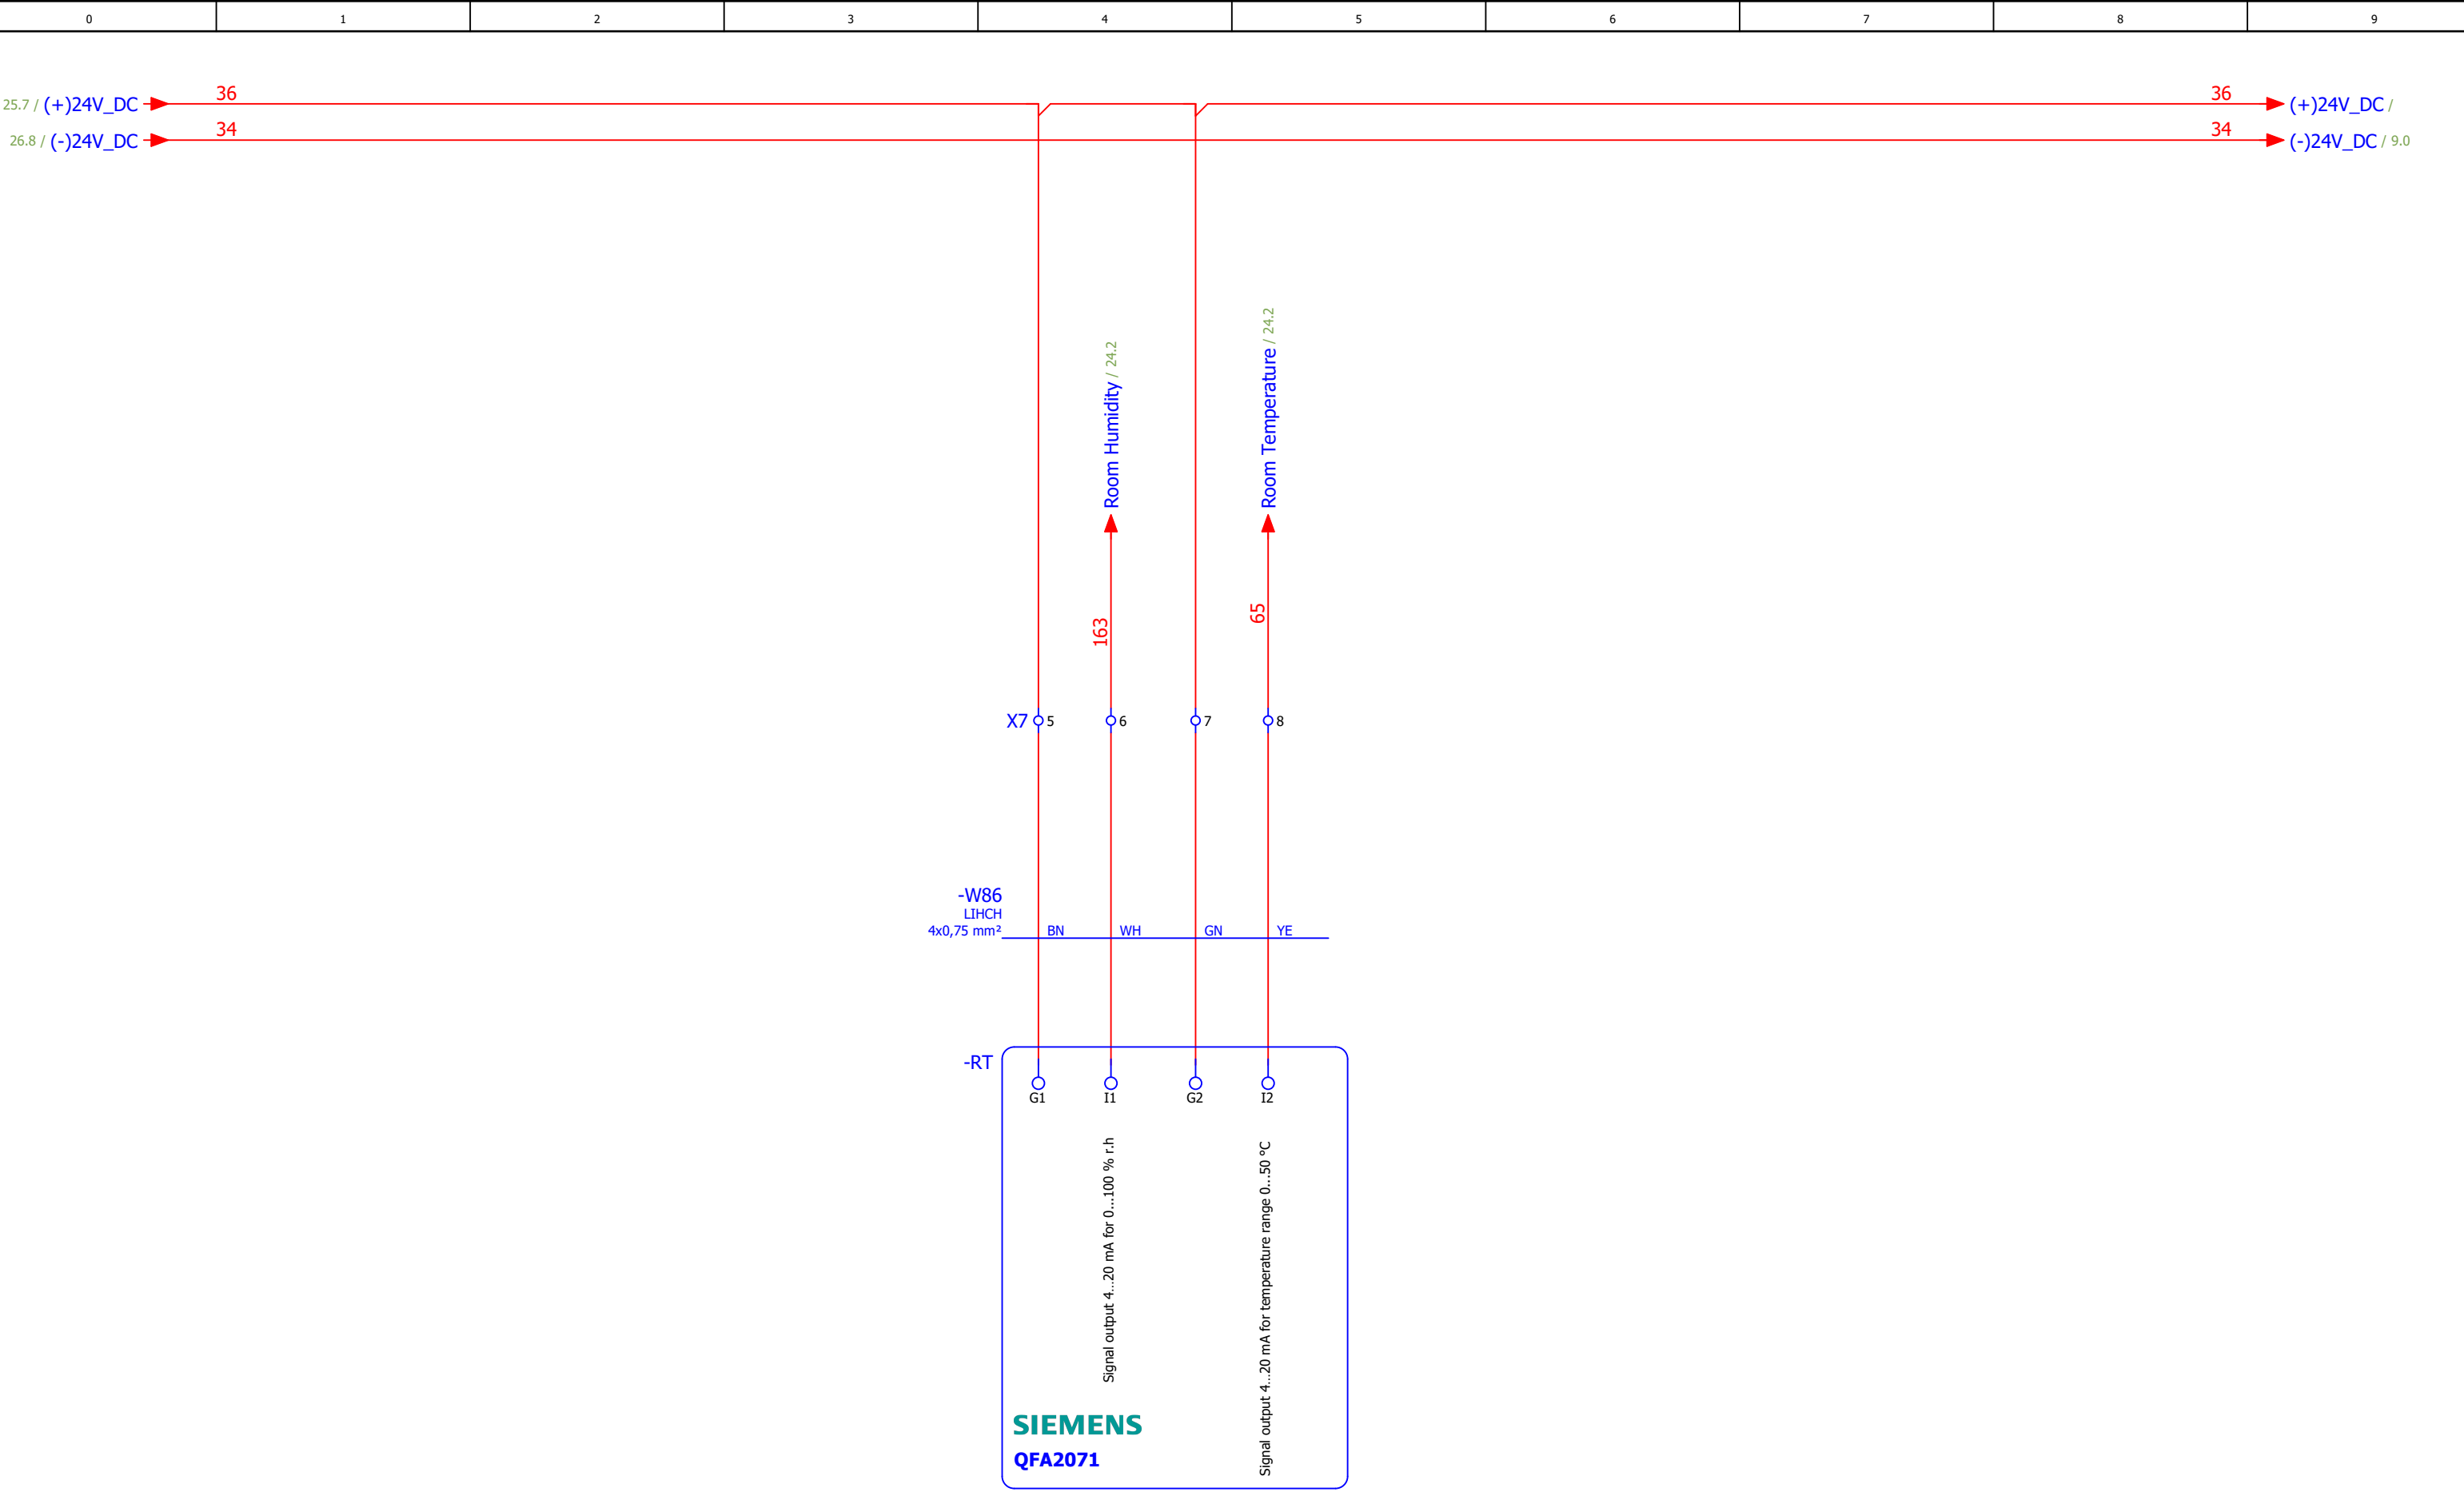

Room Temperature and Humidity

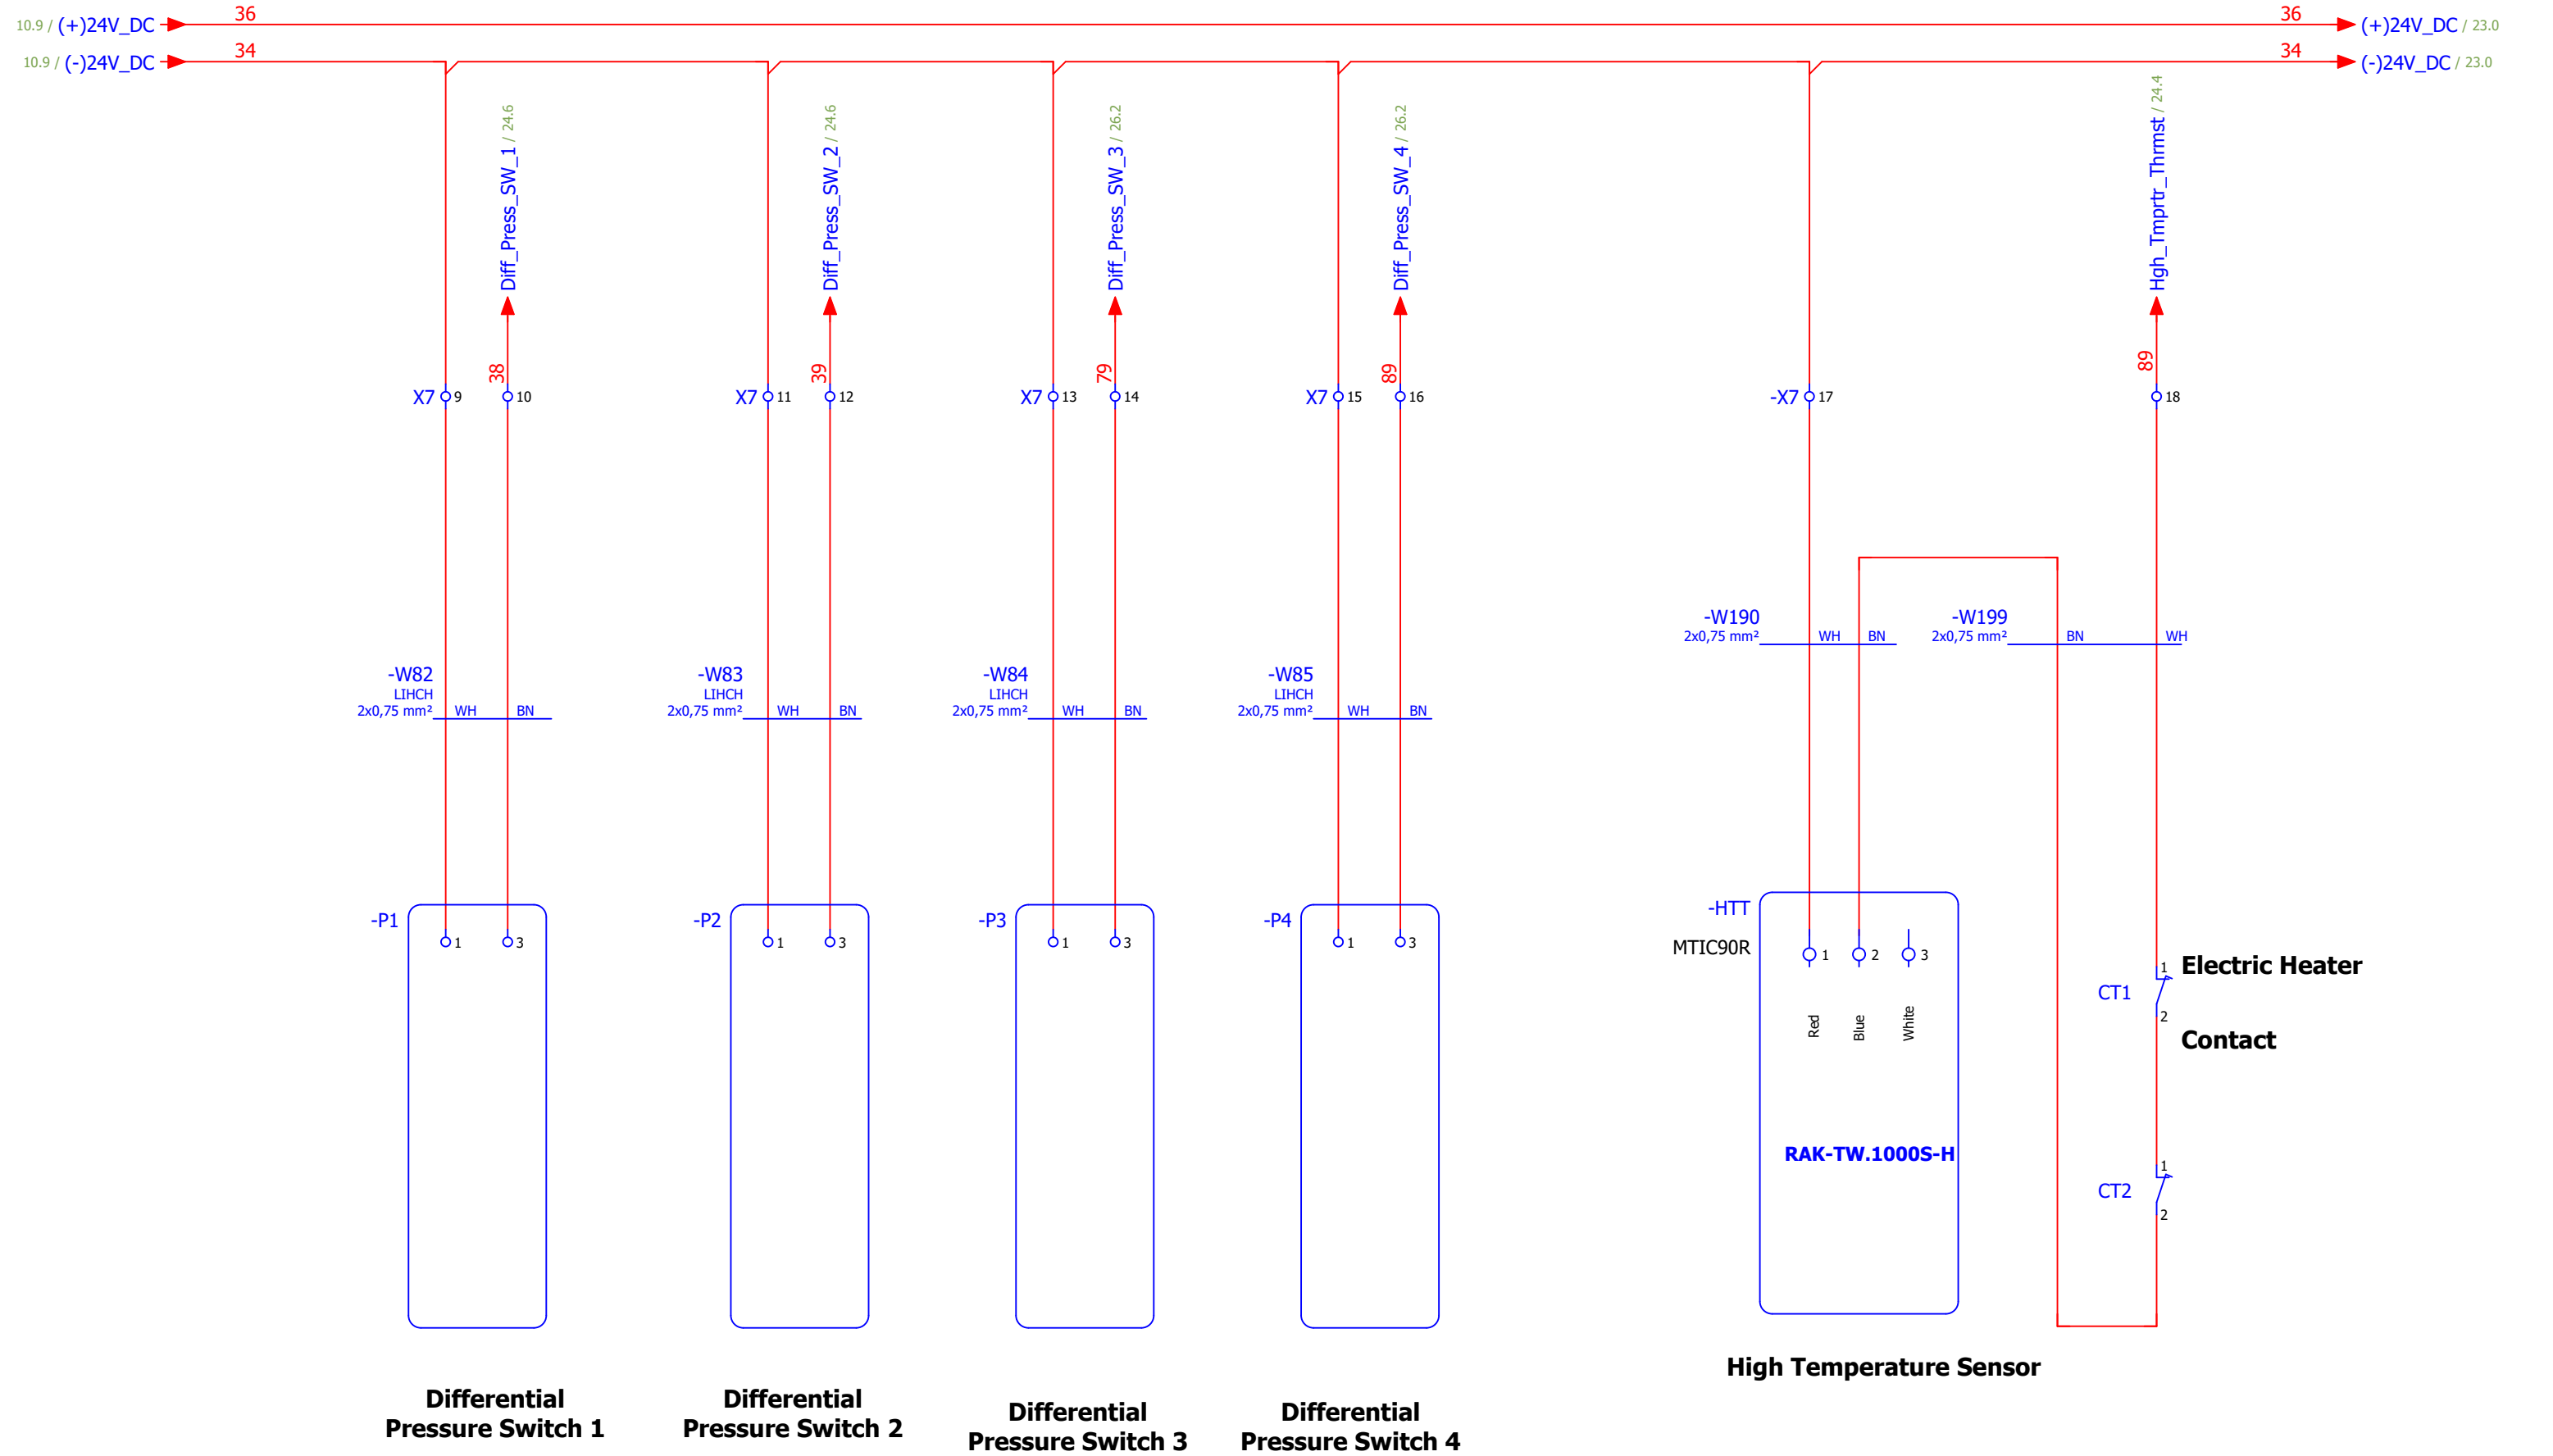


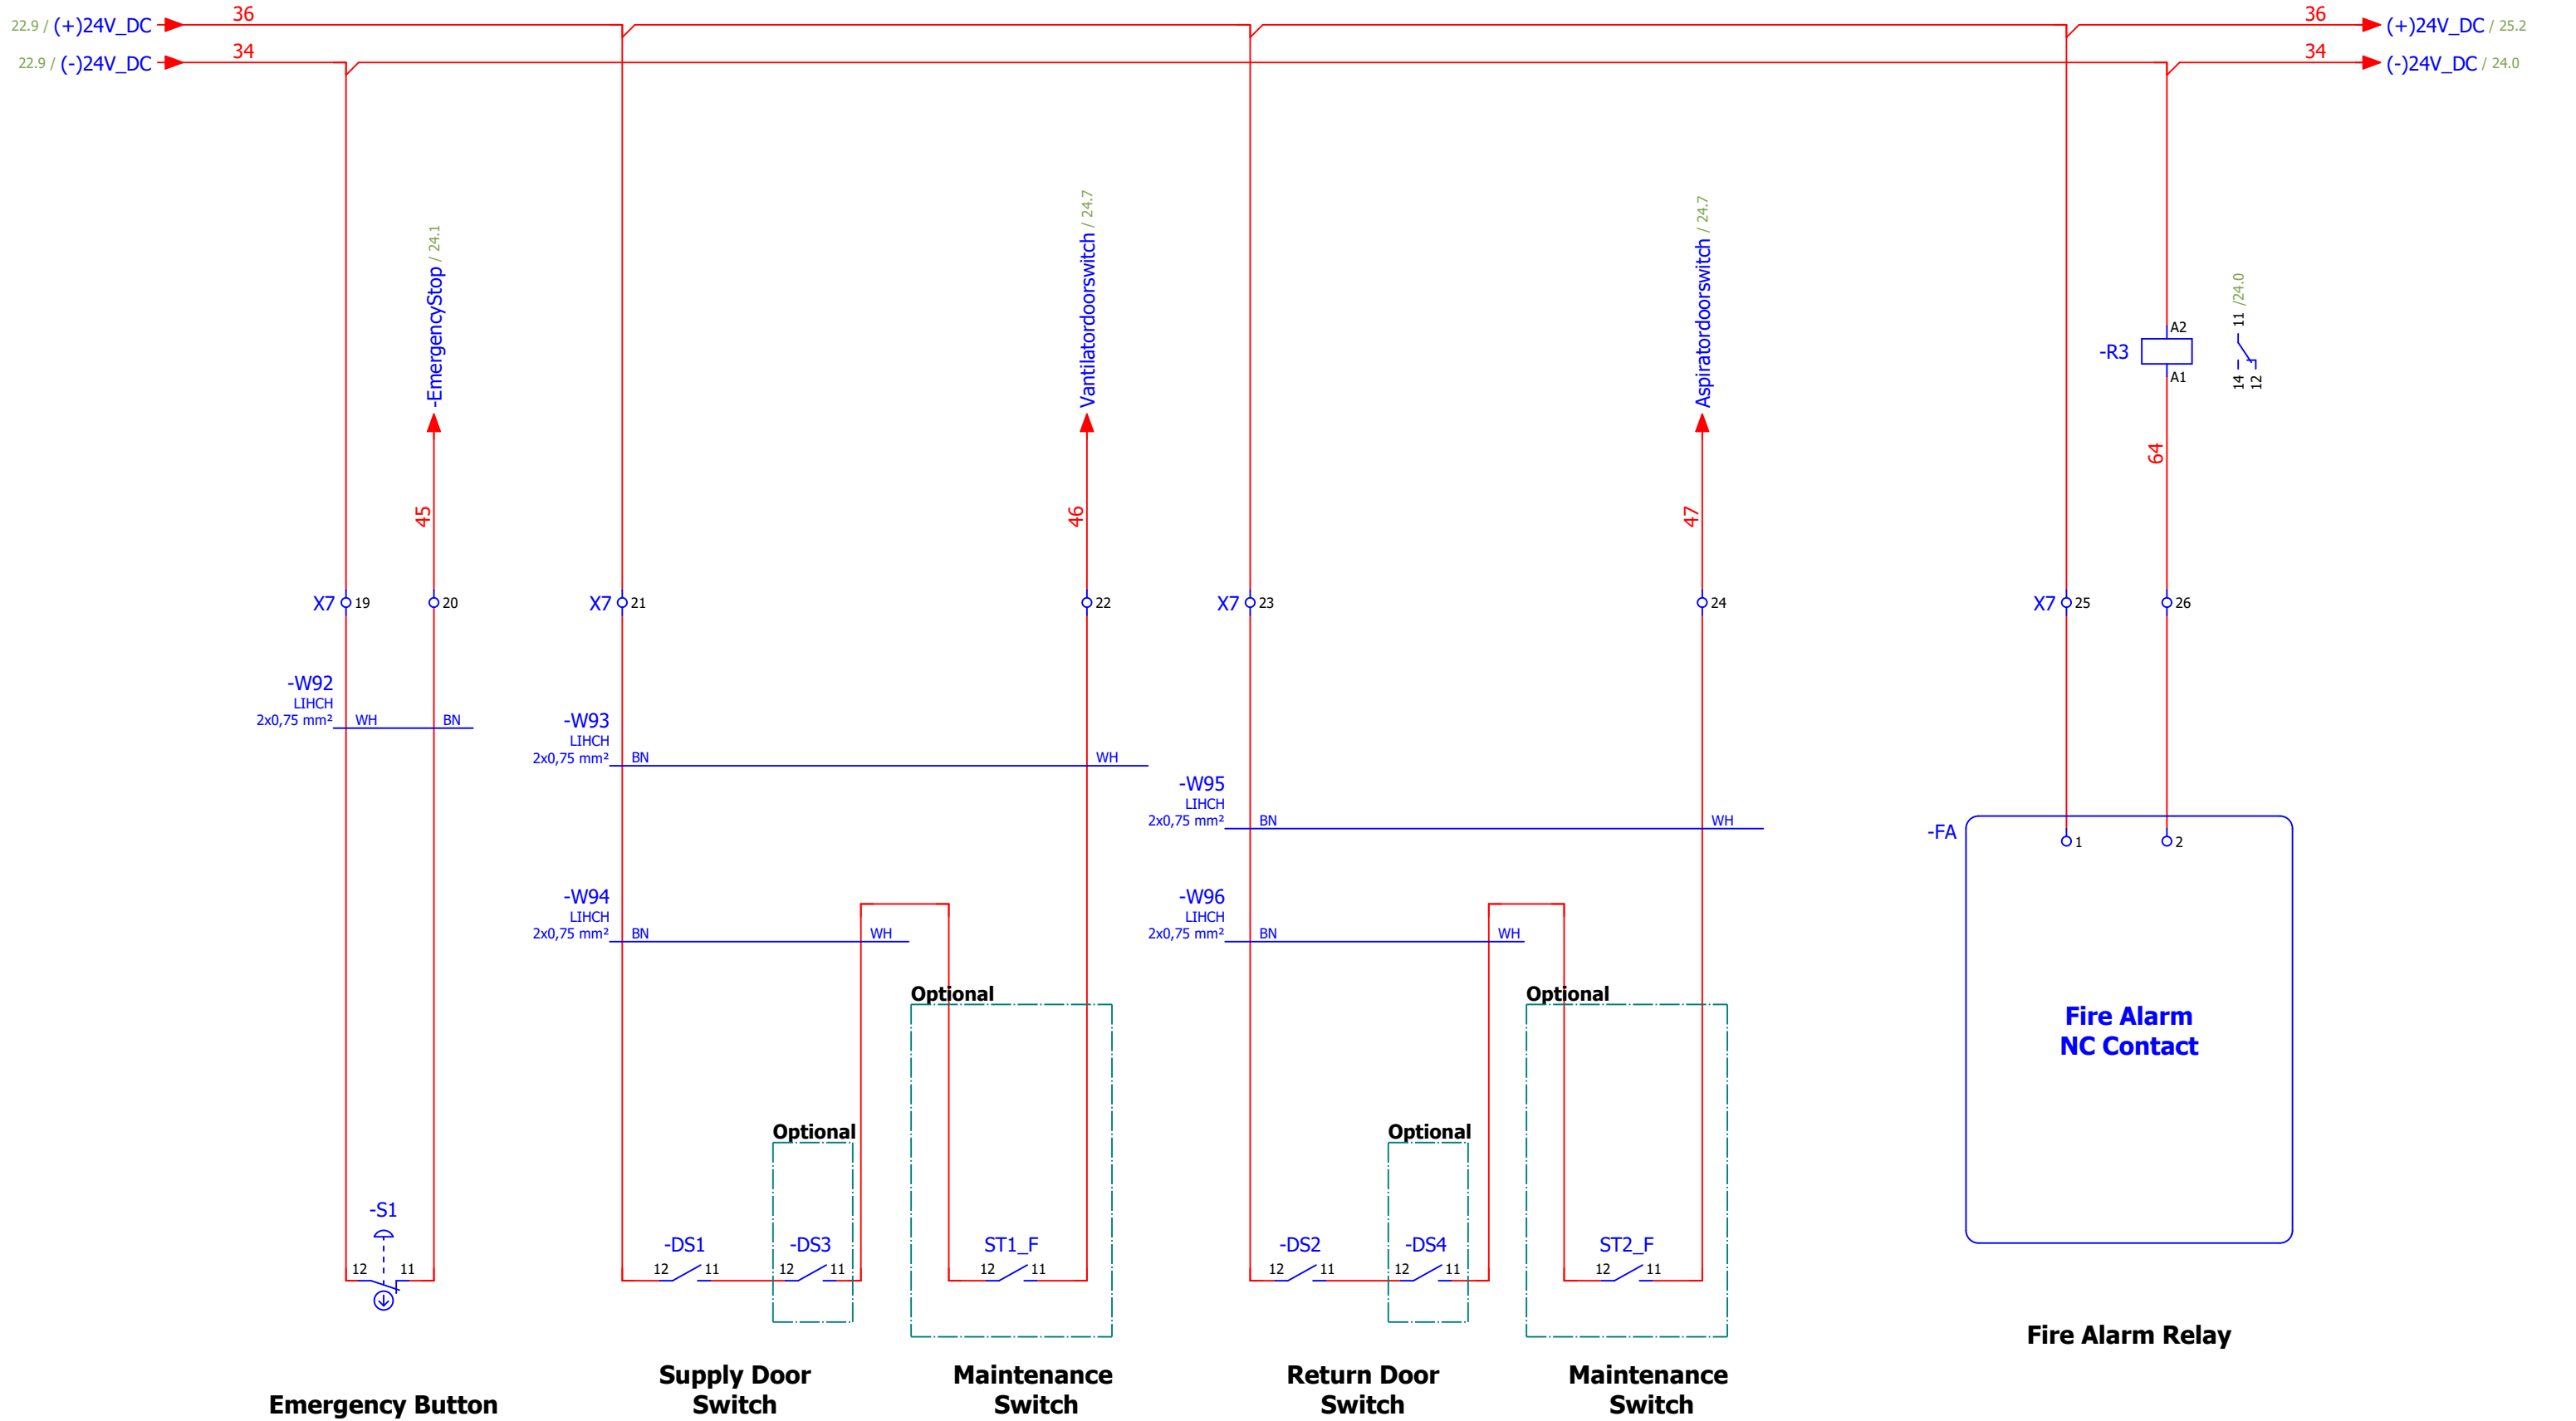

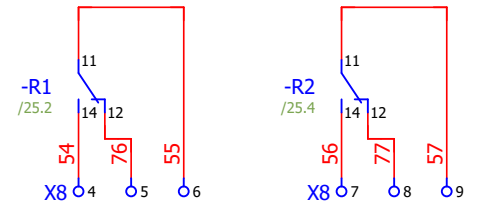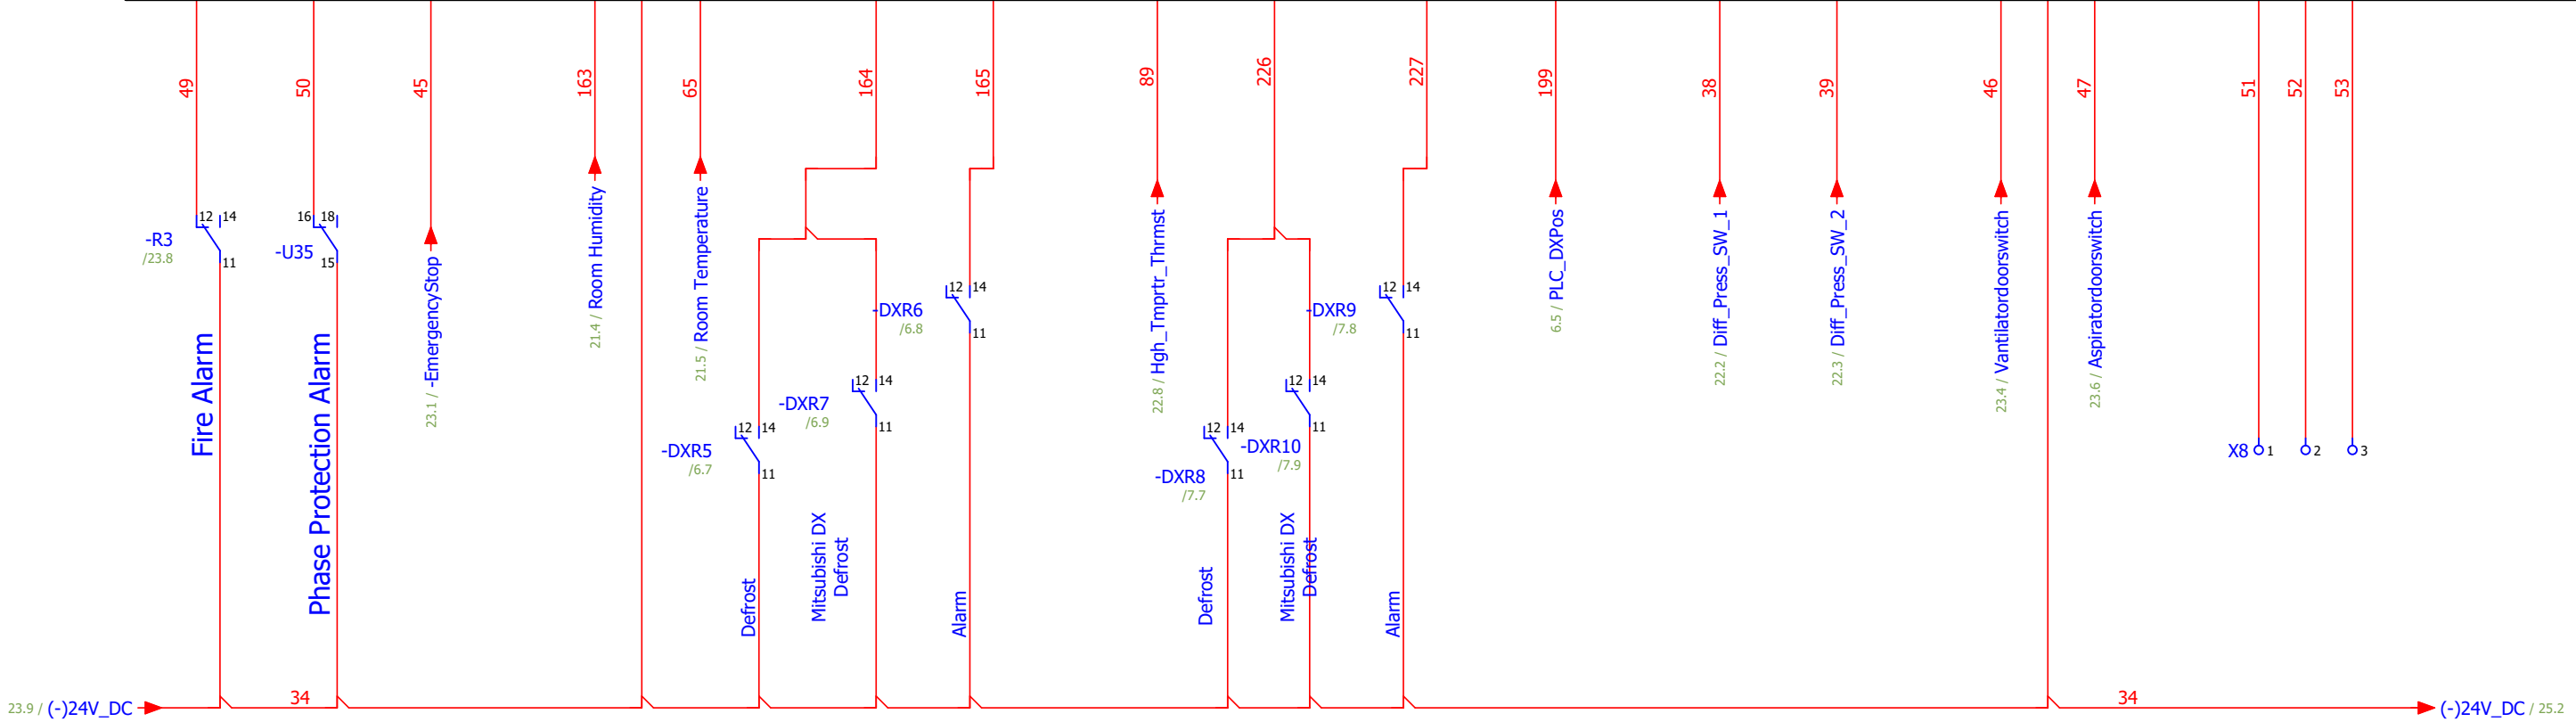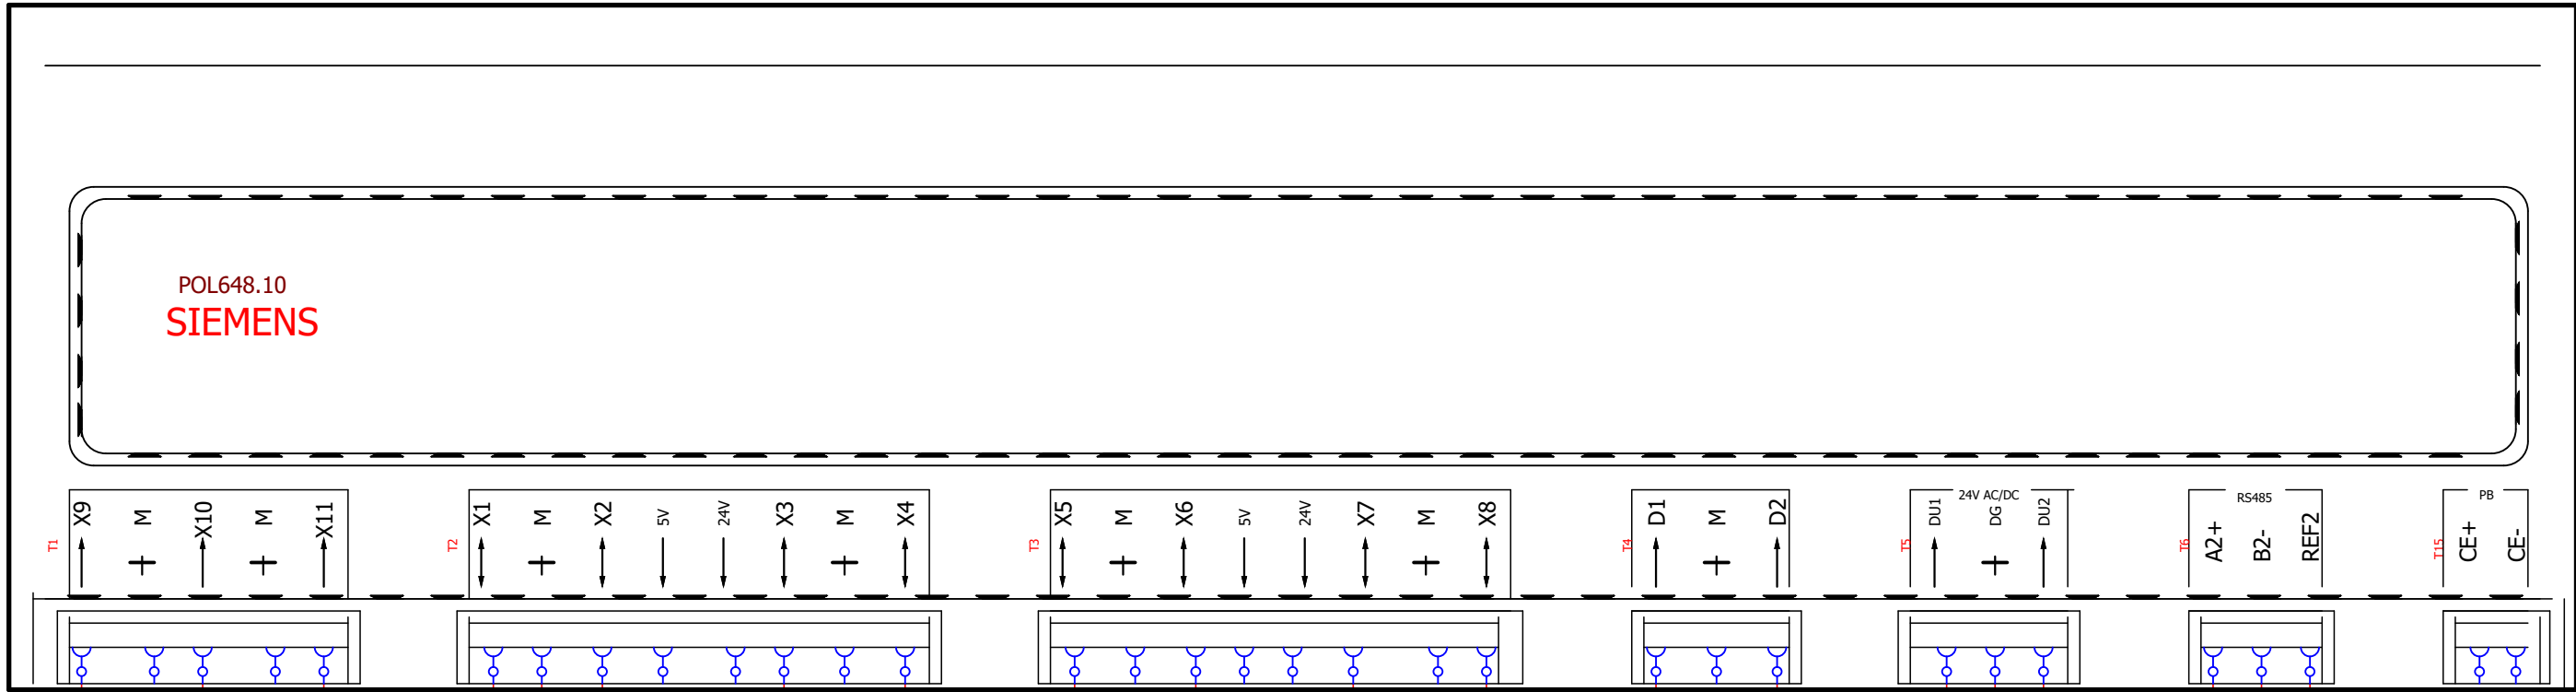

General Run General Alarm

POL648
SIEMENS

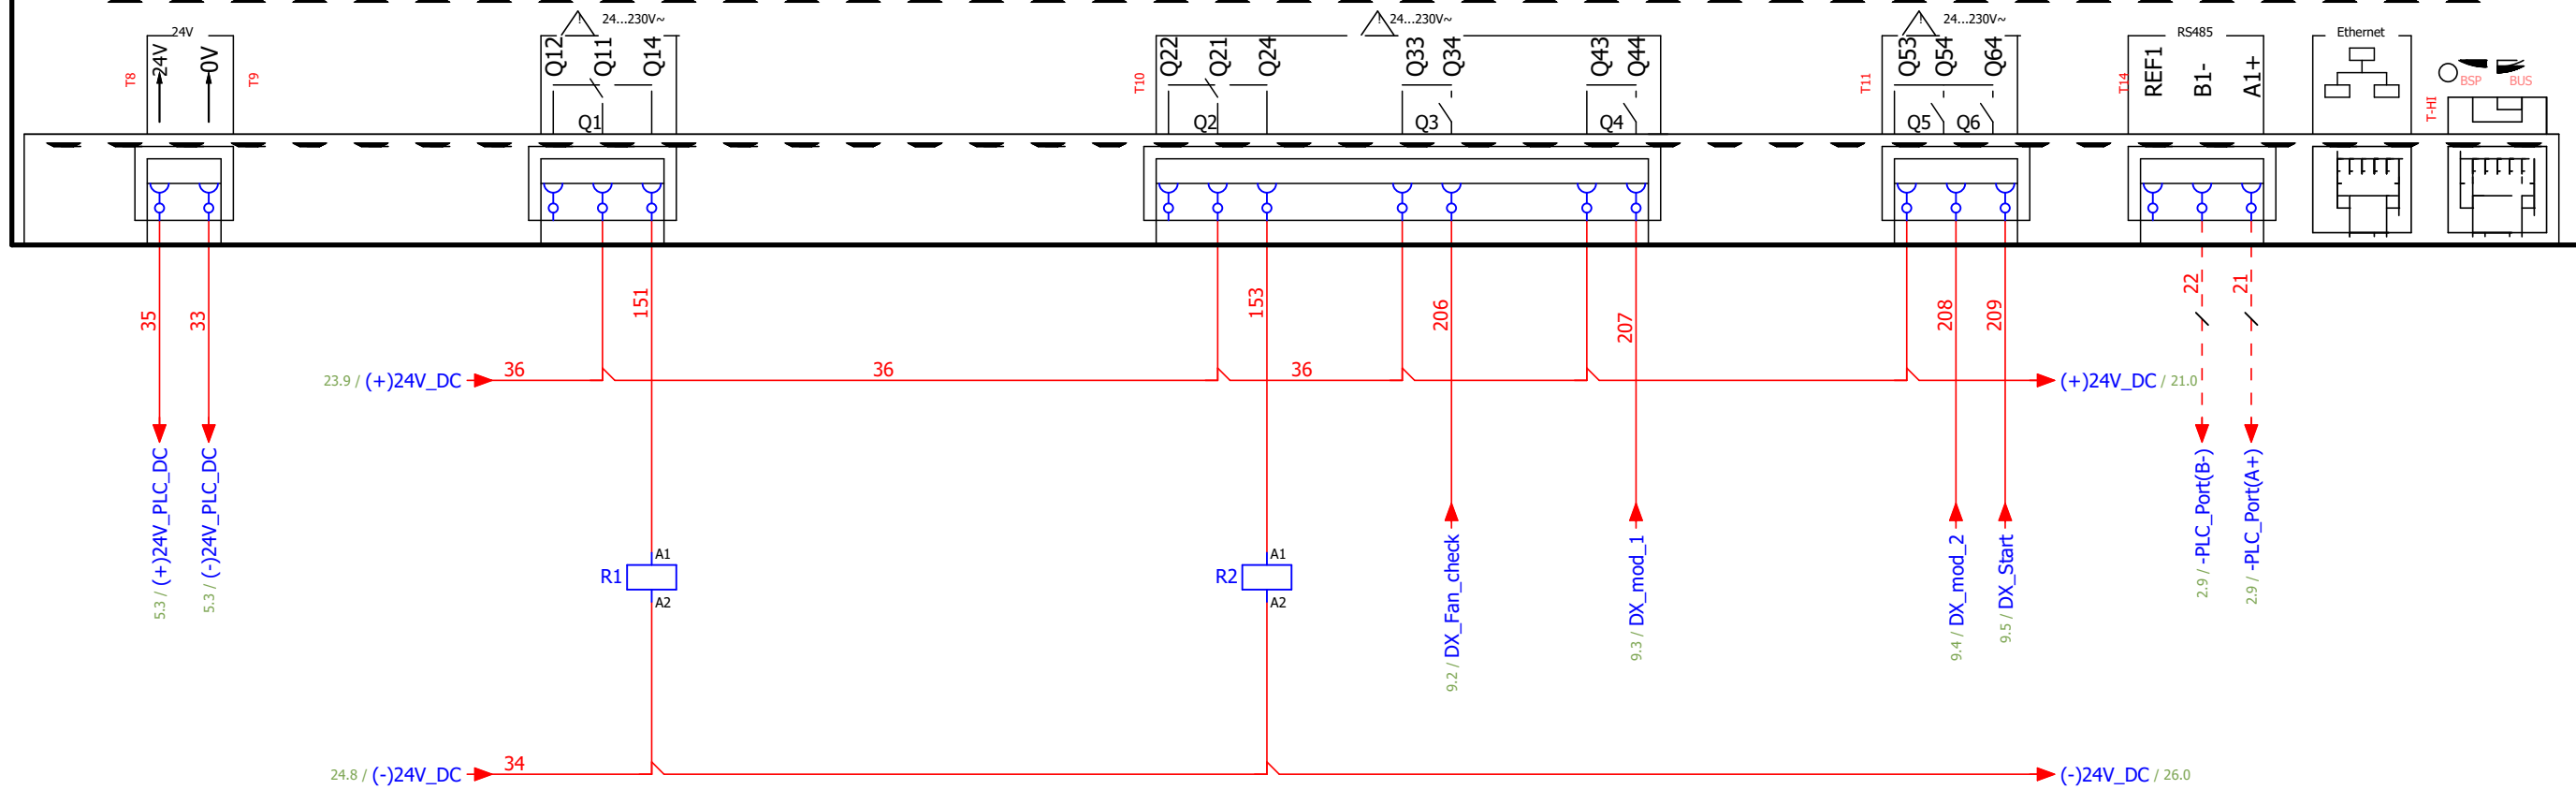


General Run


A2 — A1 /29.7
14 — 11 /24.8
12 — 11 /29.7

General Alarm


14 — 11 /24.9
12 — 11 /24.9

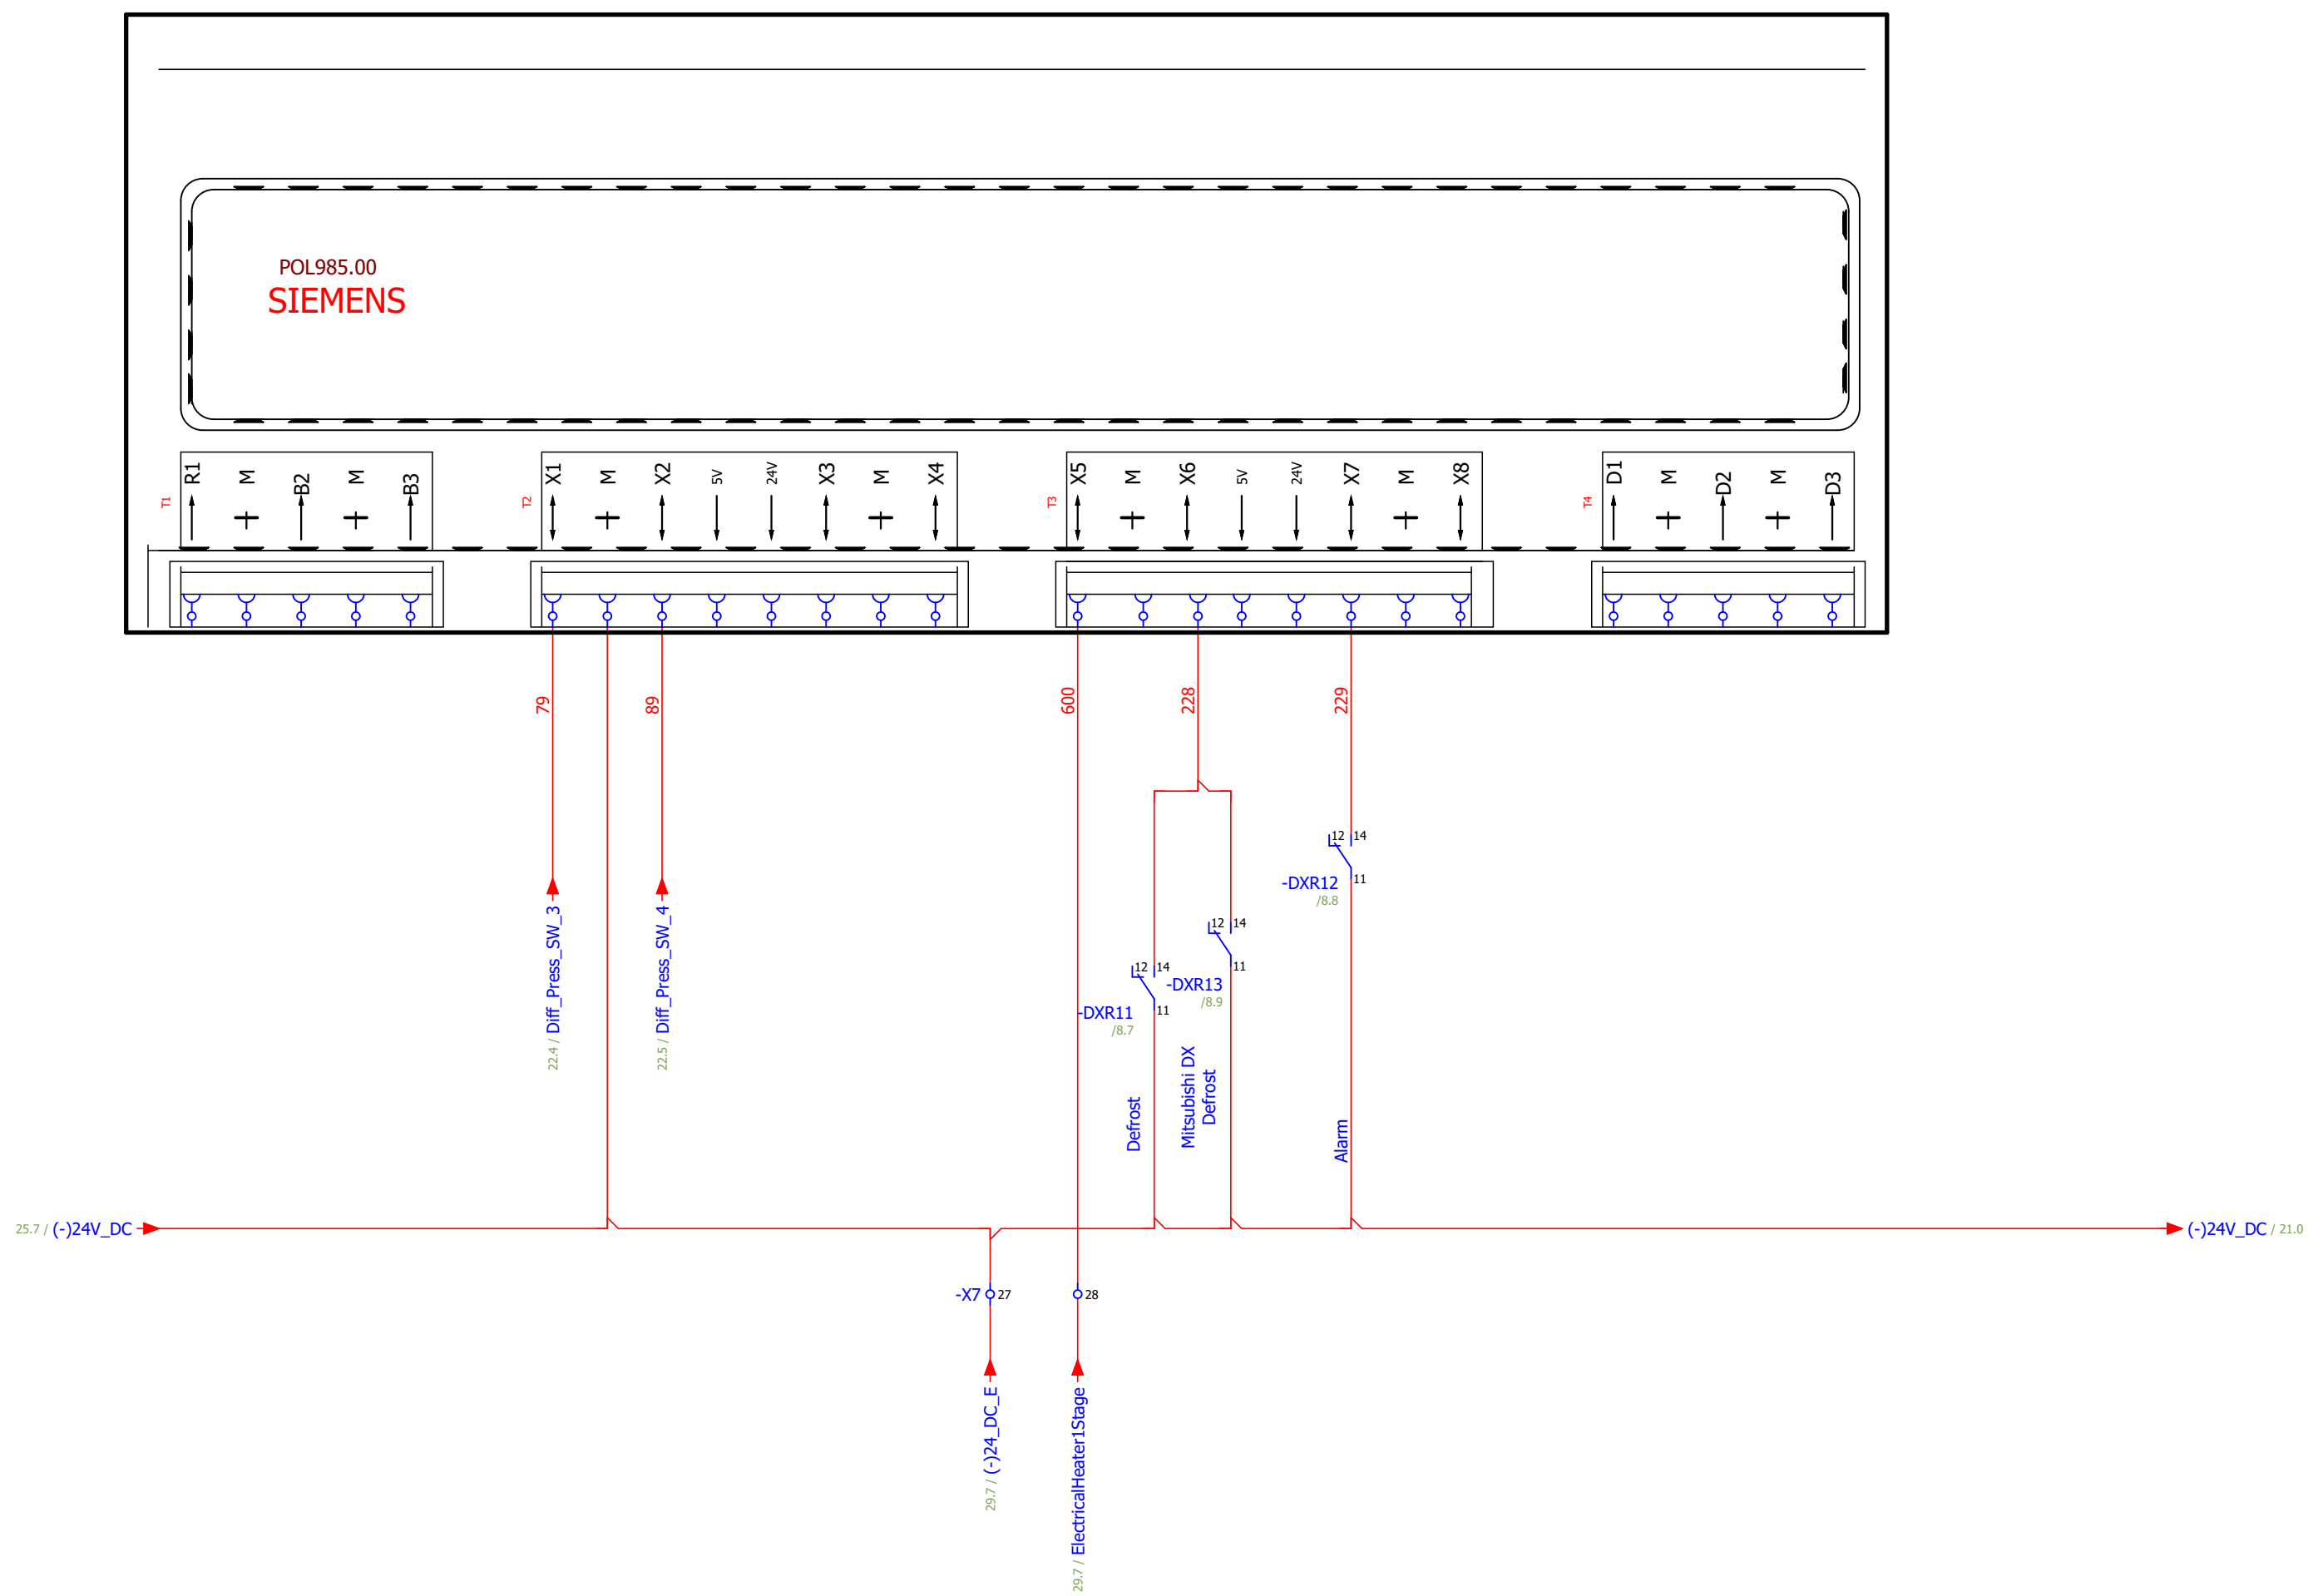

POL985.00
SIEMENS

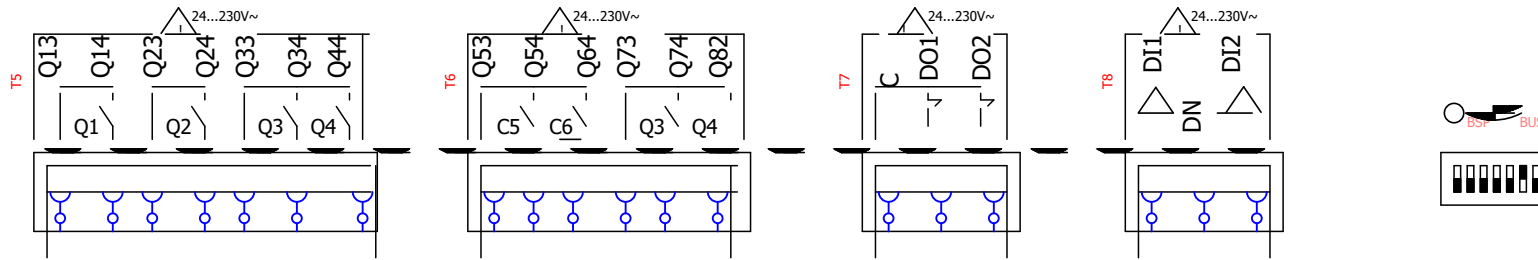



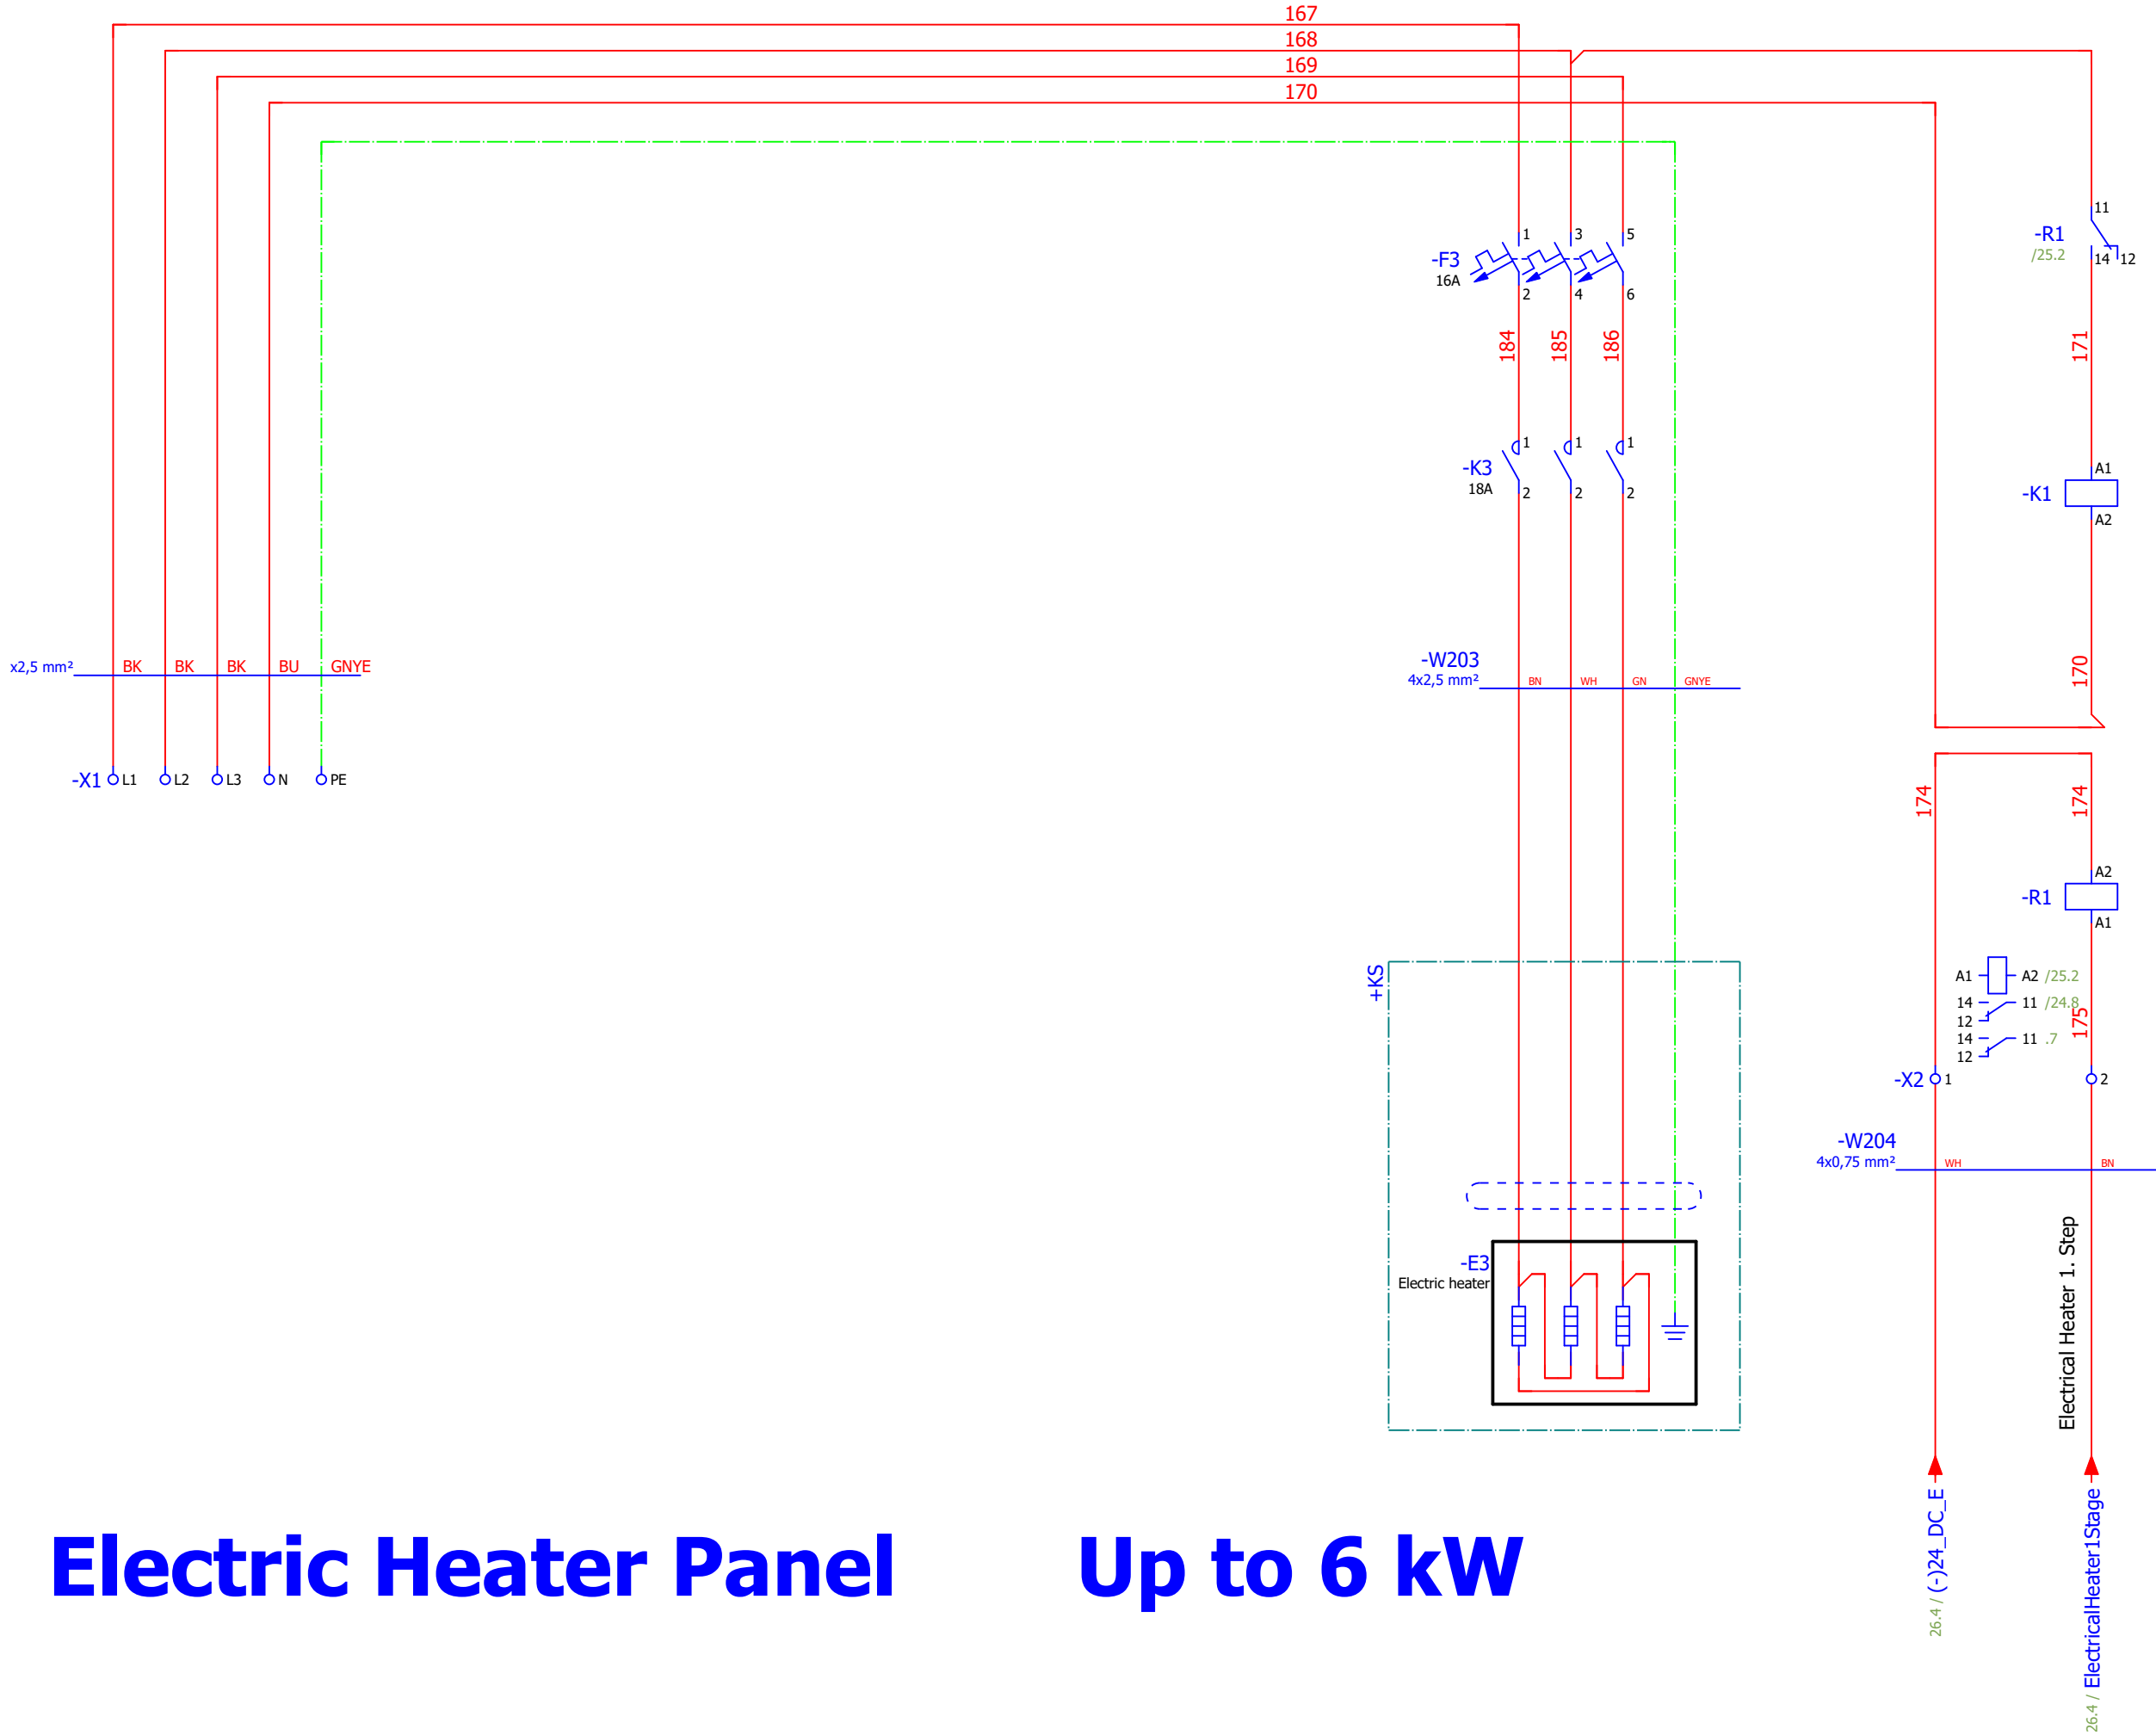

Electric Heater Panel Up to 6 kW