


Optimal Pipeline connection for industrial wastewater treatment in Maas en Waal area

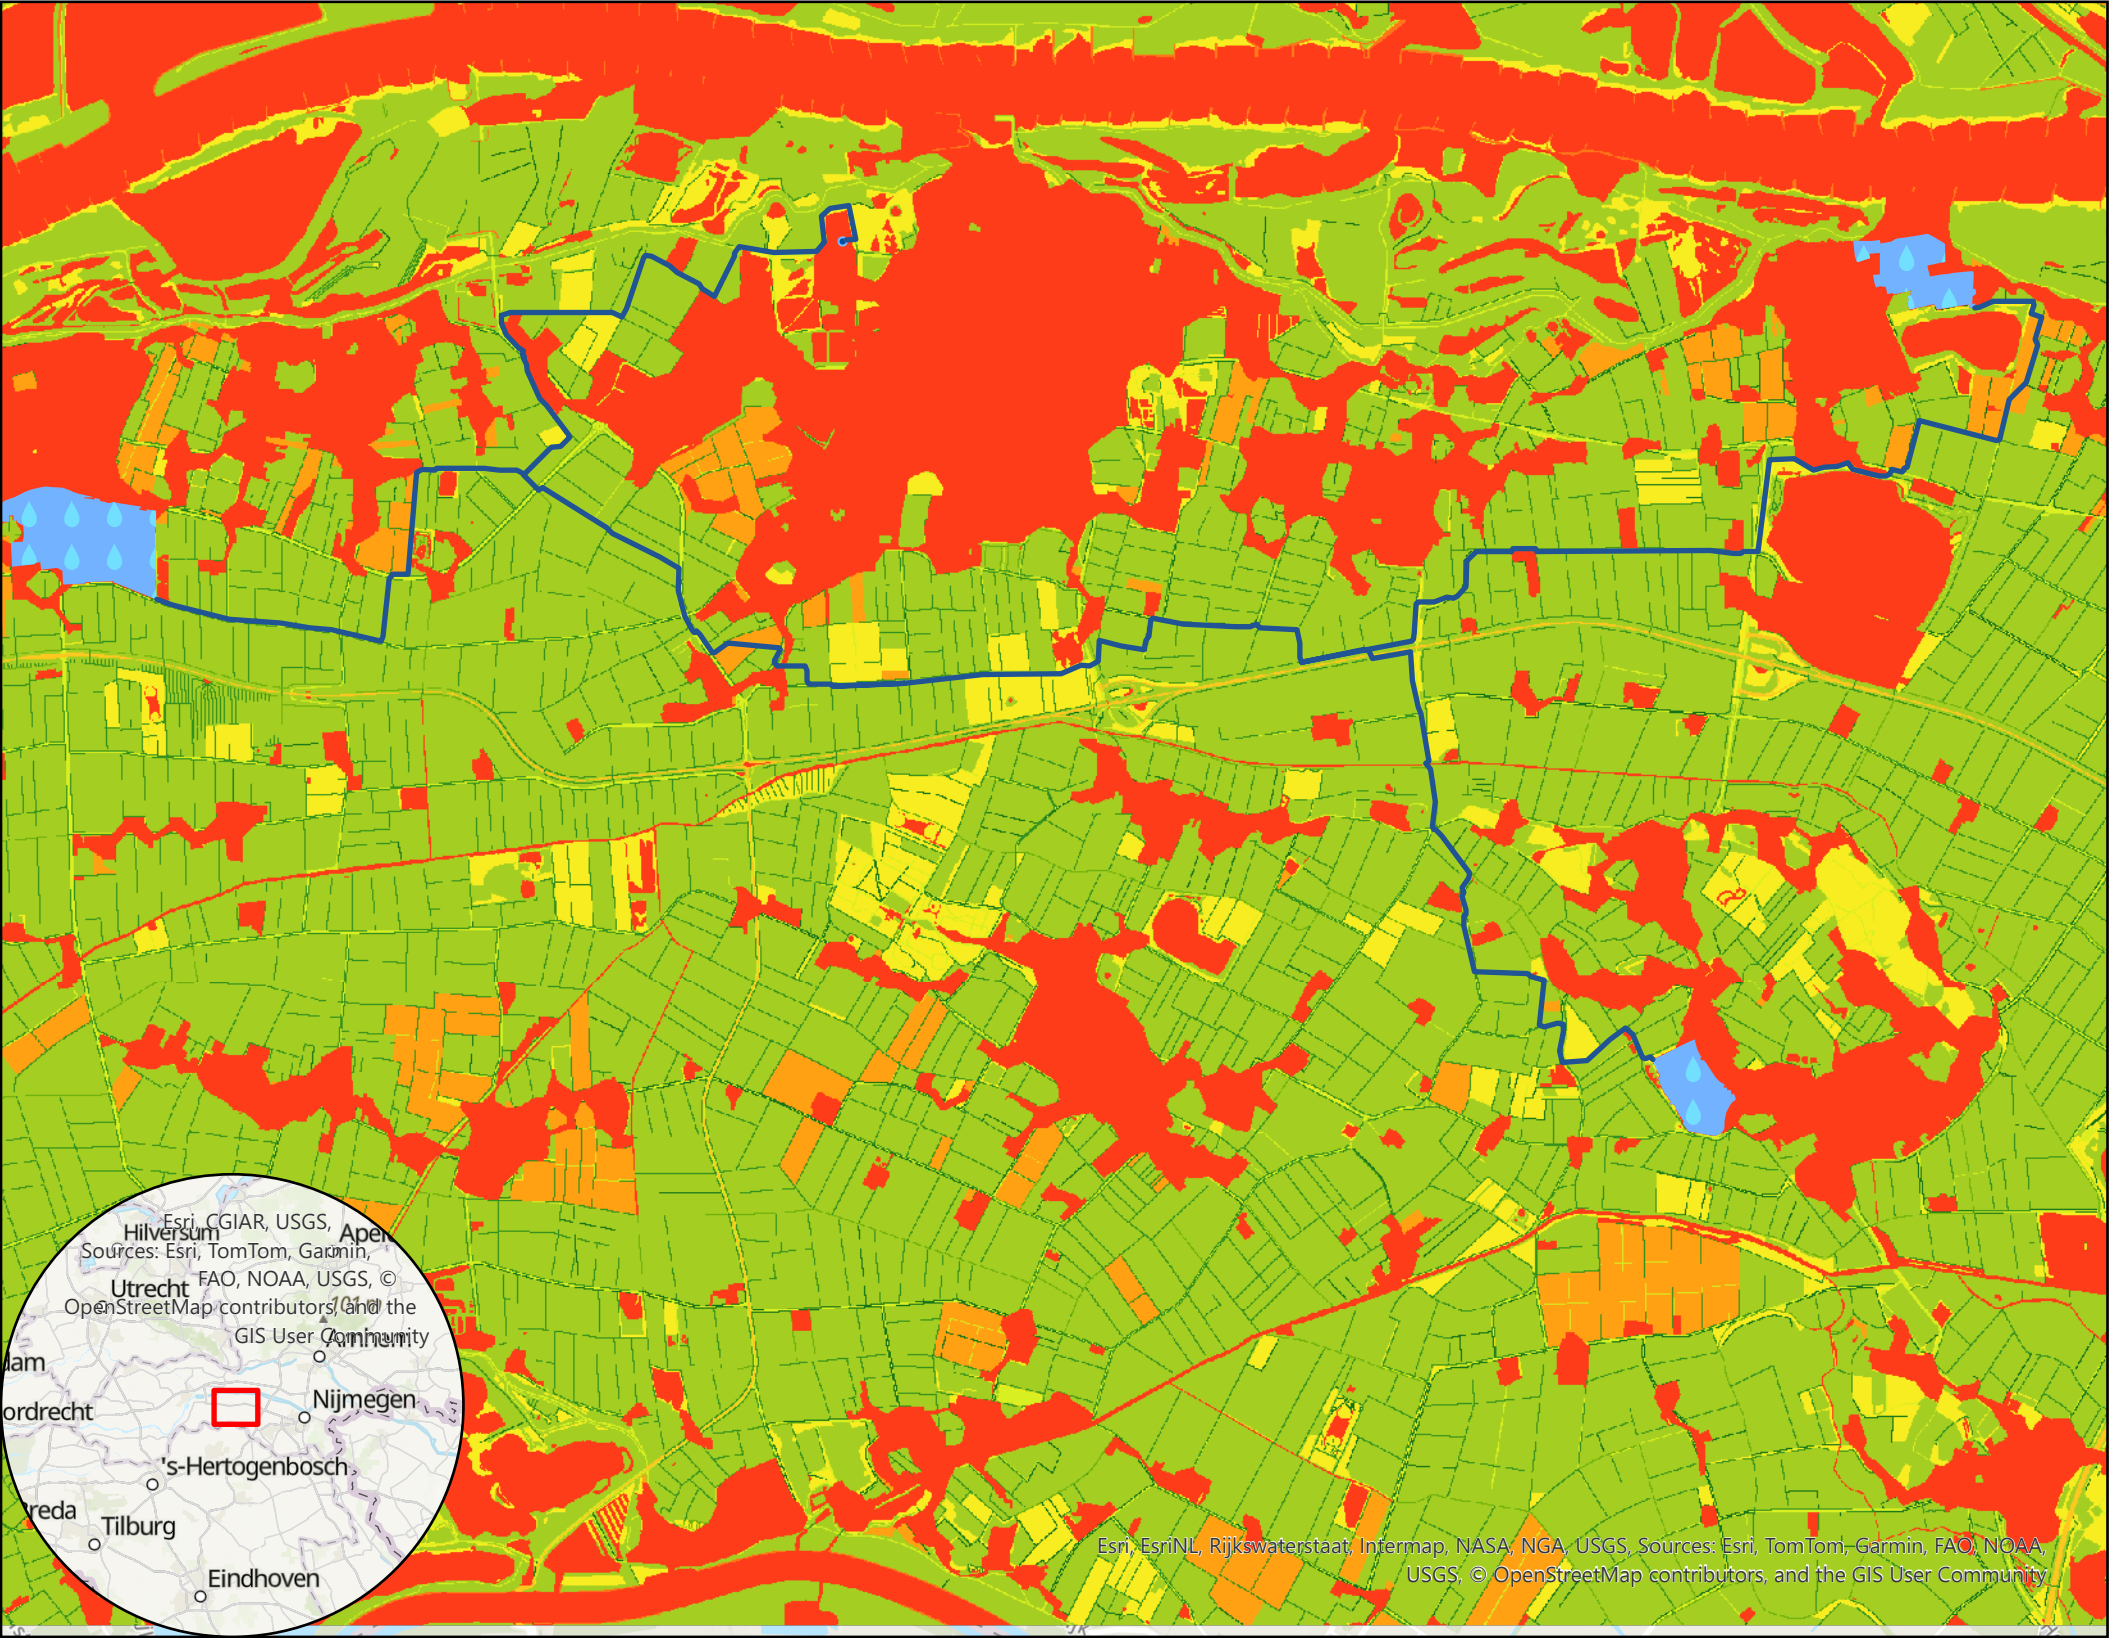

psb03FinalSuitabilit


Value

1
2
5
10
13
14
15
20
40
100

psd01WWNetworkMaas

psa00WasteWaterAreas

c02WTLargestBasin

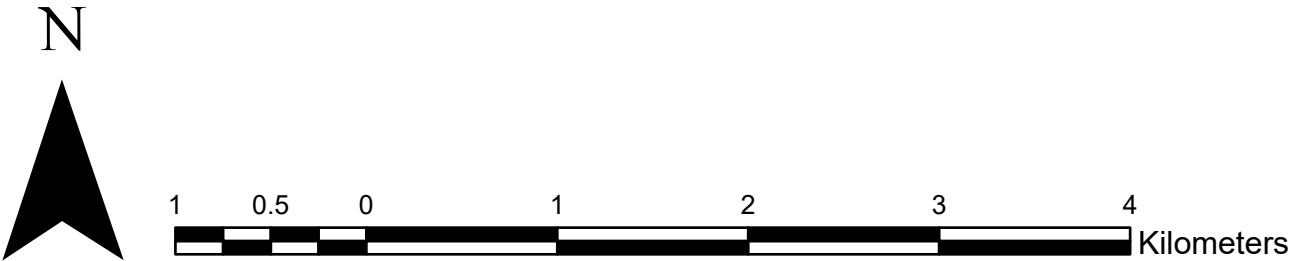

Group 20C
Dirk Emaus
Petra Izakova