


MOM 20241107 Compliance Confirmed

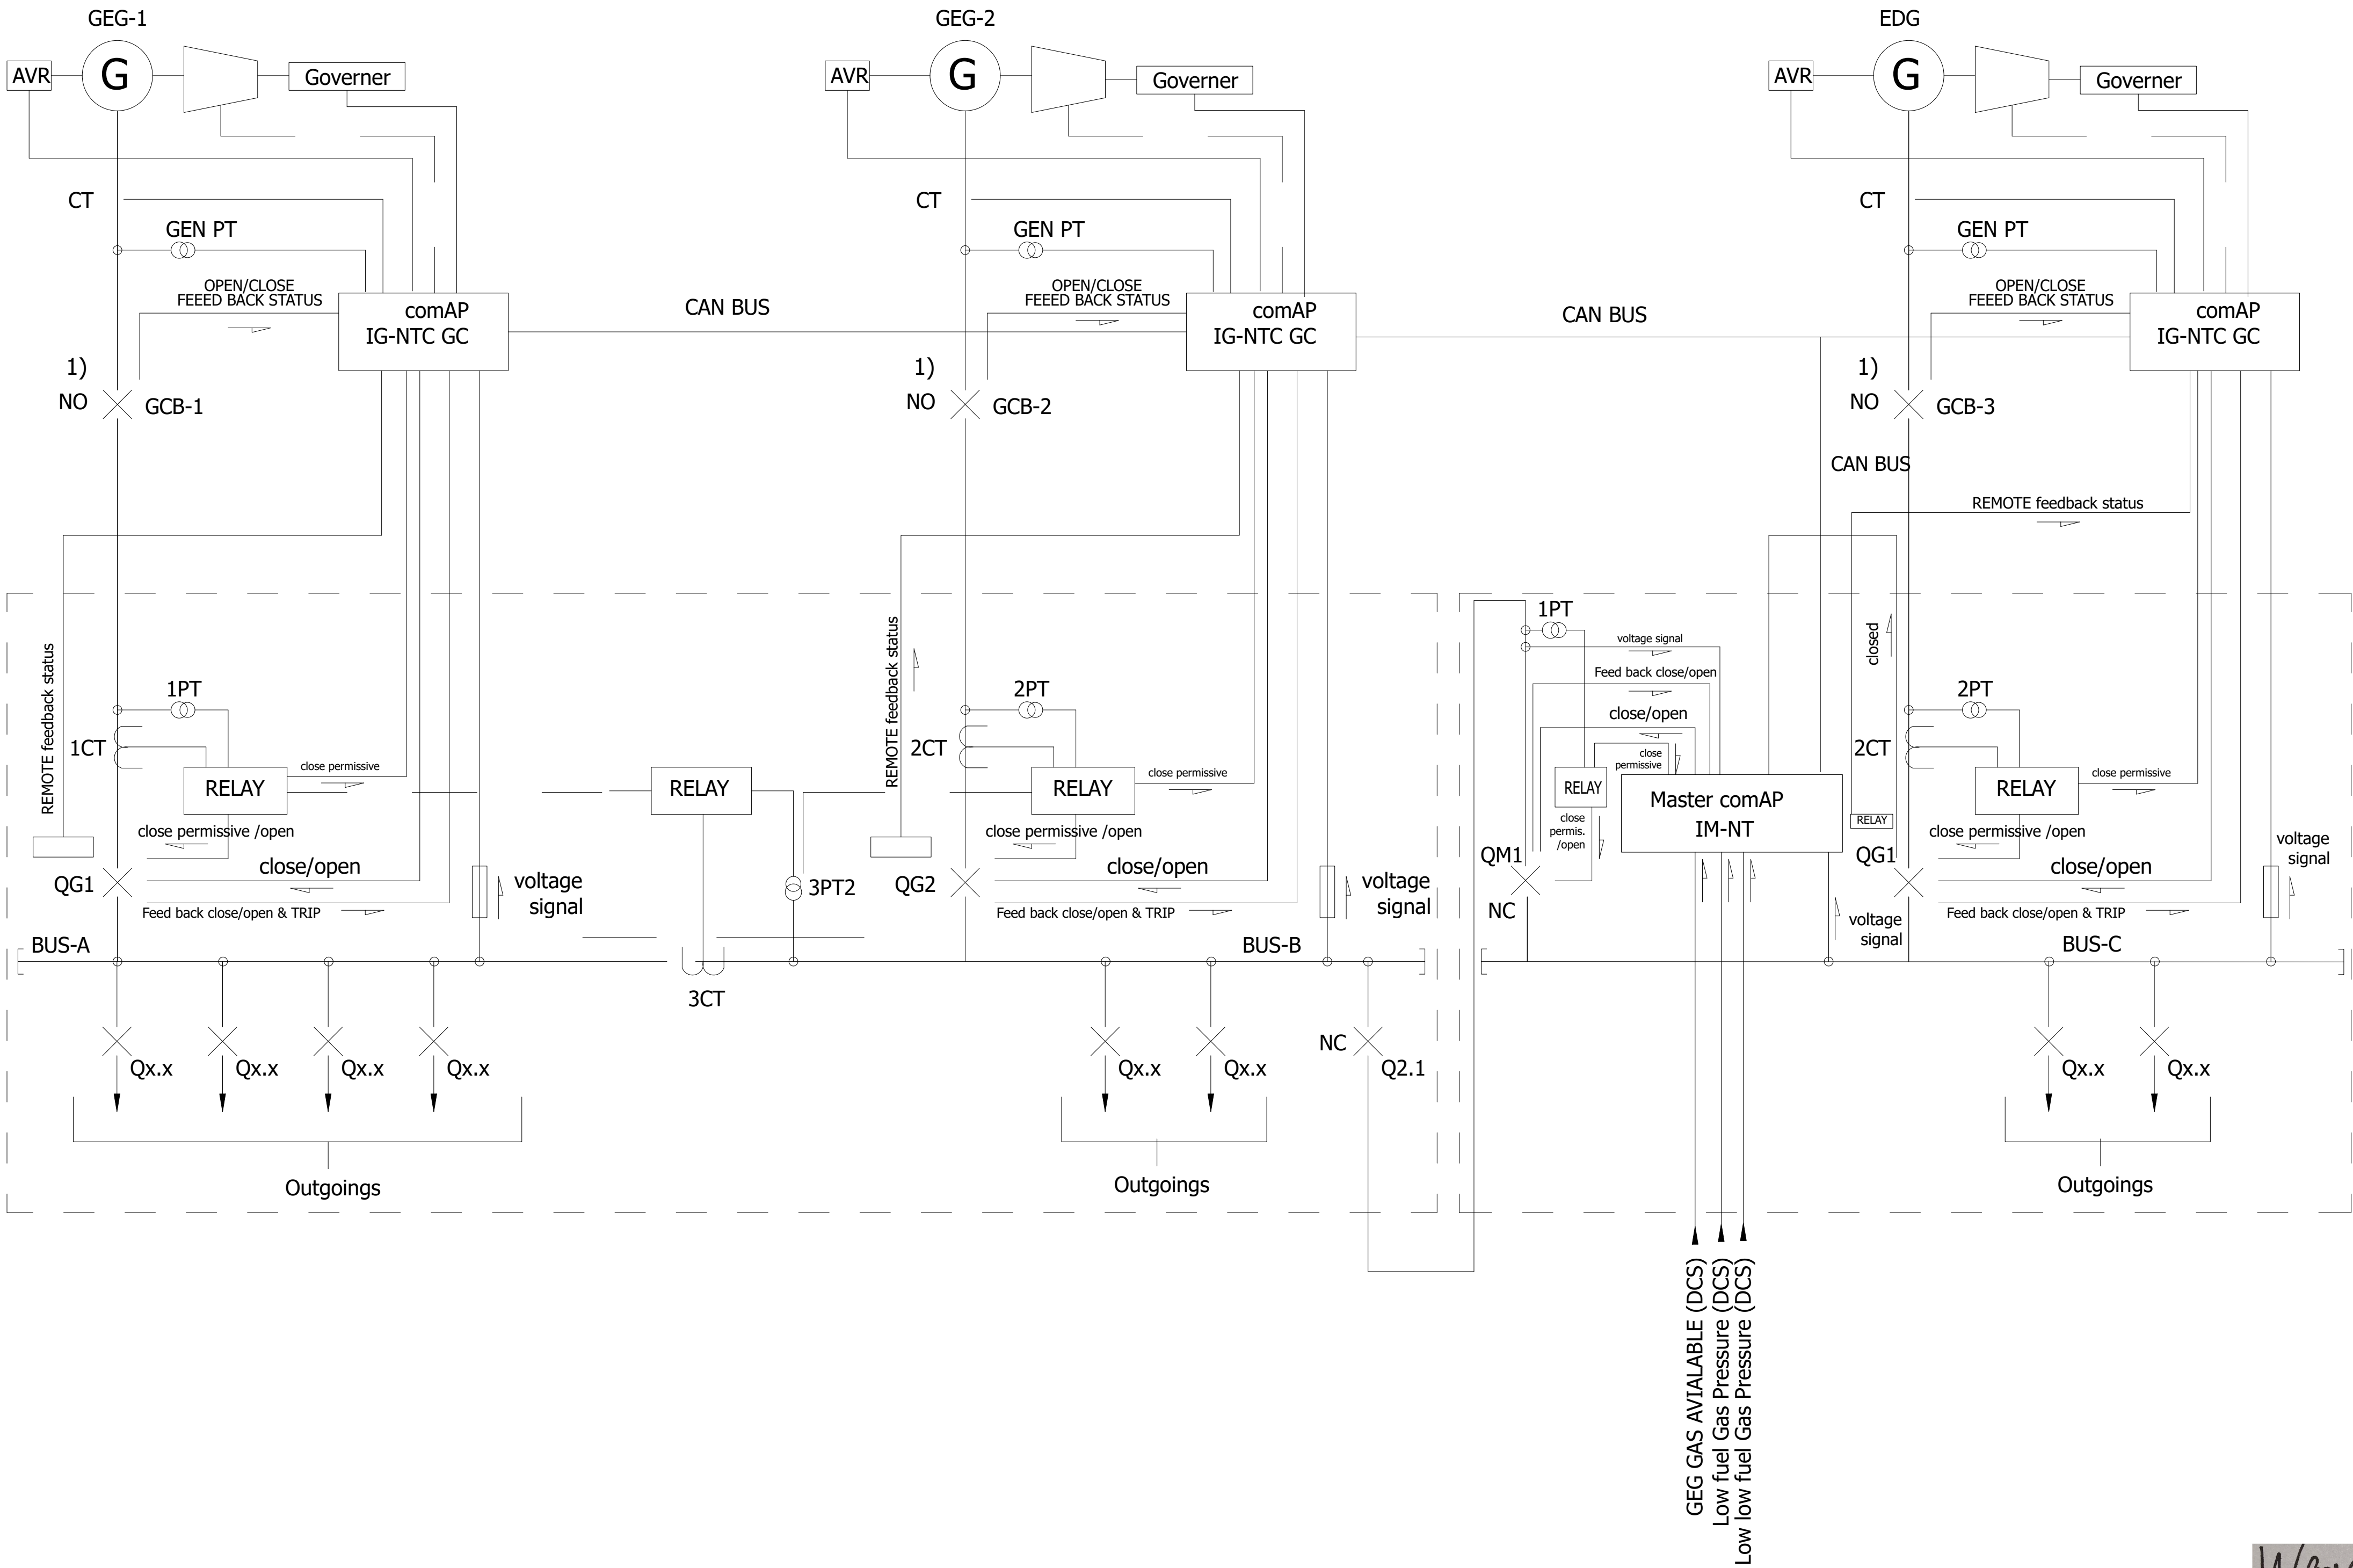

NOTES

- GCB-1,2,3 WILL BE CLOSED AS SOON AS THE CORRESPONDING GENSET ATTAINS THE REQUIRED VOLTAGE.IG-NTC SHALL CONTROL ASSOCIATED INC BREAKER IN SWITCHGEAR AFTER CHECKING ALL PARAMETERS INCLUDING SYNC OK.
- IG NTC ISSUE CLOSE COMMAND ONLY IF GCB IN GENSET IS ALREADY CLOSED.
- QBC AND Q2.1 SHALL REMAIN CLOSED NORMALLY.
- GEG-1 TRIP (GCP) & GEG-2 TRIP (GCP) INPUT SIGNALS TO IM-NT WILL BE SOFT THROUGH IG-NTC CONTROLLERS.
- LOCAL / REMOTE SELECTOR SWITCH FOR EACH ACB IN SWITCHGEAR SHALL BE IN REMOTE ALWAYS. IN REMOTE, ACB SHALL BE CONTROLLED BY COMAP CONTROLLER BOTH IN AUTO/MANUAL OPERATION.
- IF THE SWITCH IS IN LOCAL MODE, THEN ACB CAN BE OPERATED BY TNC. THIS IS ONLY IN A CASE IF COMMAND FROM COMAP CONTROLLER NEEDS TO BE BYPASSED DUE TO ANY EMERGENCY CONDITION.

HOLD

LEGEND

REFERENCE DRAWINGS

KEY PLAN

0	10-10-2024	ISSUED FOR INFORMATION	MD	JS	SR
REV	DATE	DESCRIPTION	DRAWN	CHKD	APPRD
SCALE:	DRAWN:	CHKD:	APPRD:		
NTS	MS	JS	SR		

أدنوك للغاز
ADNOC Gas



DBOOM CONTRACTOR:
TQ

EPC CONTRACTOR:
ASTRA
EXCELASTRA ENGINEERING & CONSTRUCTION LLC

PROJECT TITLE
DBOOM WORKS FOR RENTAL
COMPRESSION FACILITIES FOR
BUHASA PLANT (PROJECT 5.0)

DRAWING TITLE
SYNCHRONIZATION SCHEME

UNIT: 000	PLANT: BUHASA
CONTR. PROJ. No.: AP-044	CONT. DWG. No.: --
ADNOC GAS AGREEMENT No. 4700024157	
ADNOC GAS PROJ. No. -	ADNOC GAS DWG. No. -
	SHEET 1
	REV. 0