

KGW550DF-T LEGEND SHEET

xxx xxx xx LOCALLY MOUNTED		xxx xxx xx MOUNTED ON MAIN CONTROL PANEL ROOM		xxx xxx xx DISTRIBUTED CONTROL SYSTEM ITEMS NORMALLY NOT ACCESSIBLE TO THE OPERATOR	
	TEMPERATURE INDICATOR		SPEED INDICATOR		
	TEMPERATURE TRANSMITTER		TEMPORATURE ALARM HIGH		
	PRESSURE TRANSMITTER		TEMPORATURE ALARM HIGH HIGH		
	TEMPERATURE SWITCH		LEVEL ALARM LOW		
	PRESSURE GAUGE		LEVEL ALARM LOW LOW		
	VISUAL INDICATOR		LEVEL ALARM HIGH		
	DIFFERENTIAL PRESSURE GAUGE		LEVEL ALARM HIGH HIGH		
	DIFFERENTIAL PRESSURE INDICATOR		PRESSURE ALARM LOW		
	SPEED TRANSMITTER		PRESSURE ALARM LOW LOW		
	LEVEL SWITCH LOW		DIFFERENTIAL PRESSURE ALARM HIGH		
	LEVEL INDICATOR		VIBRATION ALARM HIGH		
	LEVEL TRANSMITTER		SPEED ALARM HIGH		
SYM.	DESCRIPTION	SYM.	DESCRIPTION		

	PRESSURE REDUCING VALVE		PRESSURE REGULATING VALVE
	BREATHER		BALL VALVE
	CHECK RELIFE VALVE		OIL SUMP
	OIL SUCTION PUMP		FLEXIBLE JOINT
	HAND PUMP		THERMOSTAT VALVE
	PRE-FUEL WATER FILTER		EXPANSION TANK
	FLEXIBLE JOINT		MANUAL VALVE
	TURBOCHARGER		HEAT EXCHANGER
	WATER PREHEATING		GEAR PUMP
	SILENCER		ELECTRICAL PUMP
	NO RETURN VALVE		ELECTRIC CONTROL VALVE
	FILTER		ENGINE DRIVEN PUMP
	FILTER SCREEN		
SYM.	DESCRIPTION	SYM.	DESCRIPTION

1、Pipeline description

—4~1/2"~150SS-FG—Fuel gas pipeline — 2~1/2"~150CS-CL—Coolant water pipeline
—4"~150CS-LO—lubrication oil pipeline —3"~16HS01-CL—Coolant water pipeline
—10"~150CS-CL—Coolant water pipeline —————Exhaust and water supply pipeline
— 8"~150CS-EX—Exhaust emission pipeline —————Boundary line

2、Primary component symbol

Single sensing probe Porous orifice plate Standard pitot tube Thermal mass flow meter
 Temperature sensor Temperature sensor Combustible Gas Alarm Sound and light alarm
 Manual switch controller

3、Valve actuator symbols

Spring diaphragm actuator electric actuator Pressure reducing regulating valve (internal pressure tapping)
 Spring diaphragm actuator with locator Electromagnetic actuator Pressure reducing regulating valve (external pressure tapping)
 Pressure balanced diaphragm actuator Manual actuator Valve opens when energy is interrupted


4、Symbols for solenoid valves

Two way solenoid valve

5、Symbols for instrument and process connection

.....Instrument and process connection line General types of instrument and process connection

Pipeline number description

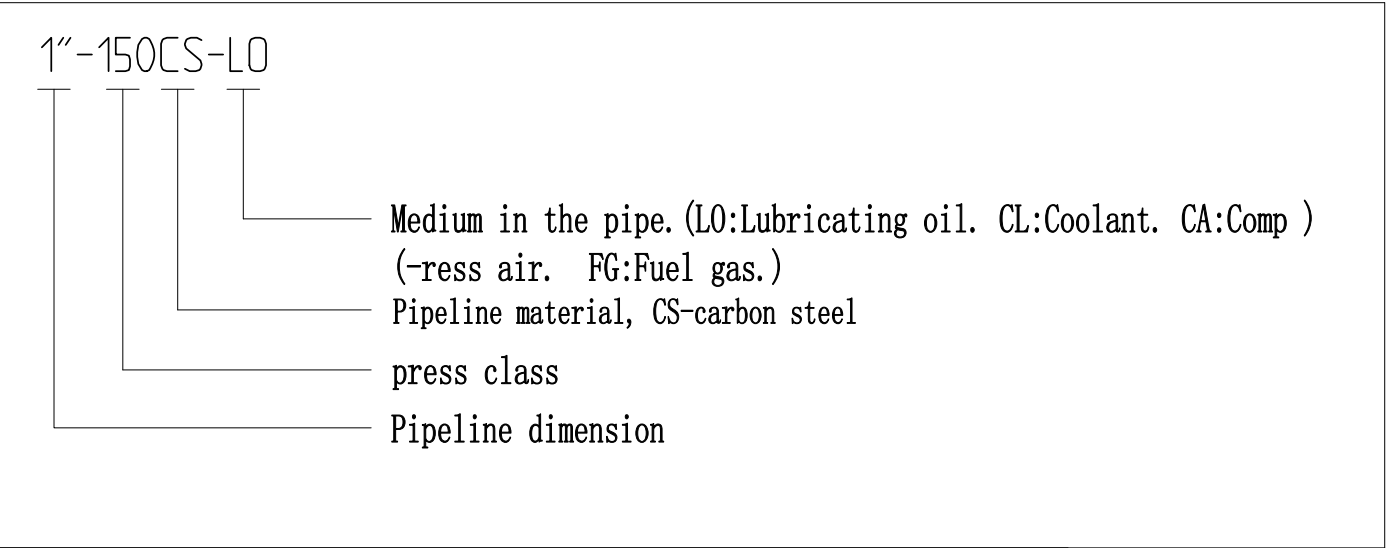

Wanglei


ITEM	DRAWING No.	DESCRIPTION	QTY	MATERIAL	UNIT	TOTAL	REMARK
					MASS	MASS	
DRN		ISS					
REW							
CHK							
CAPP		APP					
KGW550GF-T & Enclosures LEGEND SHEET						MASS	SCALE
							1:40
					/	DATE	10/26/24
					KERUI 山东科瑞油气装备有限公司 KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co.,Ltd.		

KGW550GF-T COOLING SYSTEM

PZ-01
EXPANSION TANK
HT VLOUE:50L
LT VLOUE:30L
WORKING TEMP:0℃ TO +110 ℃
MEDIUM: COOLANT

R-01
RADIATOR
WORKING TEMP:0℃ TO +110 ℃
MEDIUM: COOLANT
MAXLENVIRONMENT TEMPERATURE:55℃
INLET INTERCOOLING TEMPERATURE:60℃
OUTLET INTERCOOLING EMPERATURE:66.7℃
INLET CYLINDER TEMPERATURE:73.8℃
OUTLET CYLINDER TEMPERATURE:82℃

SYSTEM COMPONENTS
HA-01~08 BALL VALVE
FJ-01~08 FLEXIBLE CONNECTIO
PZ-01 EXPANSION TANK
R-01 RADIATOR
GL-01~02 FILTER

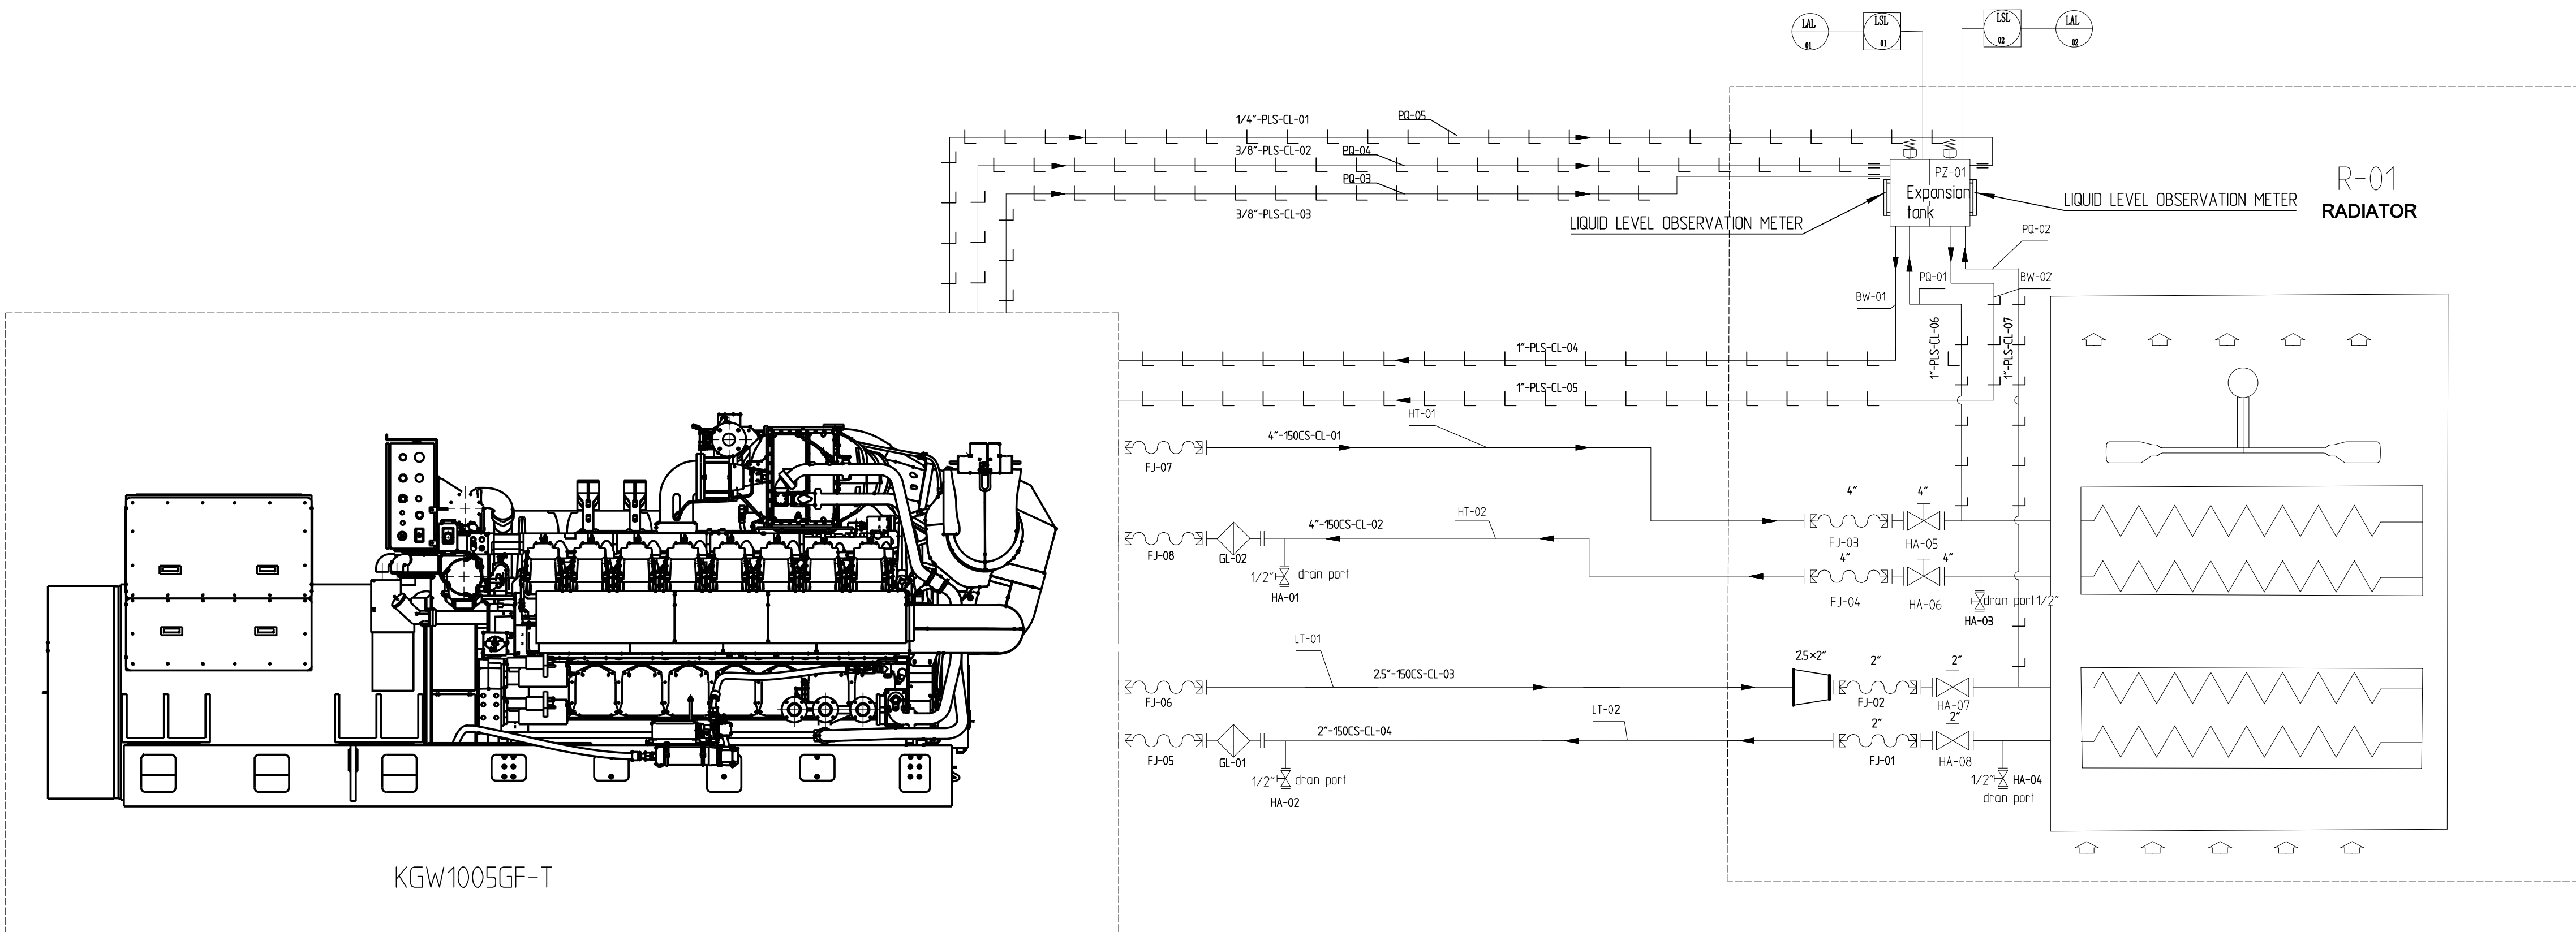

HT-01: HT OUTLET PIPE 4"
HT-02: HT RETURN PIPE 4"
LT-01: LT OUTLET PIPE 25"
LT-02: LT RETURN PIPE 2"
BW-01: HT WATER REFILL PIPE 1"
BW-02: LT WATER REFILL PIPE 1"
PQ-01: HT PIPE GAS EXHAUST PIPE 1"
PQ-02: LT PIPE GAS EXHAUST PIPE 1"
PQ-03~04: COOLANT AIR BLEED VENT PIPE 3/8"
PQ-05: AUXILIARY WATER AIR BLEED CONNECTION PIPE 1/4"

Wangler

ITEM	DRAWING No.	DESCRIPTION	QTY	MATERIAL	UNIT	TOTAL	REMARK
					MASS	MASS	
		KGW550GF-T & Enclosures COOLING SYSTEM					
						MASS	SCALE
DRN			ISS				1:40
REW						DATE	10/26/24
CHK							
CAPP		APP					

KERUI 山东科瑞油气装备有限公司
KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co., Ltd.

KGW550GF-T FUEL SYSTEM

GL-01~02


FILTER
FLOW RATE:0~700Nm³/h
INLET PRESSURE:0~7Bar
WORKING TEMPERATURE:+18 °C TO +65 °C
FILTER FINENESS:< 50µM STAINLESS STEEL CARTRIDGE
In normal operation, the valve HA-01G/HA-02G before and after GL-01 is closed, and the gas is filtered through GL-02 into the genset. When the pressure difference shown by the pressure differential meter of GL-02 is twice the pressure difference during initial operation, it indicates that the filter element needs to be replaced. At this time, the valve HA-01G/HA-02G is opened and the GL-01 is run. Then close the valve HA-03G/HA-04G before and after the GL-02, replace the filter element of the GL-02, and cycle.

PRV-02

PRESSURE REDUCING VALVE
NLET PRESSURE:7Bar
EXPORT PRESSURE :0.2-0.4Bar
FLOW RATE:200m³/h
TEMPERATURE:-15°C~+70°C CENTIGRADE
CONNECTION JOINT THREAD SIZE :2"NPT

SYSTEM COMPONENTS

HA-01~05G	BALL VALVE
GL-01~02	FILTER
FJ-01G	FLEXIBLE CONNECTION
EQD-01~02	ELECTROMAGNETIC SHUT-OFF

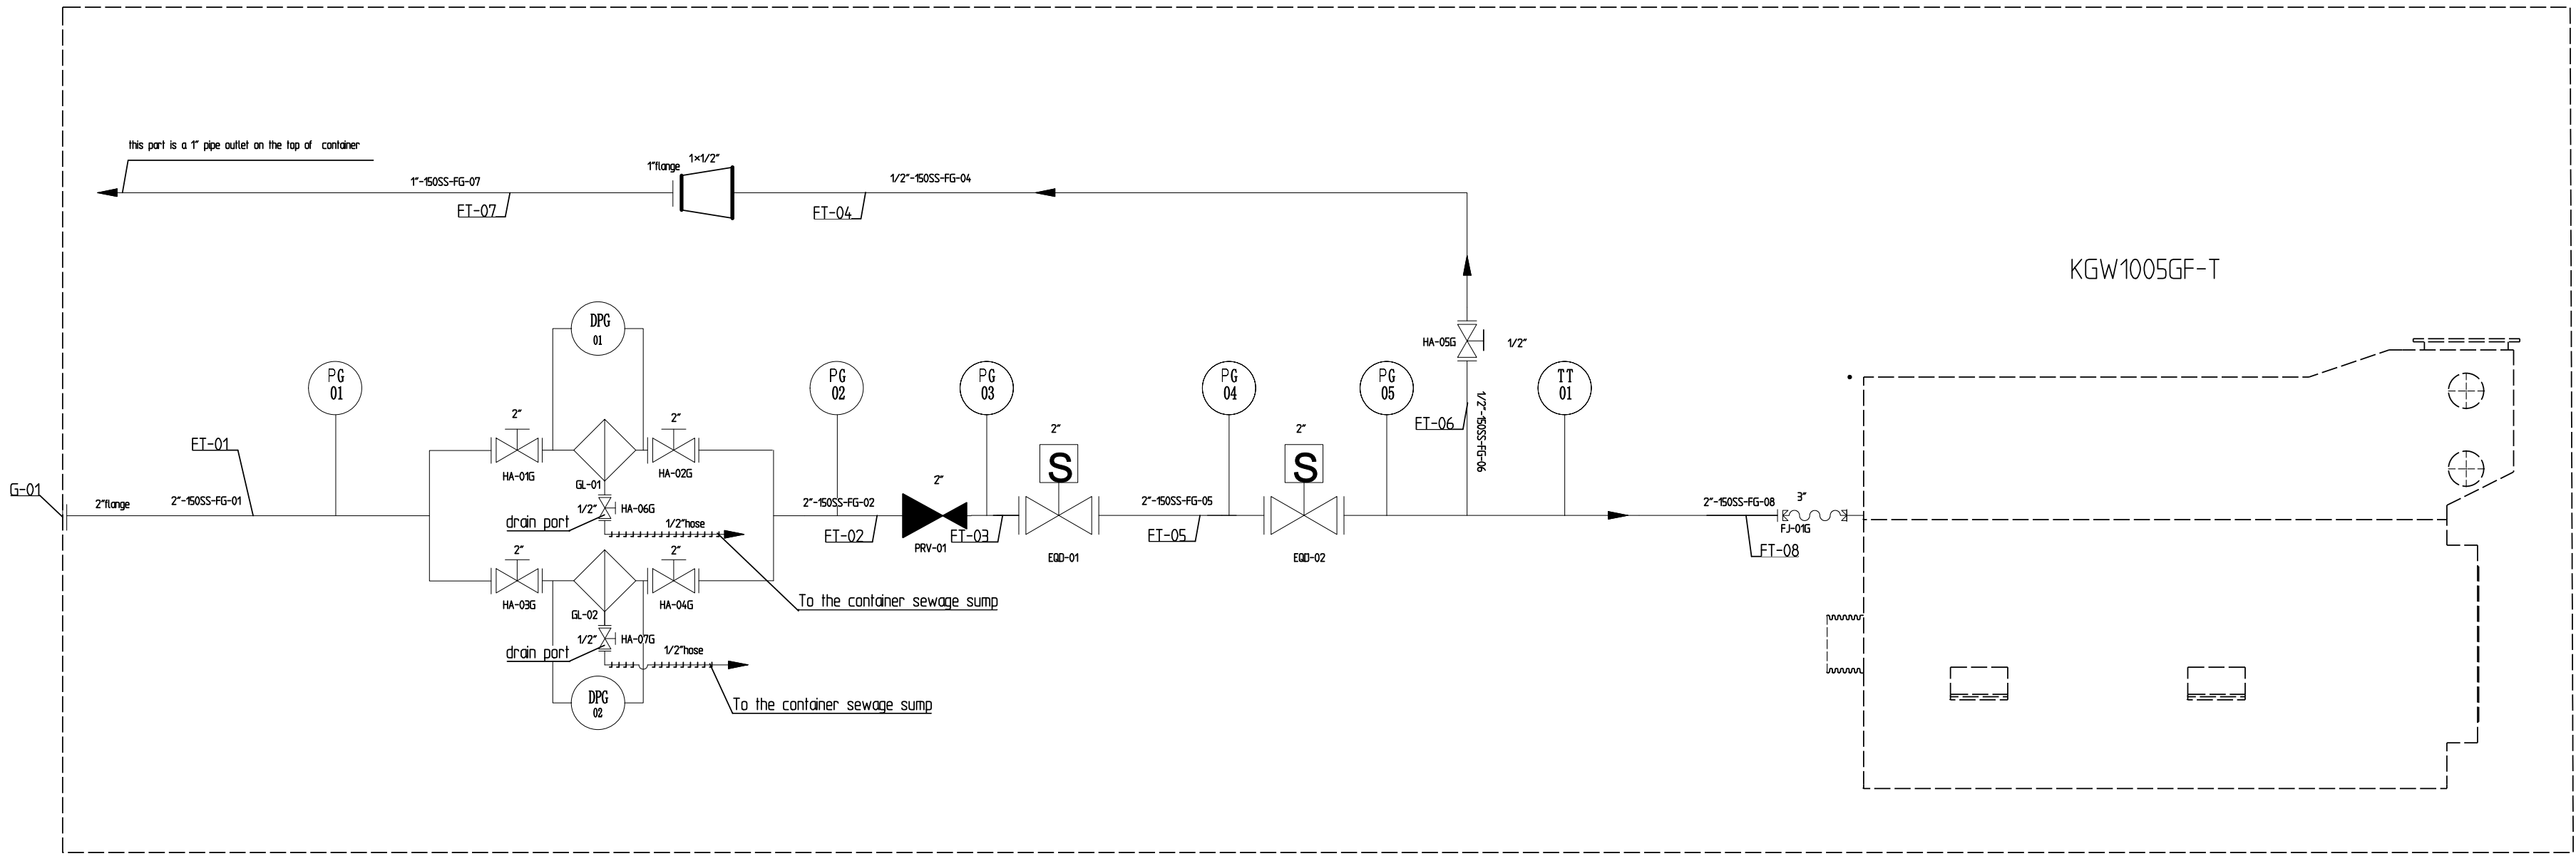

FOR FUEL GAS INLET

INLET PRESSURE:7Bar
FLOW RATE:160Nm³/h
PIPE DIAMETER : 2"
CONNECTION FLANGE:2",150LB,RF

FT01GAS INTAKE PIPE 2"
FT02.CHECK VALVE TO PRESSURE REDUCING VALVE PIPE 2"
FT03BETWEEN VALVE PIPE 2"
FT04:MANUAL VENT VALVE OUTLET PIPE 1/2"
FT05BETWEEN SOLENOID VALVE PIPE 2"
FT06:ELECTRIC RELEASE VALVE INTAKE PIPE 1/2"
FT07:ELECTRIC RELEASE VALVE OUTLET PIPE OUTSIDE CONTAINER 1"
FT08:GENSET GAS INLET FRONT PIPE 2"

Explanation: During normal operation, the HA-01G/HA-02G/HA-05G/EQD-03/EQD-04 valves are closed.

Wangler

NO.	LOCATION	FLUID	SIZING&RATING	NOTE
G-01	Gas Inlet	Fuel GAS	2"-150#RF	

ITEM	DRAWING No.	DESCRIPTION	QTY	MATERIAL	UNIT	TOTAL	REMARK
					MASS	MASS	
DRN		ISS					
REW							
CHK							
CAPP		APP					
KGW550GF-T & Enclosures FUEL SYSTEM					MASS		SCALE
							1:40
					DATE		10/26/24
					KERUI 山东科瑞油气装备有限公司 KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co.,Ltd.		

KGW550GF-T LUBE OIL REFILL SYSTEM

HP-01

HAND PUMP

MATERIAL: STAINLESS STEEL

HEAD: 5m

FLOW: 36-50m³ /H

MEDIUM: LAMP OIL, LIGHT OIL, HEAVY OIL

OT-01

COILTANK

VOLUME:200L

WORKING TEMP:0°C TO +110 °C

MEDIUM: LUBE OIL

SYSTEM COMPONENTS

FSV-01

FIRE SAFE VALVE

OLC-01


OIL LEVEL CONTROLLER

OT-01

Oil tank

HP-01

HAND PUMP

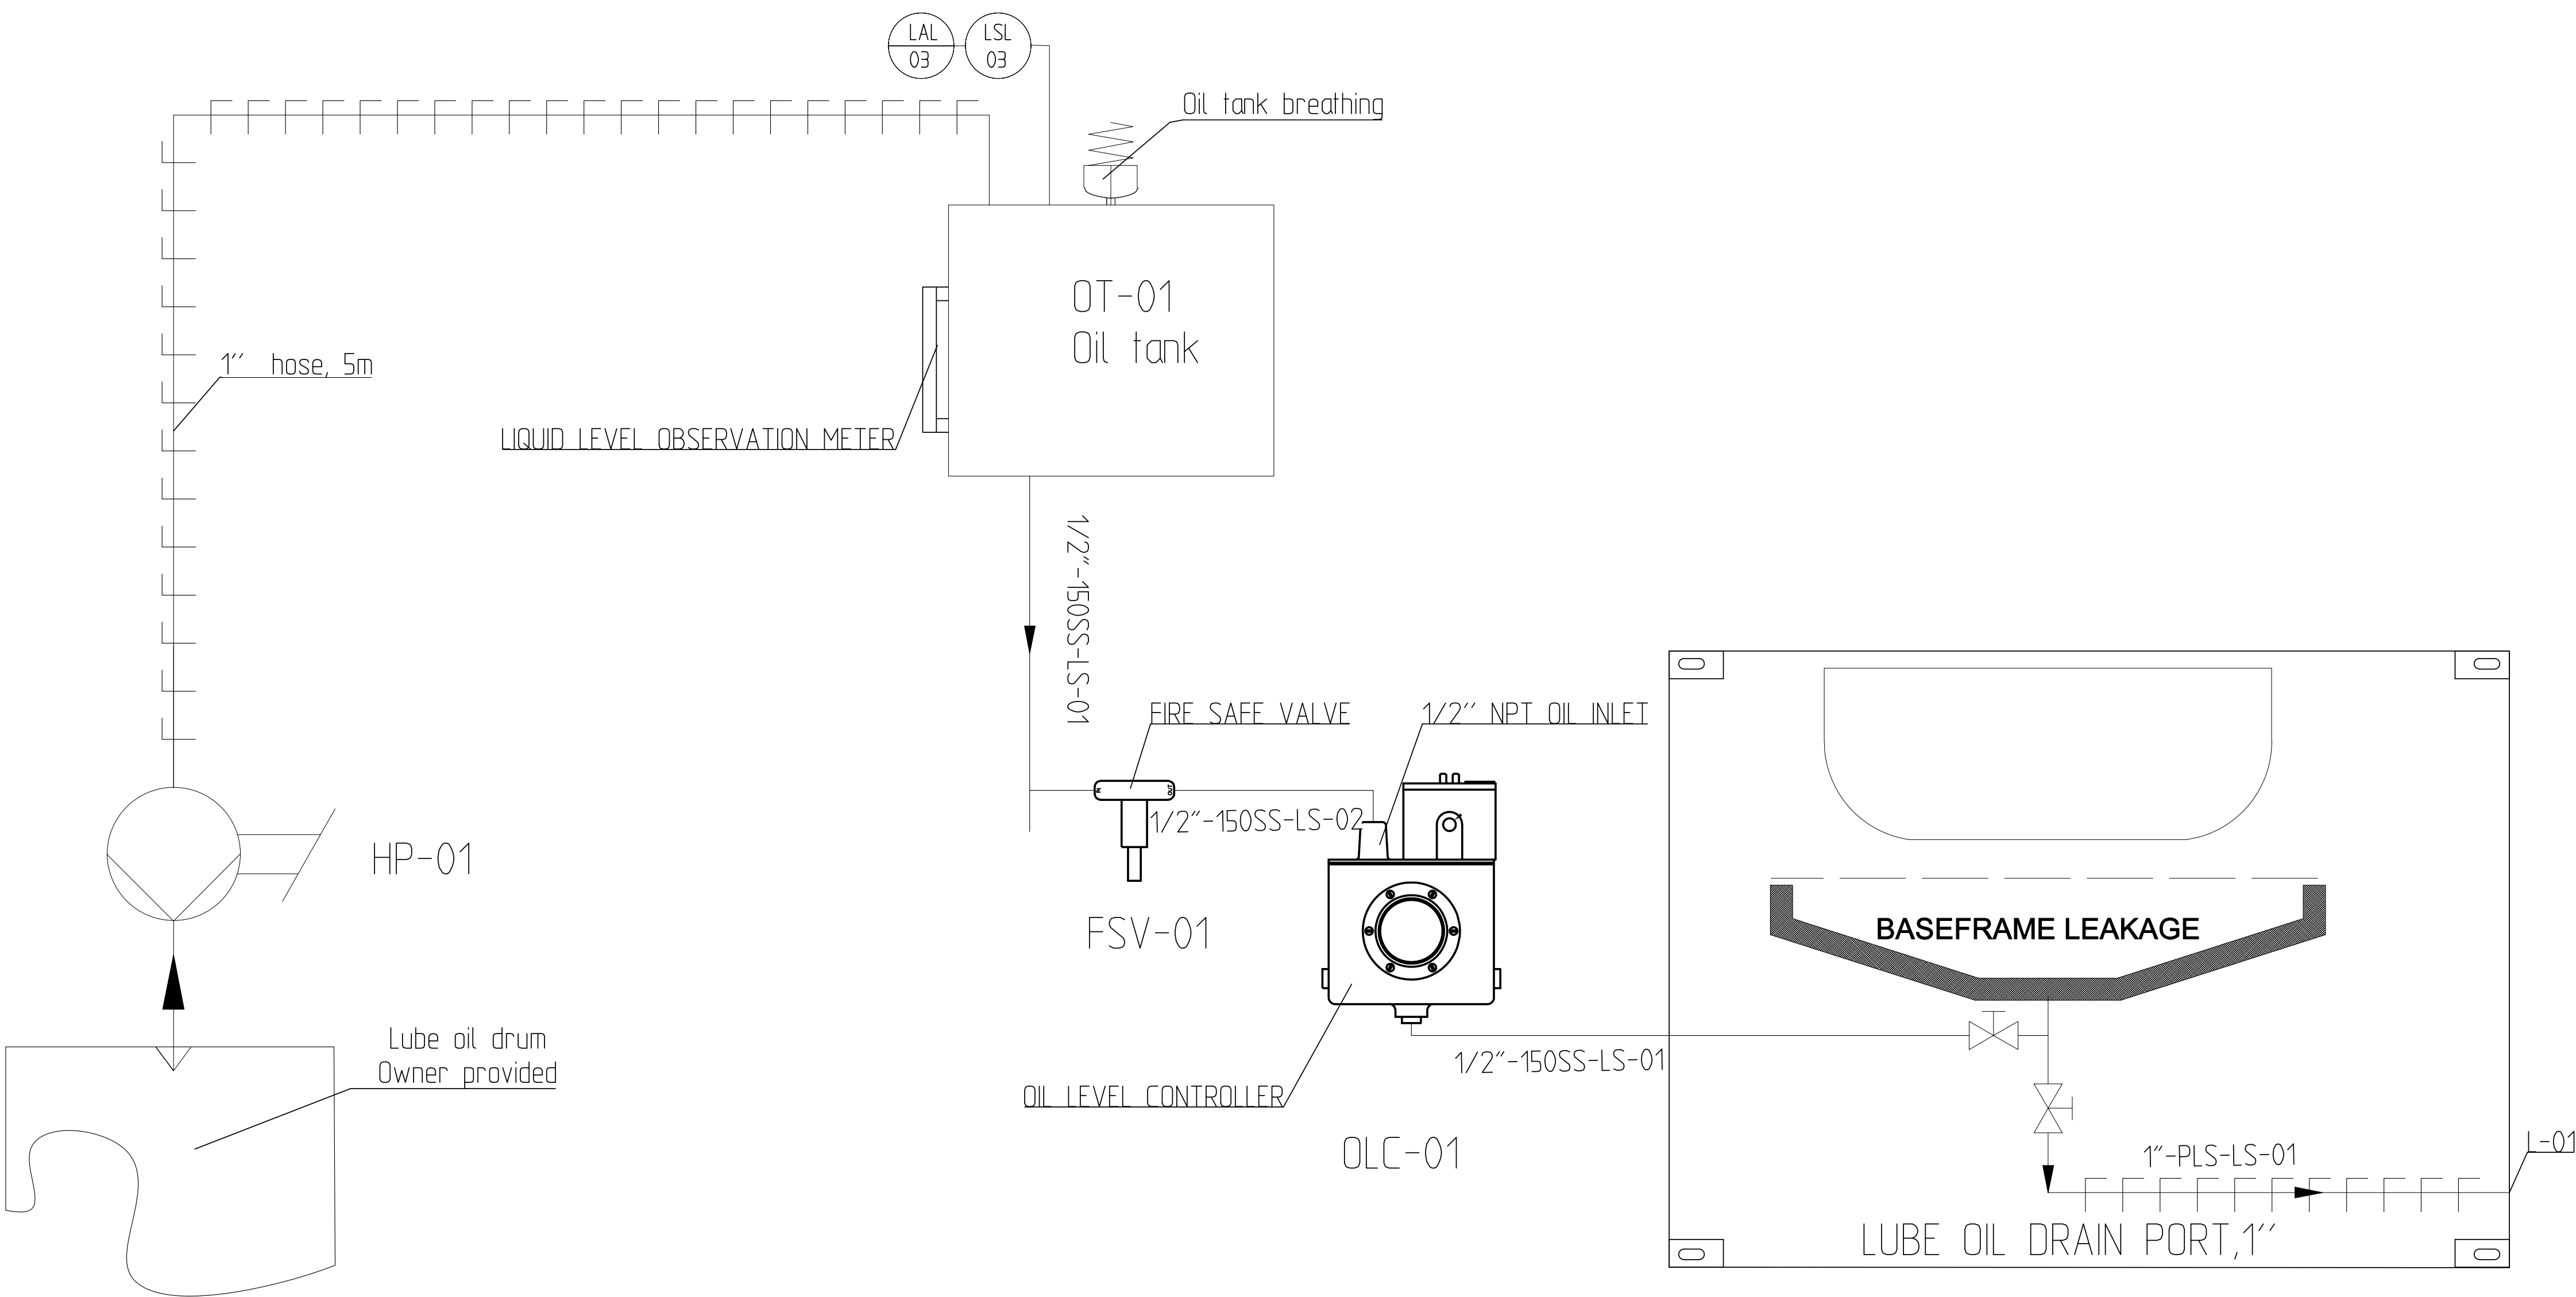

Wang lei

Explanation: Fire safe valve is usually open state, when the temperature in the pipeline reaches 70℃ or 280℃, that is, the fusing metal sheet fusing temperature is reached, the compression spring and spring pin on the mandrel quickly lay the clutch plate, at this time, the clutch and blade adjustment mechanism is removed, the valve body is equipped with two torsion springs, so that the blade is turned by torsion, and the execution is closed. It can effectively prevent fire.



NO.	LOCATION	FLUID	SIZING&RATING	NOTE
L-01	Waste oil outlet	Waste oil	1"-NPT	

ITEM	DRAWING No.				DESCRIPTION				QTY	MATERIAL	UNIT TOTAL		REMARK
											MASS		
									KGW550GF-T & Enclosures LUBE OIL SYSTEM				
DRN			ISS									MASS	SCALE
REW													140
CHK										/		DATE	10/26/24
CAPP			APP							KERUI 山东科瑞油气装备有限公司 KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co.,Ltd.			

KGW550GF-T VENTILATION SYSTEM



KERUI 山东科瑞油气装备有限公司
KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co., Ltd.

KGW550GF-T GAS LEAK ALARM SYSTEM

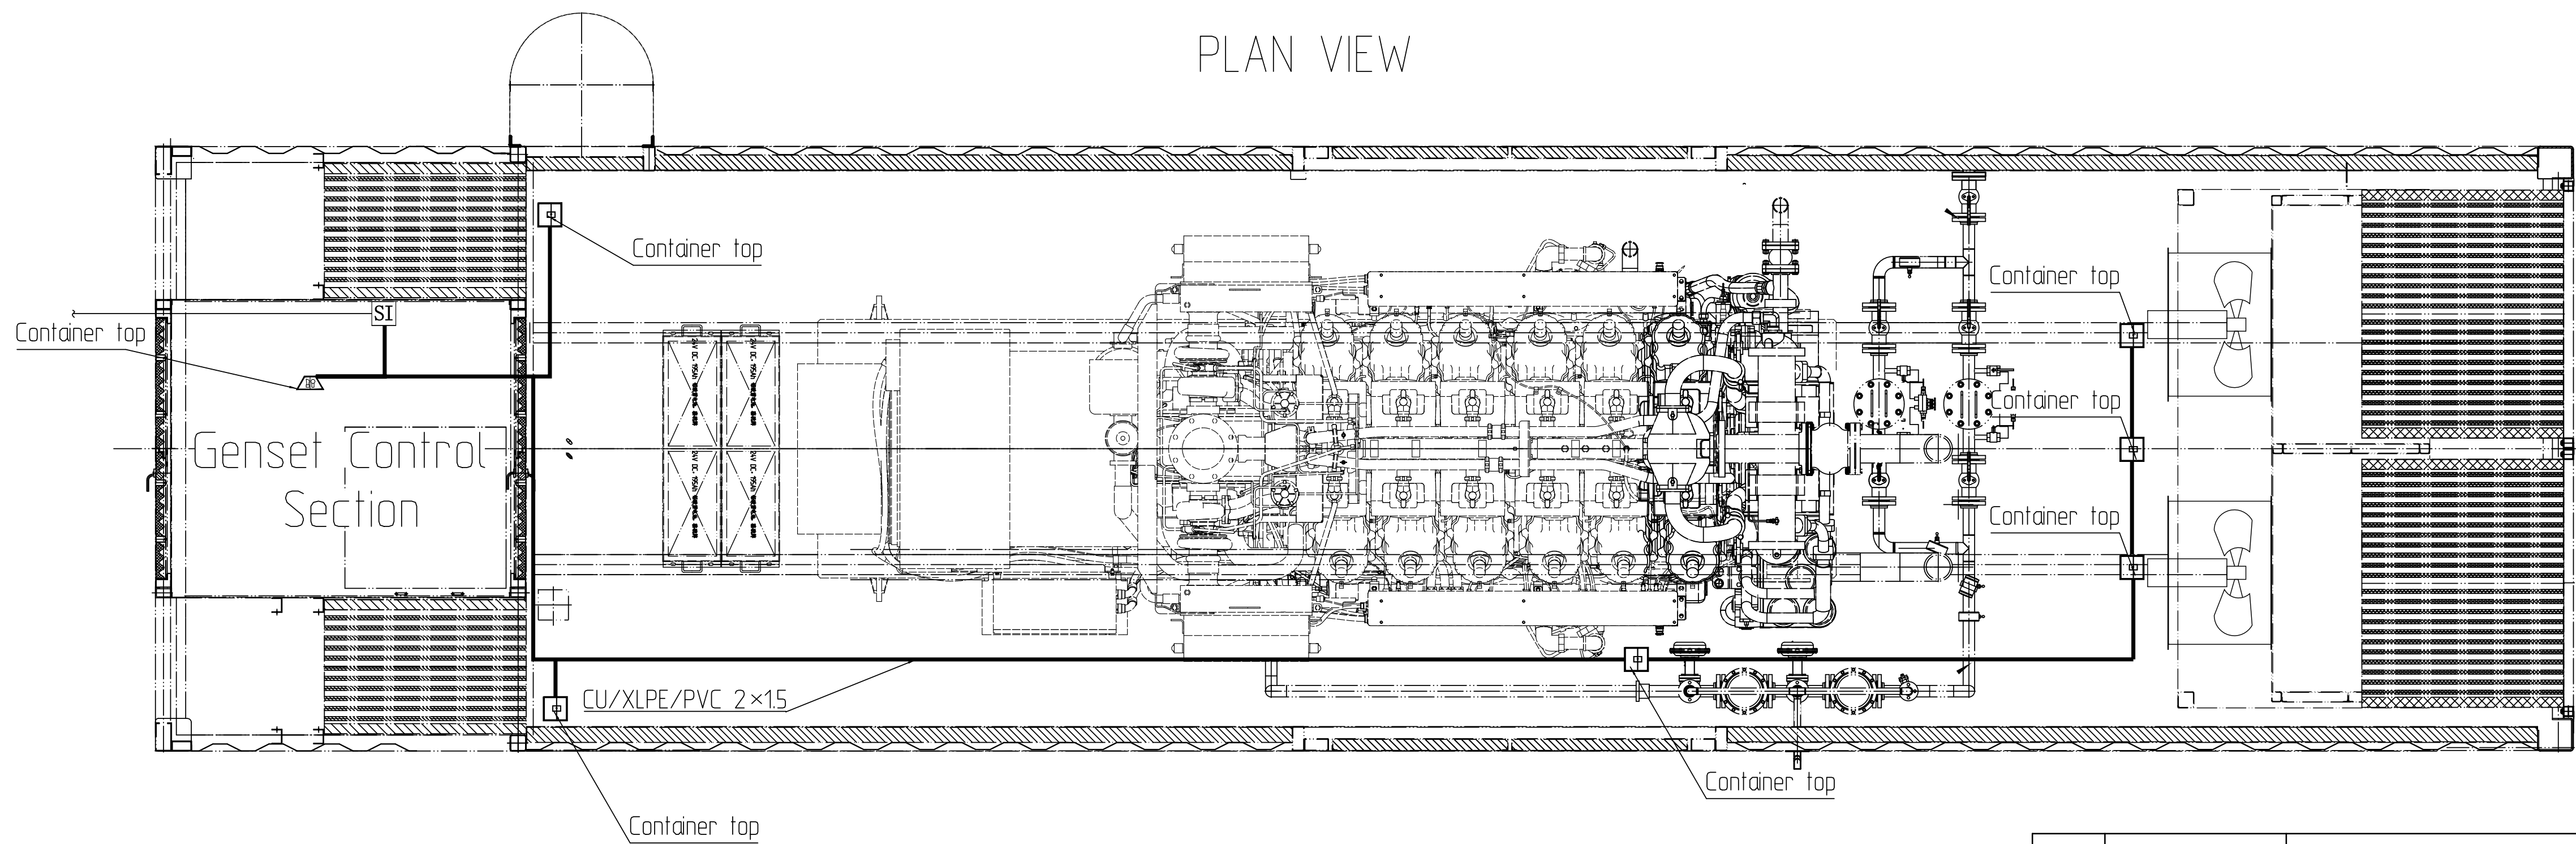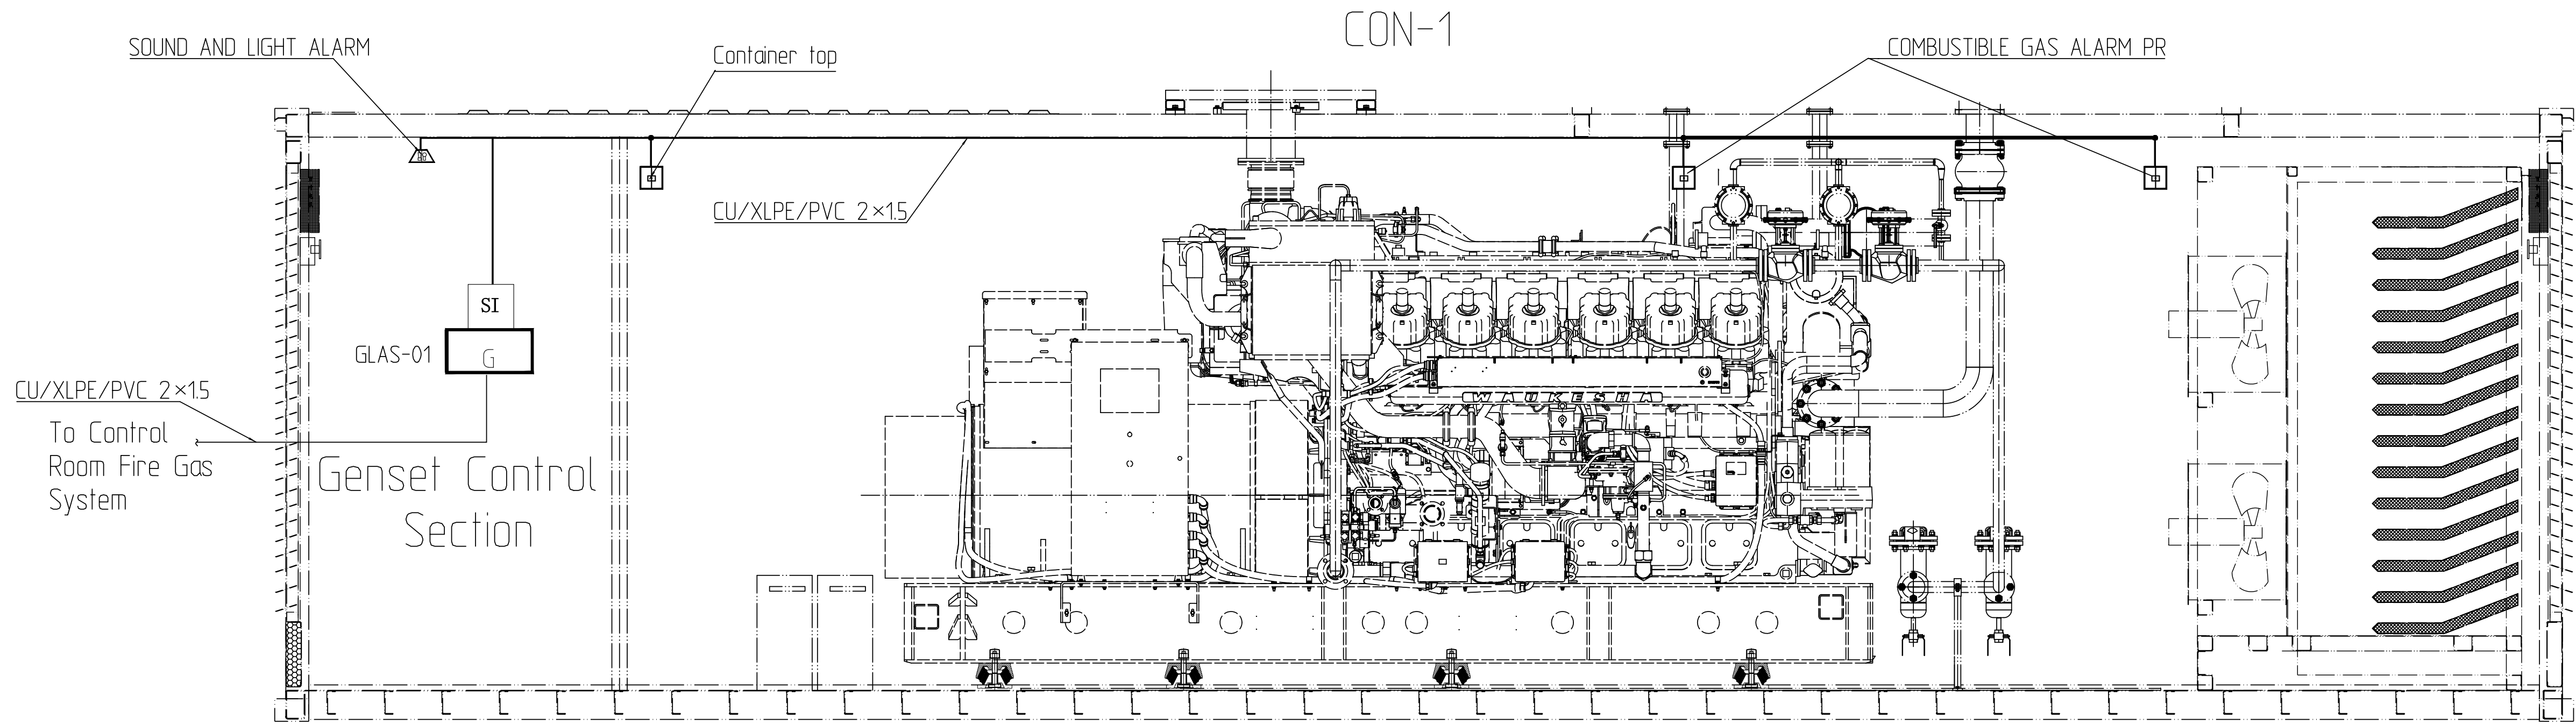

CON-1
CONTAINER
DIMENSION:12000mmx3000mmx3000mm
WEIGHT(NOT INCLUDE THE GENSET):ABOUT
8.5T
MATERIAL:Q235


SYSTEM COMPONENTS
CON-1:CONTAINER
GLAS-01:GAS LEAK ALARM SYSTEM
INCLUDING(1 COMBUSTIBLE GAS ALARM PR
1 SOUND AND LIGHT ALARM,AND 6 FIRE
MAIN CONTROLLER)

-  SOUND AND LIGHT ALARM
-  COMBUSTIBLE GAS ALARM PR


ITEM	DRAWING No.			DESCRIPTION			QTY	MATERIAL			UNIT	TOTAL	REMARK
											MASS	MASS	
							KGW550GF-T & Enclosures GAS LEAK ALARM SYSTEM						
DRN			ISS								MASS	SCALE	
REW												1:40	
CHK								/			DATE	10/26/24	
CAPP			APP					KERUI 山东科瑞油气装备有限公司 KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co.,Ltd.					

Wangler

KGW550GF-T FIREFIGHTING AND FIRE DETECTORS SYSTEM

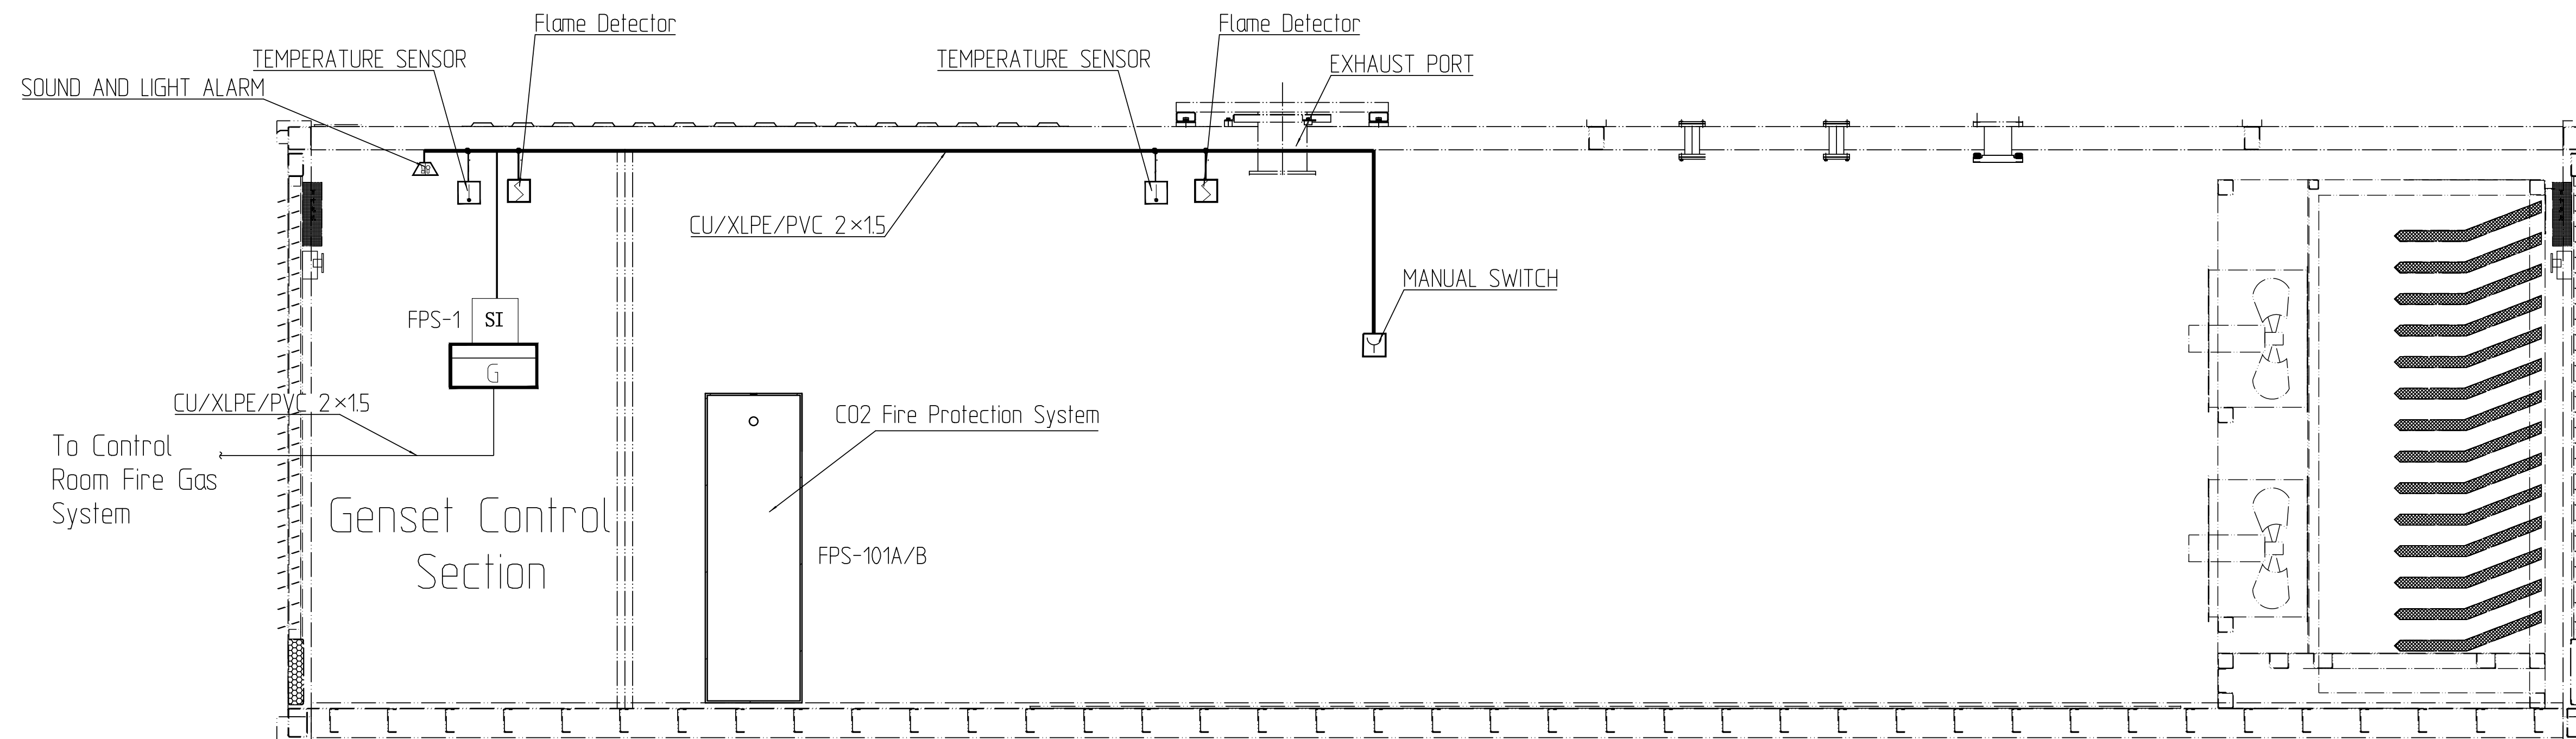

CON-1 PLAN VIEW

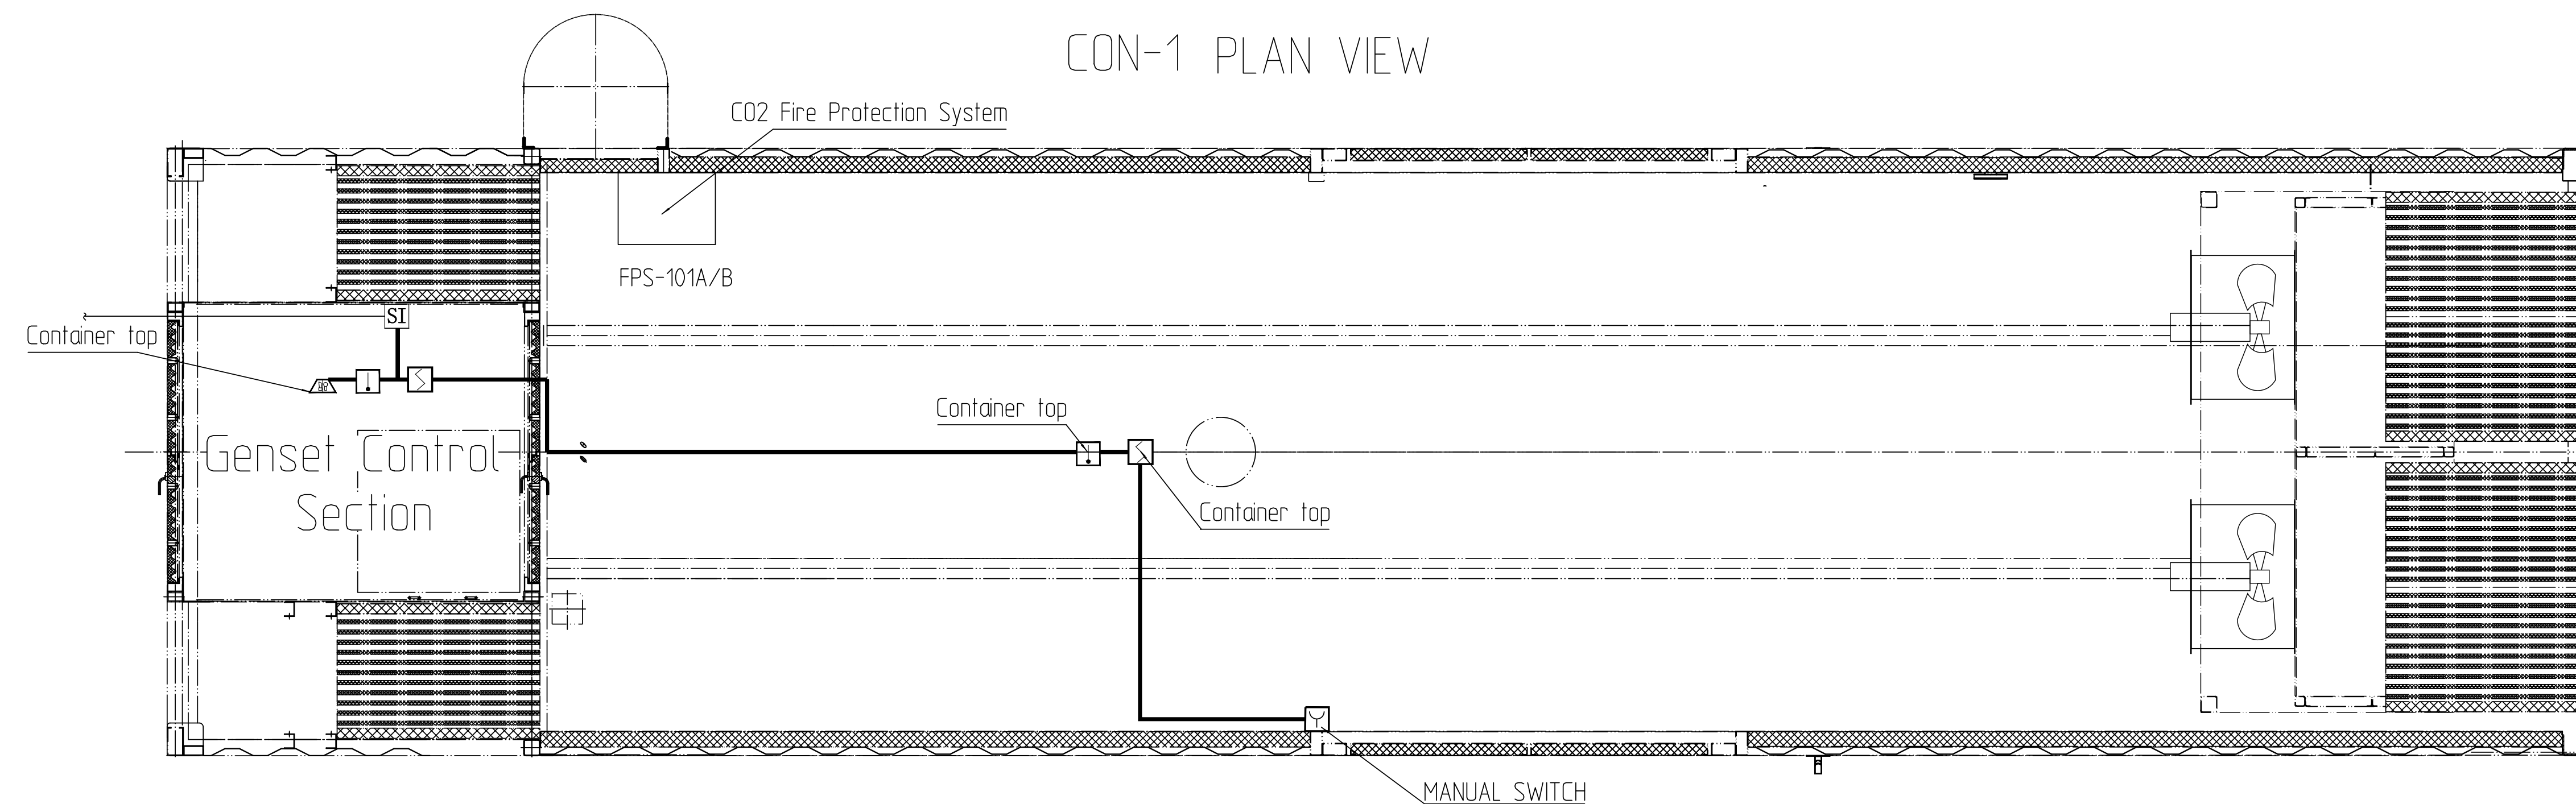


FPS-101A/B
FIRE PROTECTION SYSTEM
MODEL:GST-301
WEIGHT:ABOUT 200KG
QT:1 SET


CON-1
CONTAINER
DIMENSION:12000mmx3000mmx3200mm
WEIGHT(NOT INCLUDE THE GENSET):ABOUT
10T
MATERIAL:Q235

SYSTEM COMPONENTS


CON-1:CONTAINER
FPS-1:FIREFIGHTING AND FIRE DETECTORS
SYSTEM
INCLUDING(2 FLAME DETECTOR, 1 SOUND
AND LIGHT ALARM,2 TEMPERATURE
SENSOR,1 MANUAL SWITCH,AND 1 FIRE
MAIN CONTROLLER)




MANUAL SWITCH



FLAME DETECTOR



NIST



TEMPERATURE SENSOR


ITEM	DRAWING No.	DESCRIPTION	QTY	MATERIAL	UNIT	TOTAL	REMARK
					MASS		
					KGW550GF-T & Enclosures MASS SCALE 140		
DRN		ISS		FIREFIGHTING AND FIRE DETECTORS SYSTEM			
REW							
CHK					/	DATE	10/26/24
CAPP		APP			KERUI 山东科瑞油气装备有限公司 KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co.,Ltd.		

Wang Lei

KGW550GF-T ENCLOSURE LIGHTING

LAMP

TOTAL QT:5
TYPE:BDD95-90-90K
INPUT VOLTAGE:220V,100W
IP66
Rated Freq:50Hz

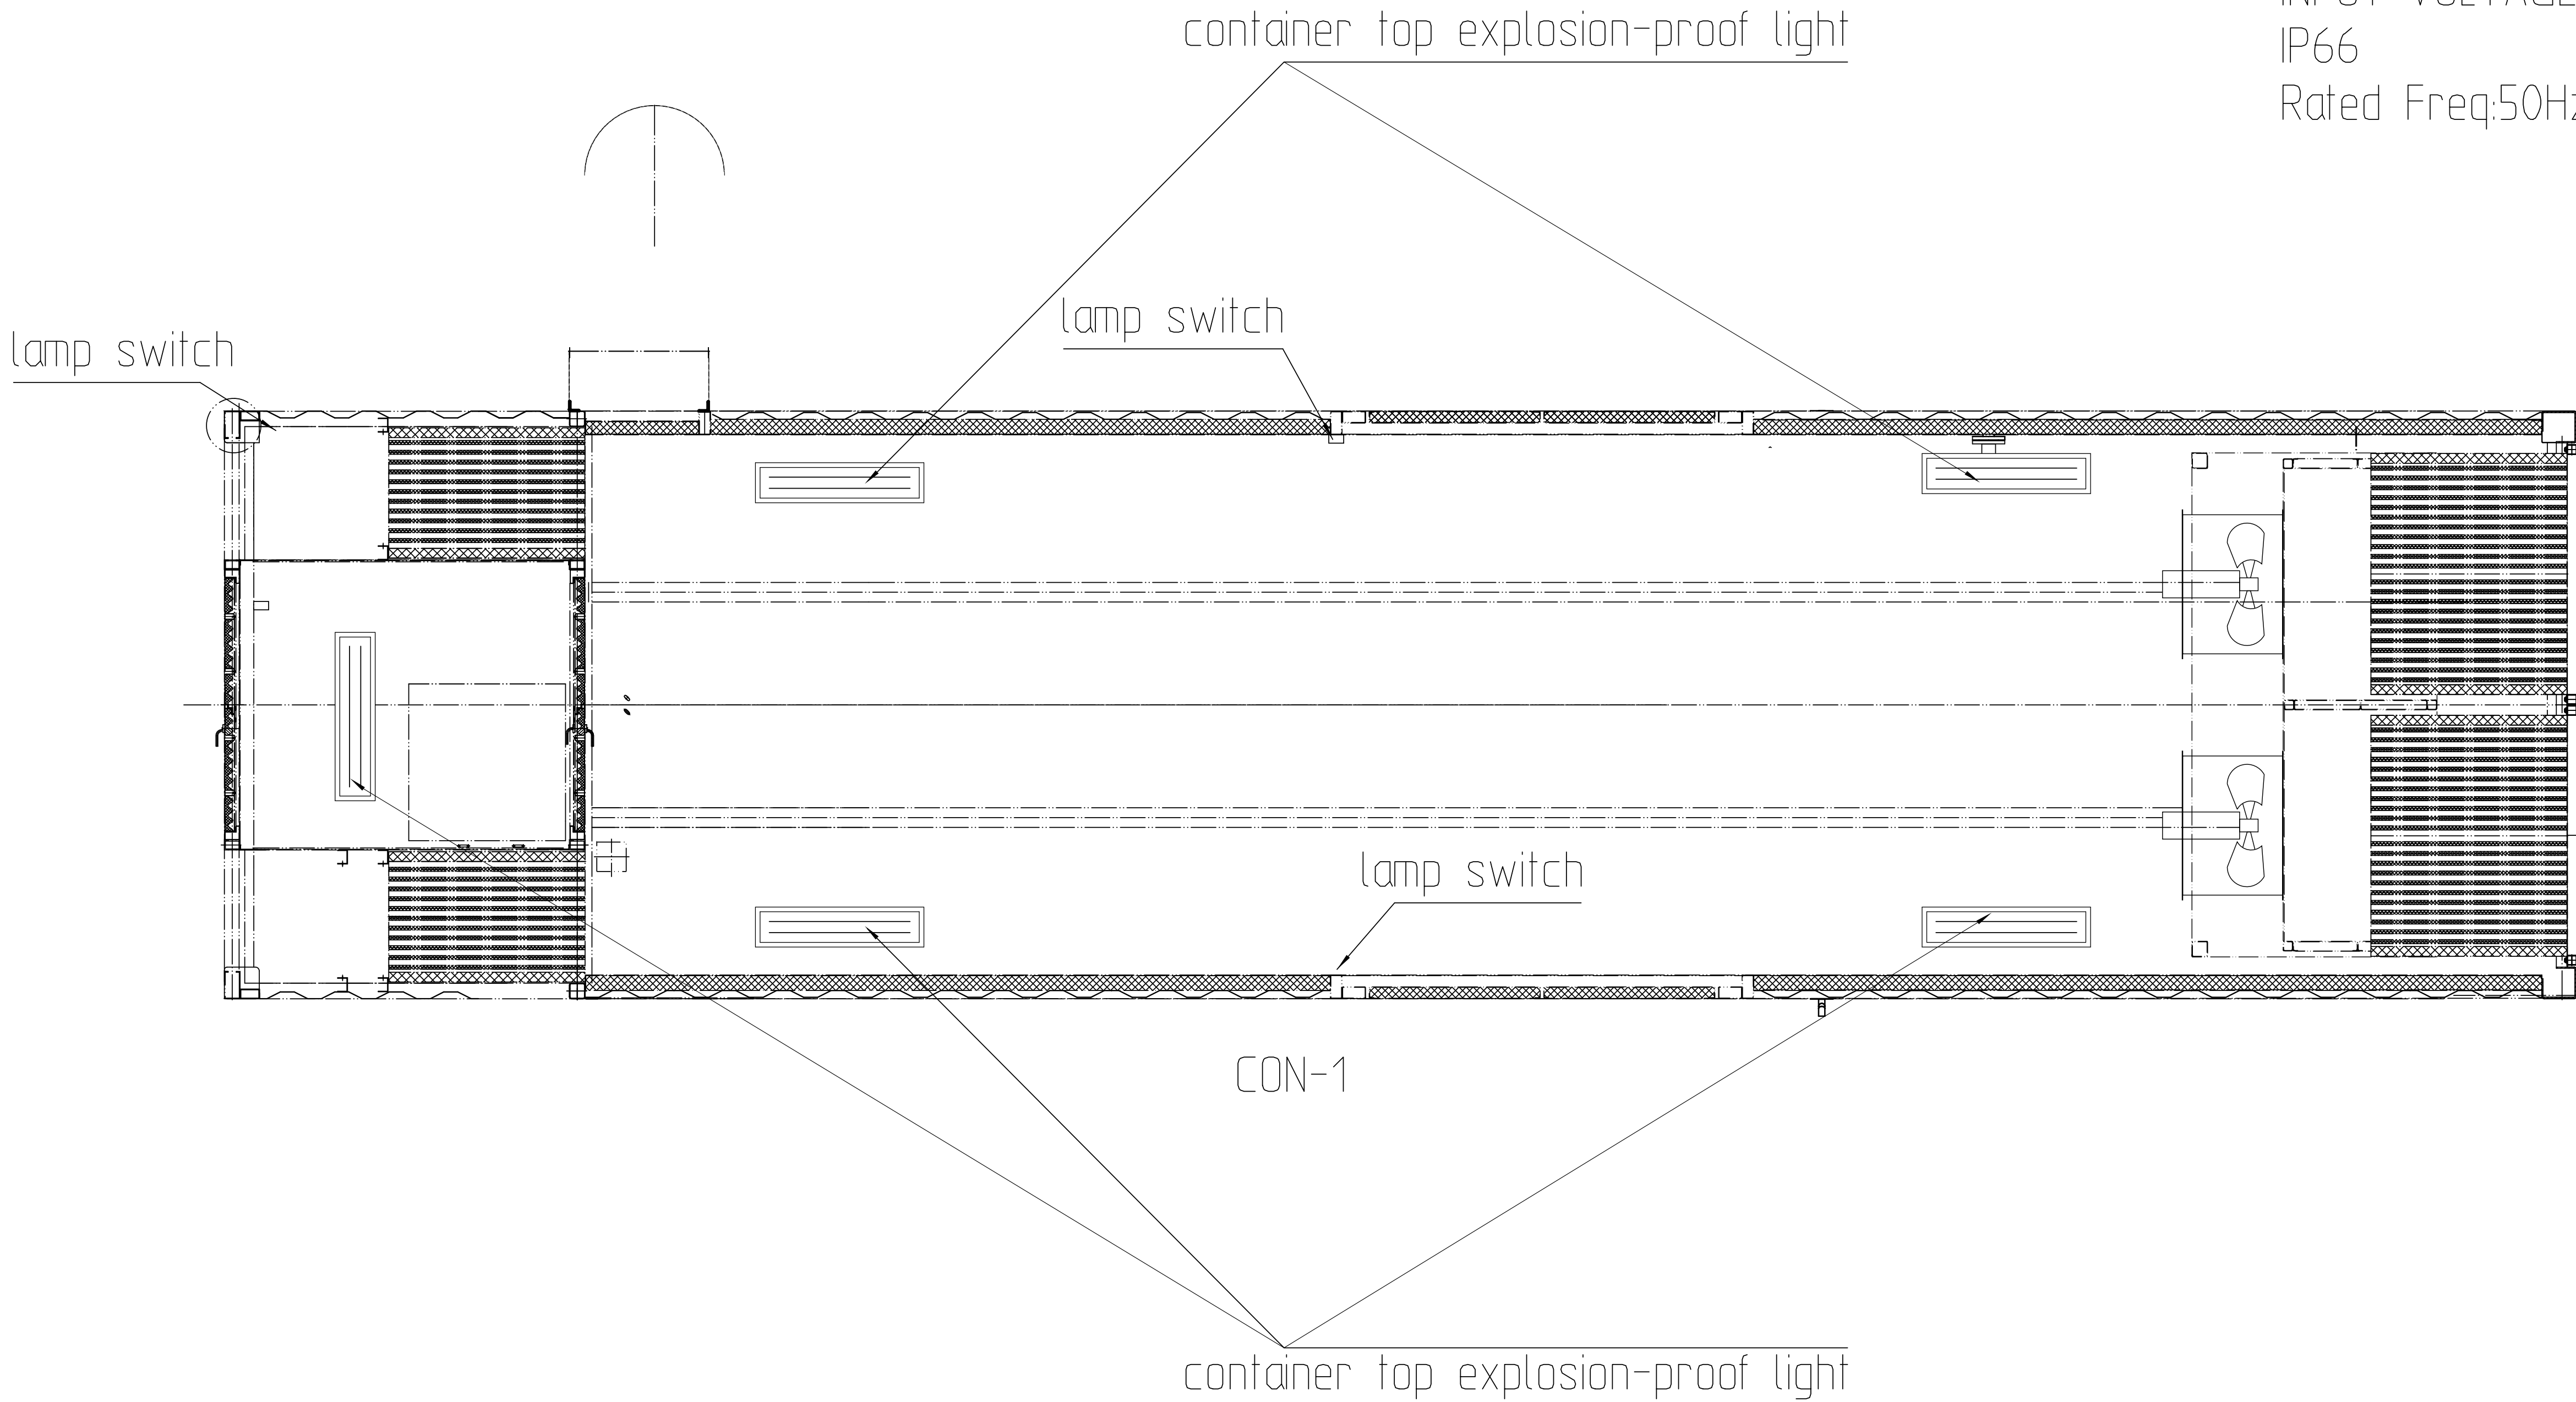

CON-1


CONTAINER
DIMENSION:12000mmx3000mmx3000mm
WEIGHT(NOT INCLUDE THE GENSET):ABOUT 8.5T
MATERIAL:Q235

Wang Lei

ITEM	DRAWING No.	DESCRIPTION	QTY	MATERIAL	UNIT	TOTAL	REMARK
					MASS	MASS	
		KGW550GF-T & Enclosures ENCLOSURE LIGHTING					
						MASS	SCALE
DRN			ISS				1:40
REW						DATE	10/26/24
CHK							
CAPP			APP				

KERUI 山东科瑞油气装备有限公司
KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co., Ltd.

KGW550GF-T Air & Exhaust system

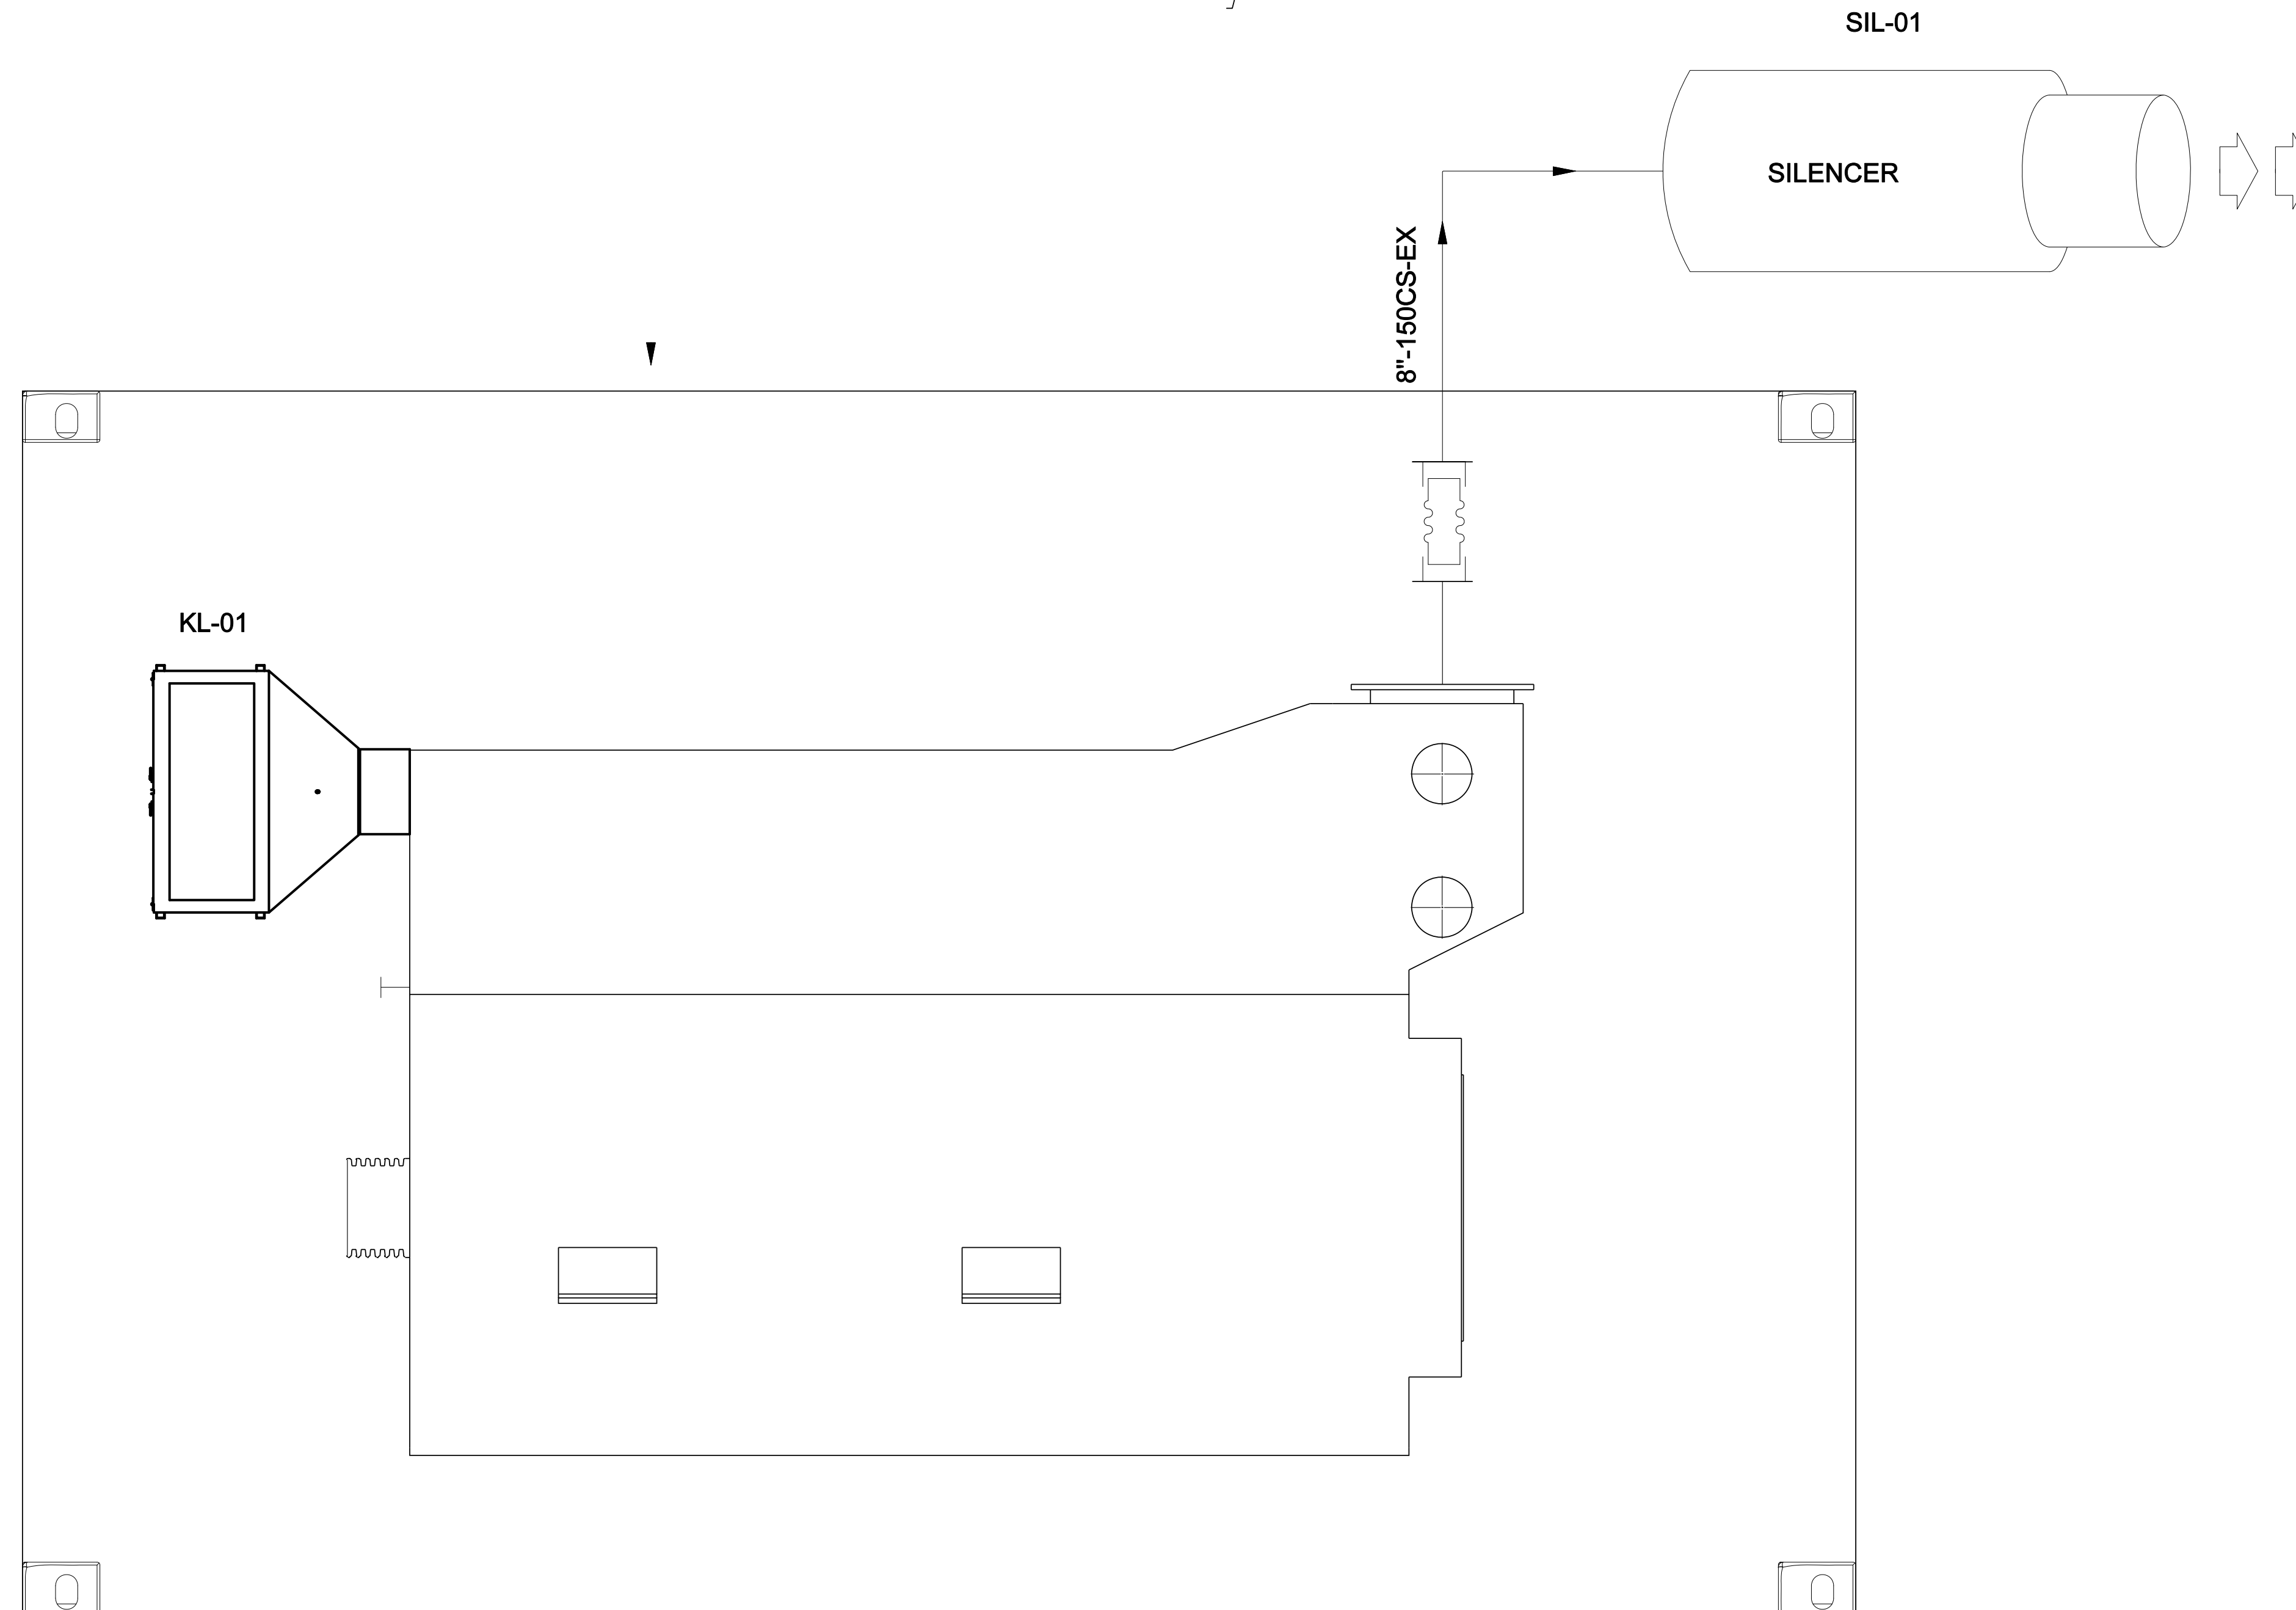

KGW550GF-T CONTAINER

KL-01

AIR FILTER

DIMENSION: 800mm*600mm*600mm

MATERIAL: CARBON STEEL

Waukesha SUPPLY

SIL-01

SILENCER

DIMENSION: 2000mm* ϕ 620mm

WEIGHT:260Kg

MATERIAL:Q235

PIPE DIAMETER:8"

Wang lei

ITEM	DRAWING No.	DESCRIPTION	QTY	MATERIAL	UNIT	TOTAL	REMARK
					MASS		
DRN		ISS					
REW							
CHK							
CAPP		APP					

KGW550GF-T & Enclosures
COOLING SYSTEM

				MASS	SCALE
					1:40
/				DATE	10/26/24

KERUI 山东科瑞油气装备有限公司
KERUI PETROLEUM Shandong Kerui Petroleum & Gas Equipment Co., Ltd.