


VAYU-NET Enforcement Evidence Pack


Ward: I.P EXTENTION (Delhi) Source: burning_fireworks Confidence: 60%
At-risk facilities in ward: 9 schools, 1 hospitals
Priority score: 7.053 Events: 15 Mean PM2.5: 469 ug/m3 (max 614)
Window: 2025-12-26 06:00:00 to 2025-12-31 21:00:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

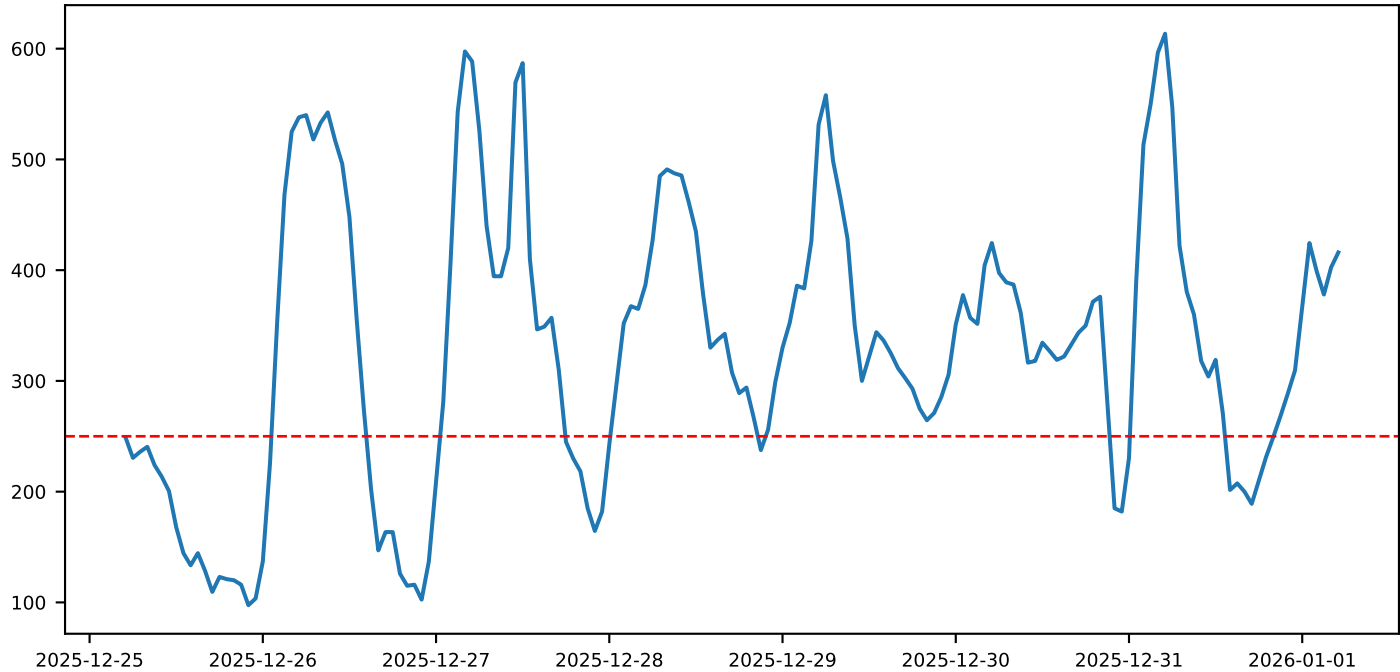

Pollution rose (mean PM2.5 by wind dir)

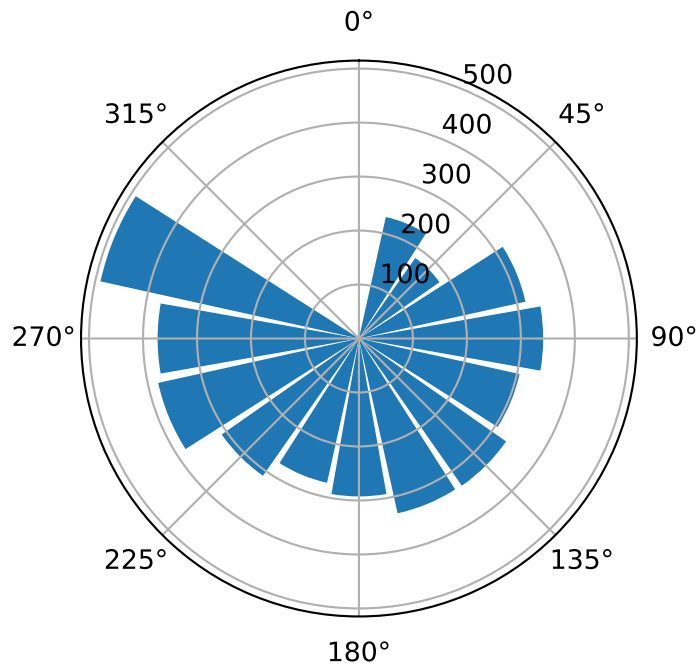

EVIDENCE (auto-generated, traceable):

- NO2 426 above station's 75th percentile (70)
- NH3 282 above station's 75th percentile (64)
- Event at 01:00 — late-night window (burning/fireworks typical)
- New Year period — fireworks prior
- Calm winds (0.3 m/s) — accumulation/inversion conditions