

VAYU-NET Enforcement Evidence Pack

Ward: SHAKARPUR (Delhi) Source: burning_fireworks Confidence: 59%

At-risk facilities in ward: 3 schools, 1 hospitals


Priority score: 5.308 Events: 25 Mean PM2.5: 412 ug/m3 (max 603)

Window: 2025-12-26 02:30:00 to 2025-12-31 20:30:00


RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points

LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

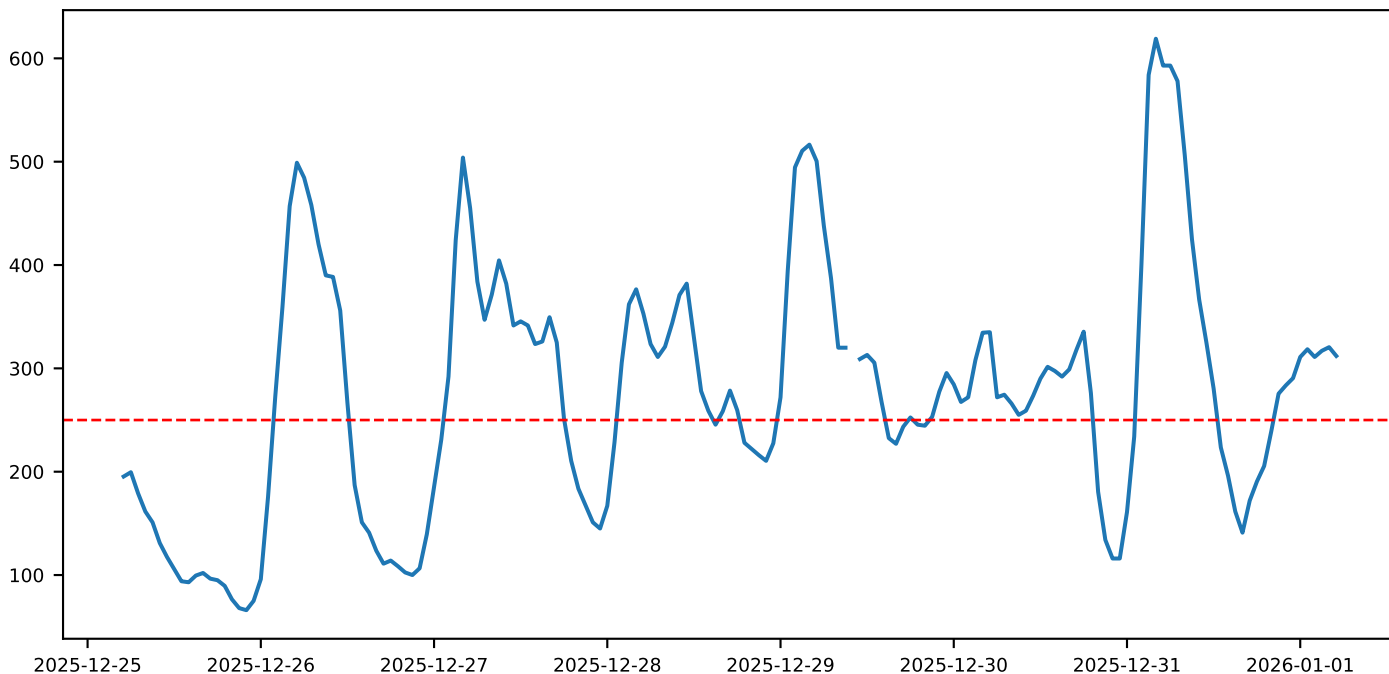

Pollution rose (mean PM2.5 by wind dir)

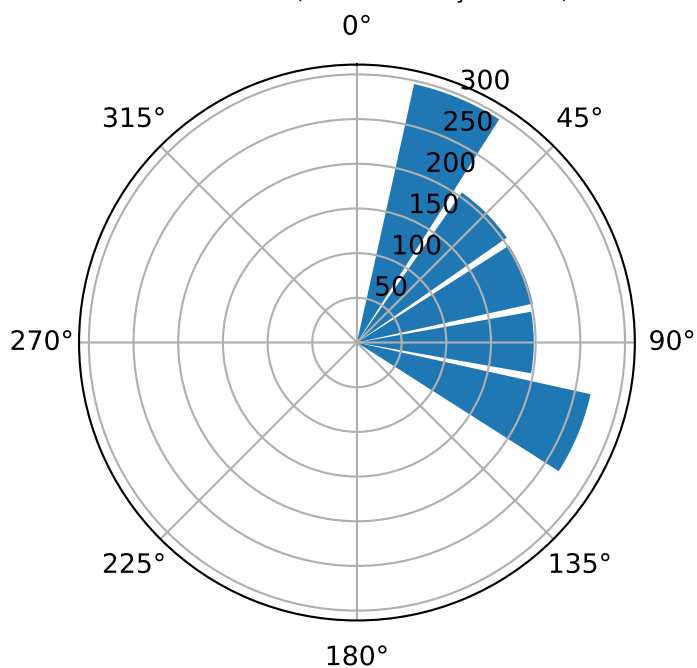

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.96 > 0.65 — combustion-dominated aerosol
- CO 8 above station's 75th percentile (5)
- SO2 10 above station's 75th percentile (10)
- NH3 75 above station's 75th percentile (75)
- Event at 01:00 — late-night window (burning/fireworks typical)
- New Year period — fireworks prior
- Calm winds (0.3 m/s) — accumulation/inversion conditions