


VAYU-NET Enforcement Evidence Pack


Ward: E (Mumbai) Source: burning_fireworks Confidence: 49%
At-risk facilities in ward: 19 schools, 26 hospitals
Priority score: 0.497 Events: 7 Mean PM2.5: 99 ug/m3 (max 116)
Window: 2025-12-28 06:30:00 to 2025-12-31 18:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

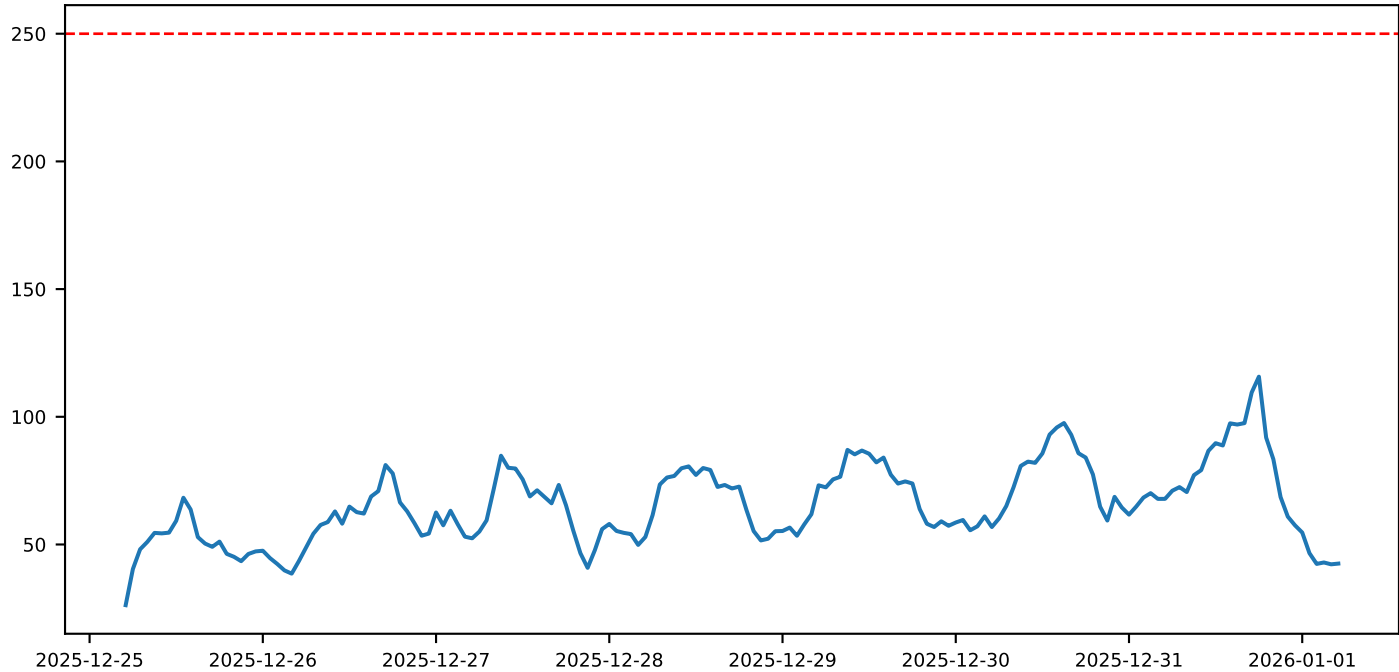

Pollution rose (mean PM2.5 by wind dir)

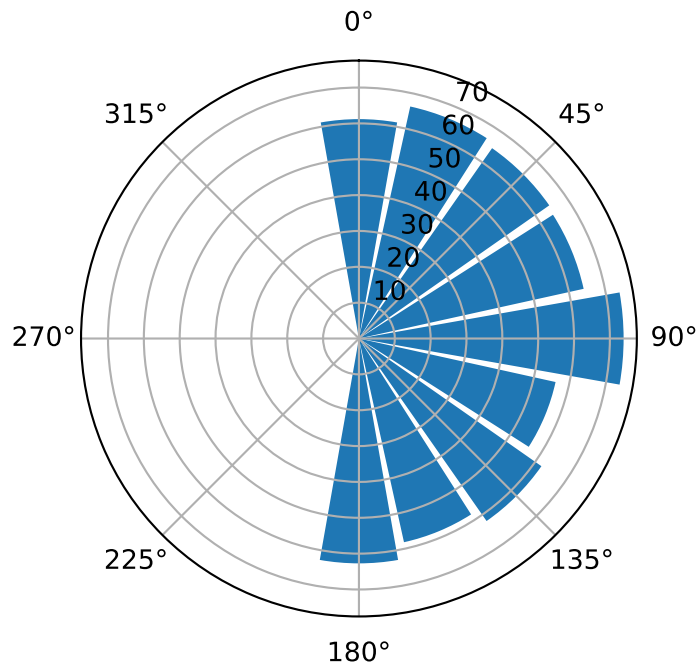

EVIDENCE (auto-generated, traceable):

- NO2 120 above station's 75th percentile (109)
- CO 1 above station's 75th percentile (1)
- NH3 131 above station's 75th percentile (130)
- New Year period — fireworks prior
- Calm winds (0.8 m/s) — accumulation/inversion conditions