


VAYU-NET Enforcement Evidence Pack


Ward: ROHINI (Delhi) Source: burning_fireworks Confidence: 66%
At-risk facilities in ward: 15 schools, 3 hospitals
Priority score: 7.829 Events: 13 Mean PM2.5: 425 ug/m3 (max 552)
Window: 2025-12-26 05:30:00 to 2025-12-31 21:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

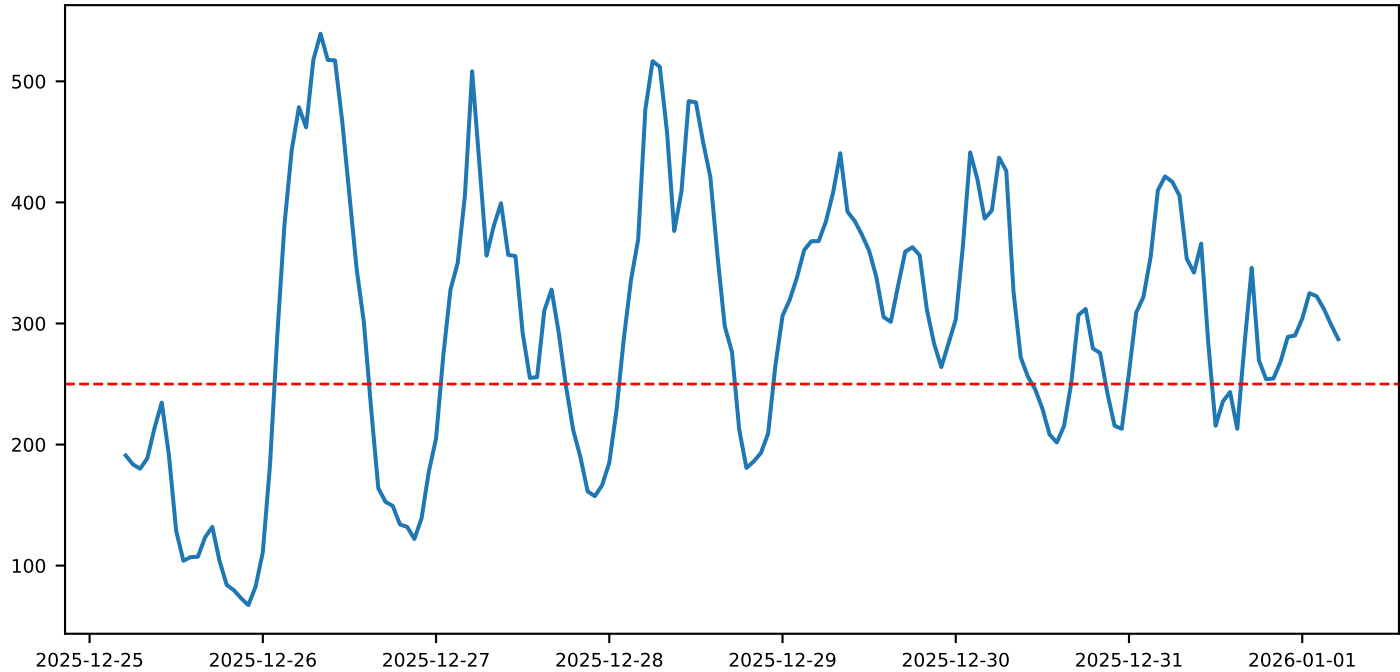

Pollution rose (mean PM2.5 by wind dir)

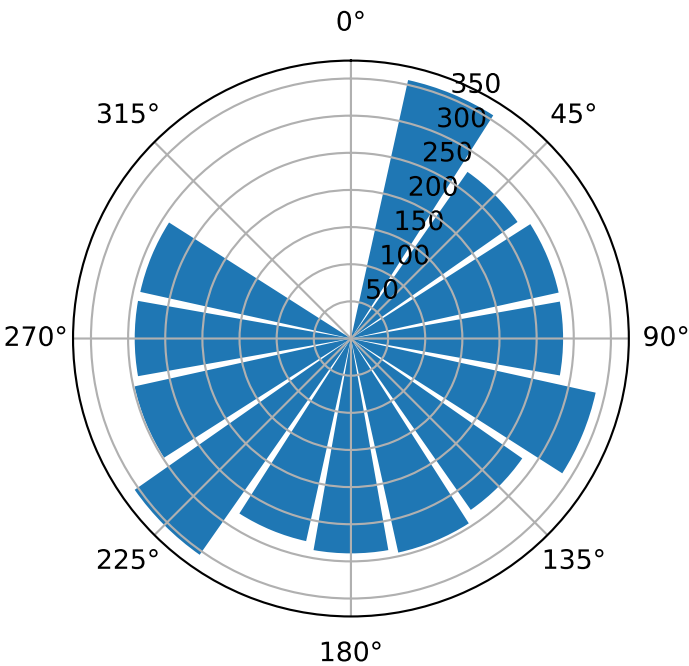

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.84 > 0.65 — combustion-dominated aerosol
- NH3 79 above station's 75th percentile (74)
- New Year period — fireworks prior