


VAYU-NET Enforcement Evidence Pack


Ward: Sarakki (Bengaluru) Source: burning_fireworks Confidence: 61%
At-risk facilities in ward: 10 schools, 9 hospitals
Priority score: 0.282 Events: 3 Mean PM2.5: 76 ug/m3 (max 94)
Window: 2025-12-28 19:30:00 to 2025-12-31 16:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

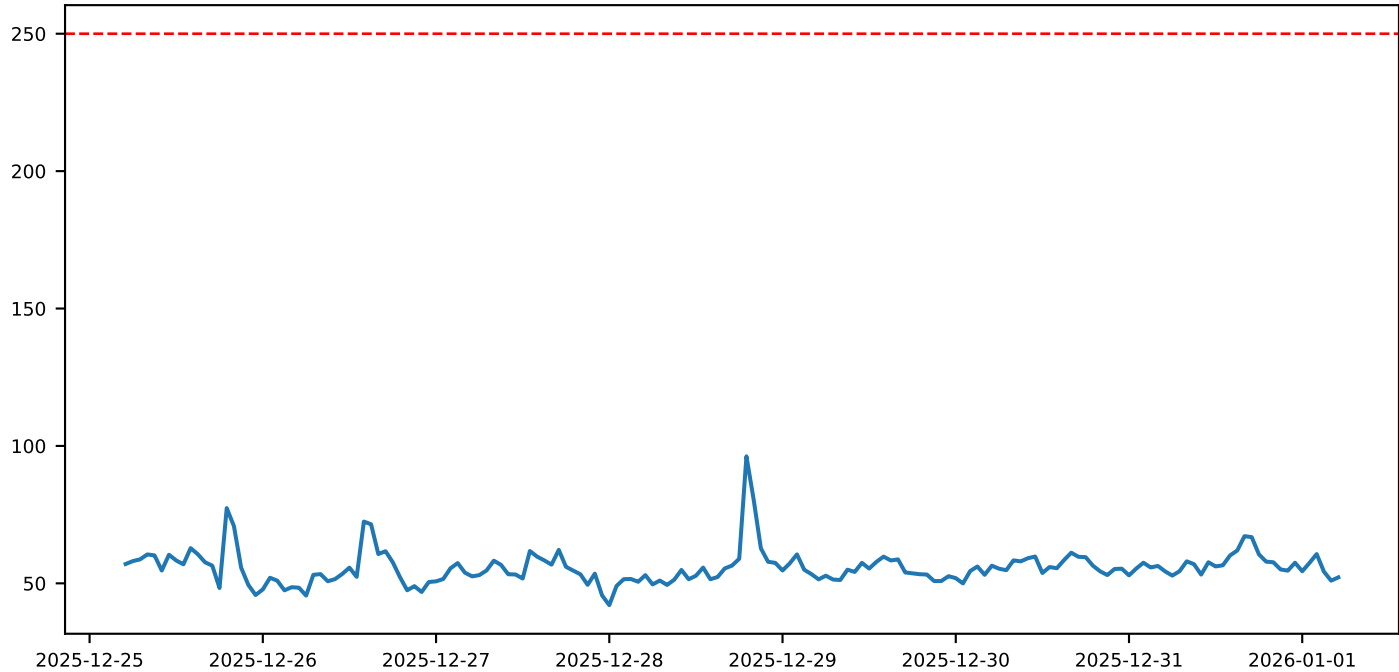

Pollution rose (mean PM2.5 by wind dir)

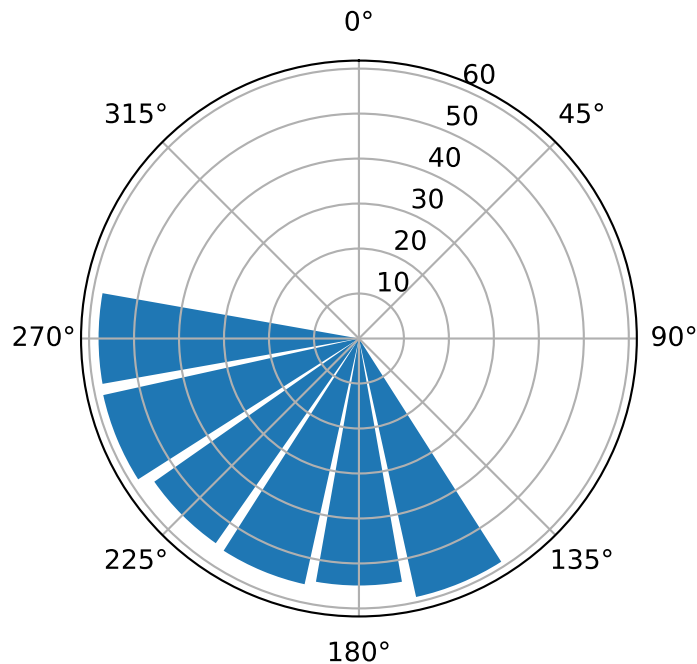

EVIDENCE (auto-generated, traceable):

- CO 1 above station's 75th percentile (1)
- NH3 36 above station's 75th percentile (31)
- New Year period — fireworks prior
- Calm winds (0.9 m/s) — accumulation/inversion conditions