


VAYU-NET Enforcement Evidence Pack


Ward: Bellanduru (Bengaluru) Source: burning_fireworks Confidence: 53%
At-risk facilities in ward: 10 schools, 6 hospitals
Priority score: 0.243 Events: 3 Mean PM2.5: 87 ug/m3 (max 103)
Window: 2025-12-26 23:30:00 to 2025-12-27 07:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

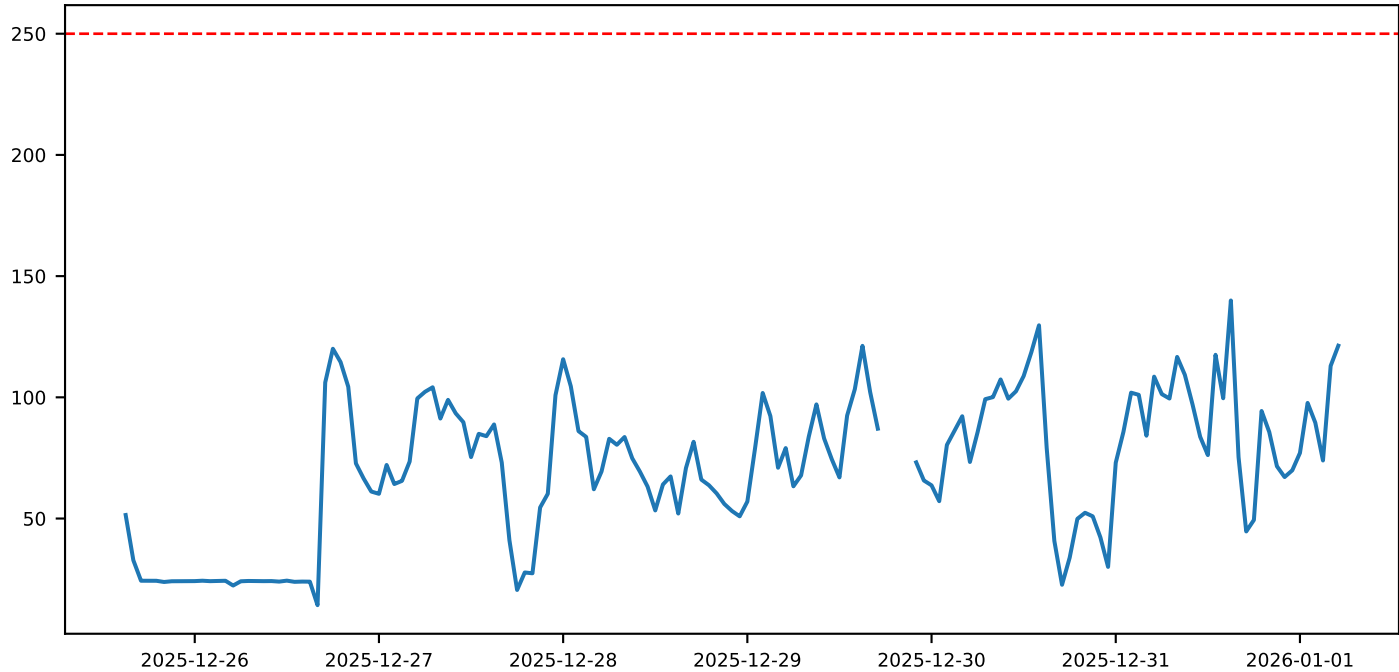

Pollution rose (mean PM2.5 by wind dir)

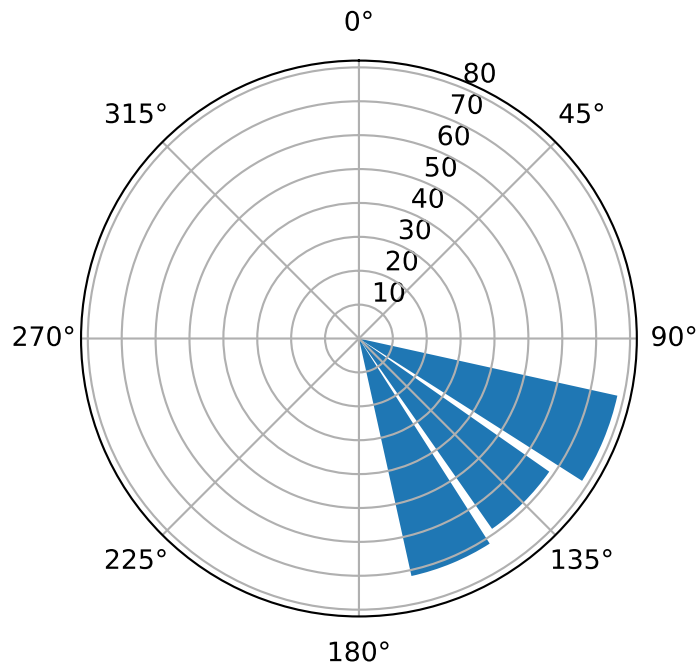

EVIDENCE (auto-generated, traceable):

- CO 1 above station's 75th percentile (1)
- NH3 3 above station's 75th percentile (3)
- Event at 01:00 — late-night window (burning/fireworks typical)