

VAYU-NET Enforcement Evidence Pack

Ward: LAJPAT NAGAR (Delhi) Source: burning_fireworks Confidence: 61%

At-risk facilities in ward: 5 schools, 2 hospitals


Priority score: 7.504 Events: 14 Mean PM2.5: 512 ug/m3 (max 685)

Window: 2025-12-26 03:30:00 to 2025-12-31 23:30:00


RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points

LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

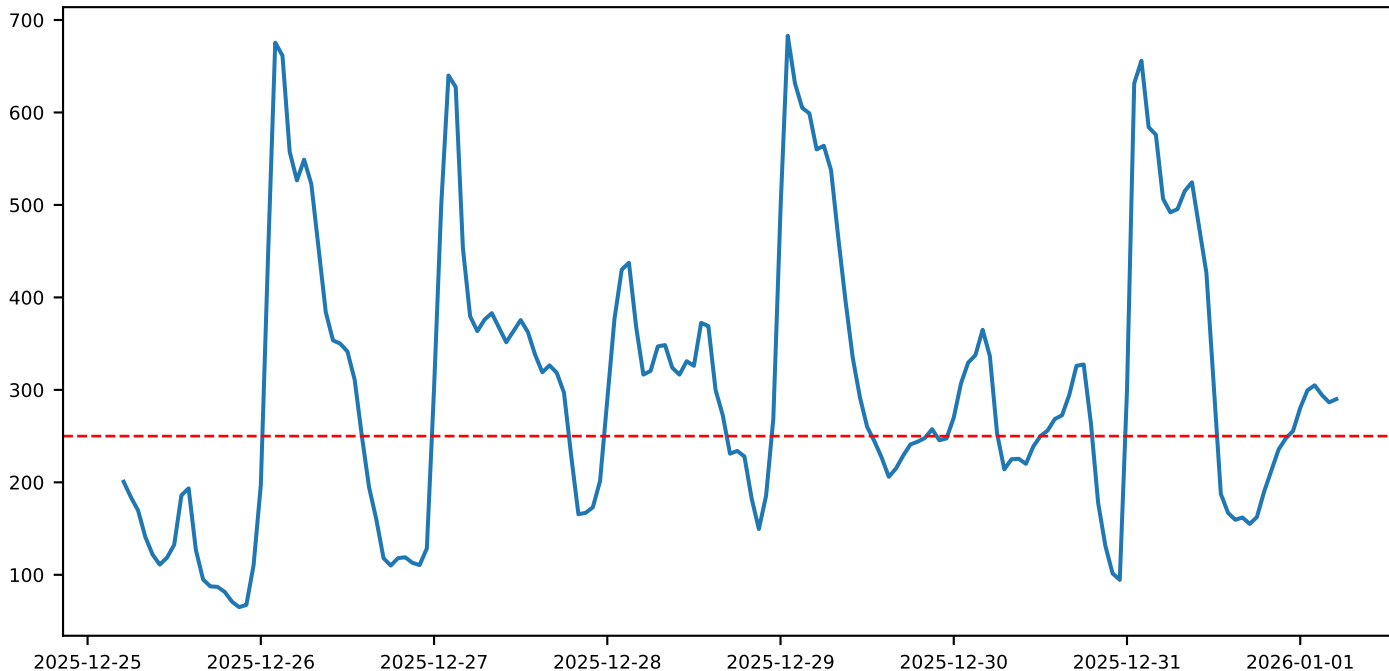

Pollution rose (mean PM2.5 by wind dir)

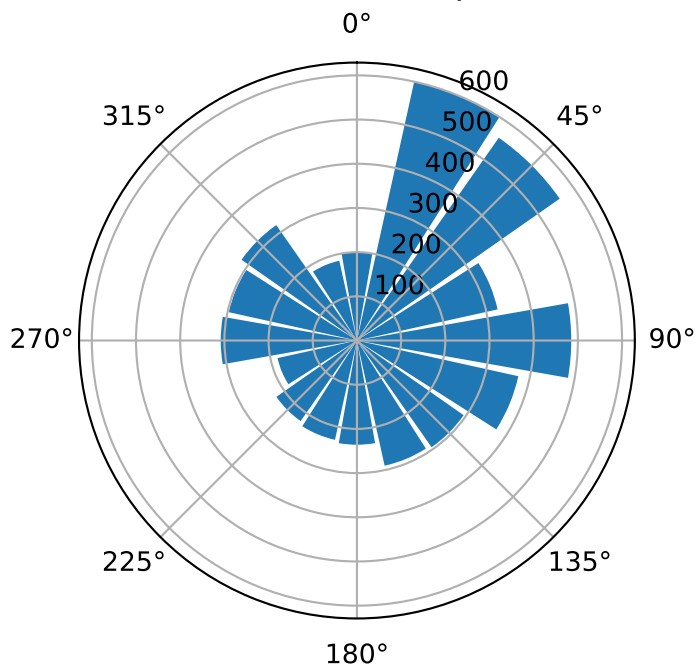

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.76 > 0.65 — combustion-dominated aerosol
- NO2 77 above station's 75th percentile (58)
- CO 5 above station's 75th percentile (4)
- NH3 38 above station's 75th percentile (31)
- Event at 22:00 — late-night window (burning/fireworks typical)
- Calm winds (0.3 m/s) — accumulation/inversion conditions
- VIIRS fire activity 3.4x the period average within ~50 km (7 detections vs 2/day baseline, NASA FIRMS)