
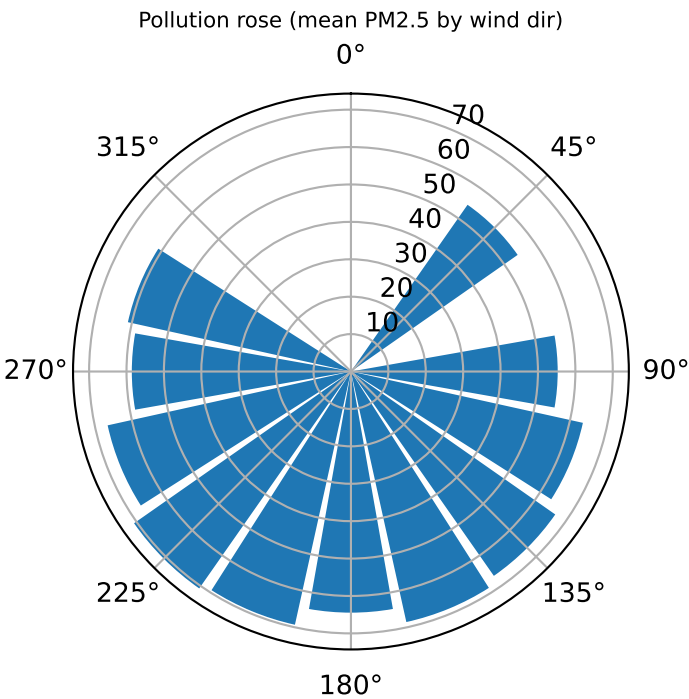


VAYU-NET Enforcement Evidence Pack

Ward: K/E (Mumbai) Source: burning_fireworks Confidence: 62%
At-risk facilities in ward: 27 schools, 61 hospitals
Priority score: 0.159 Events: 2 Mean PM2.5: 87 ug/m3 (max 88)
Window: 2025-12-31 13:30:00 to 2025-12-31 14:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

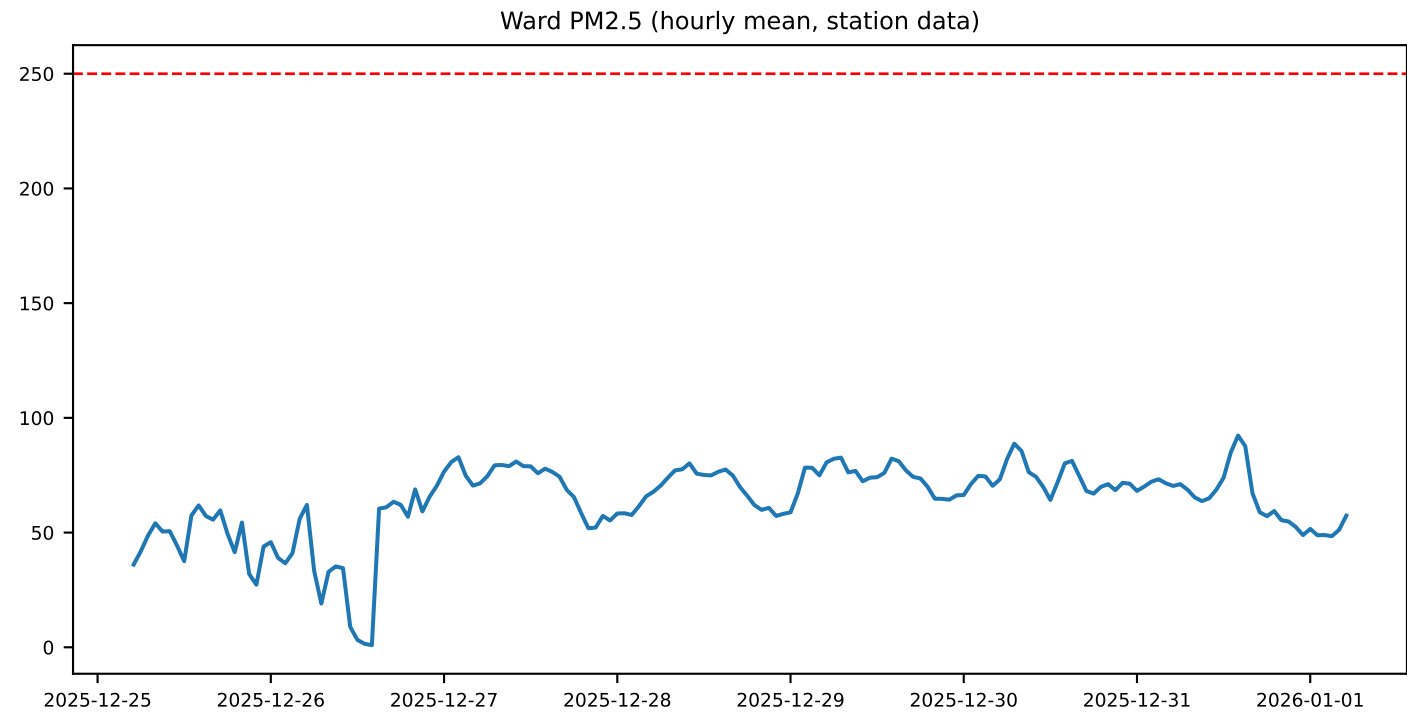

EVIDENCE (auto-generated, traceable):

- CO 2 above station's 75th percentile (1)
- NH3 109 above station's 75th percentile (102)
- Event at 09:00 — rush-hour window
- New Year period — fireworks prior
- Wind from sector 13 (CPF 0.56) — persistent upwind source direction
- Calm winds (0.1 m/s) — accumulation/inversion conditions