


VAYU-NET Enforcement Evidence Pack


Ward: BIJWASAN (Delhi) Source: burning_fireworks Confidence: 63%
At-risk facilities in ward: 12 schools, 3 hospitals
Priority score: 6.833 Events: 22 Mean PM2.5: 407 ug/m3 (max 560)
Window: 2025-12-26 03:30:00 to 2025-12-31 23:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

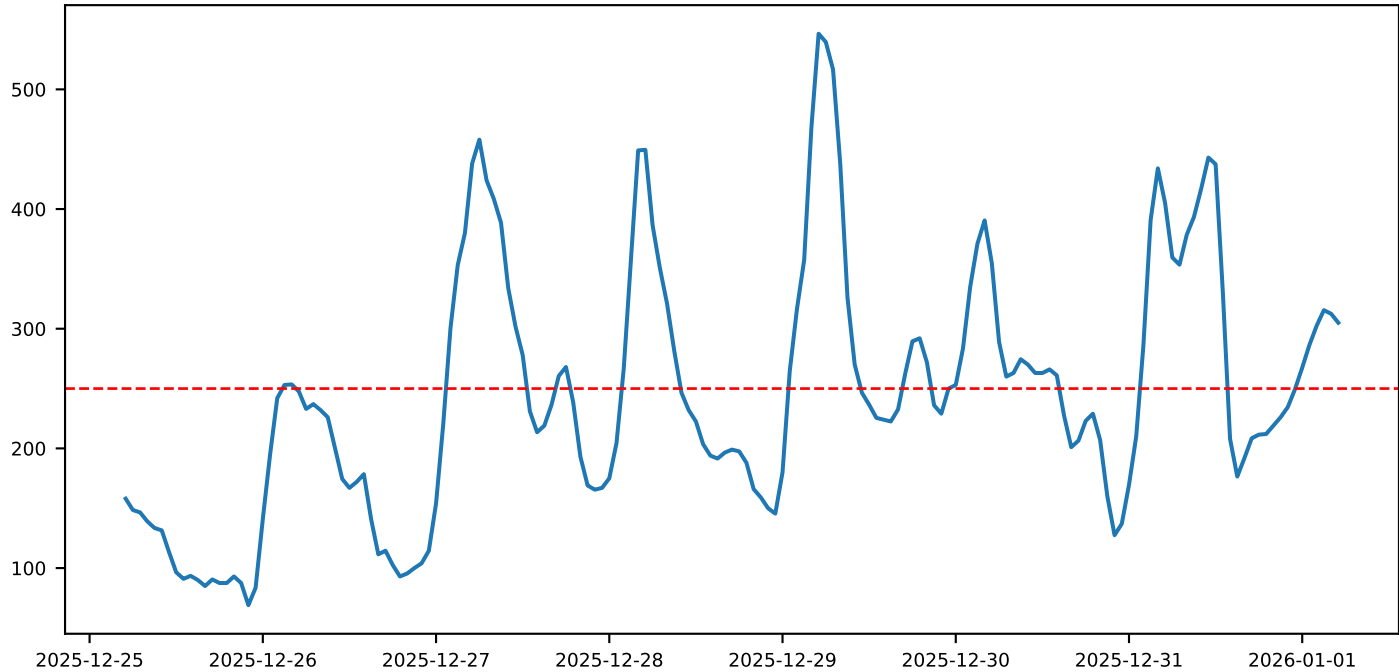

Pollution rose (mean PM2.5 by wind dir)

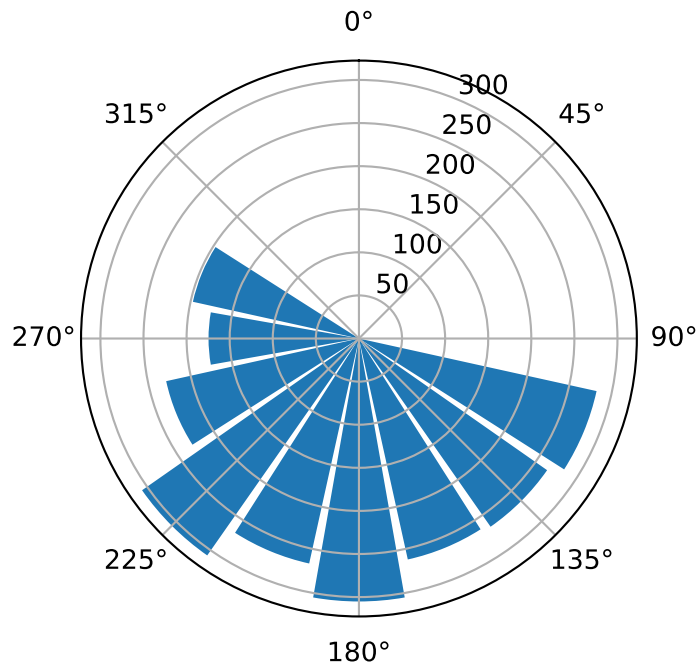

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.74 > 0.65 — combustion-dominated aerosol
- CO 4 above station's 75th percentile (4)
- NH3 104 above station's 75th percentile (97)
- New Year period — fireworks prior
- Calm winds (0.6 m/s) — accumulation/inversion conditions