


VAYU-NET Enforcement Evidence Pack


Ward: R. K. PURAM (Delhi) Source: burning_fireworks Confidence: 59%
At-risk facilities in ward: 7 schools, 2 hospitals
Priority score: 6.499 Events: 18 Mean PM2.5: 451 ug/m3 (max 718)
Window: 2025-12-26 03:30:00 to 2026-01-01 00:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

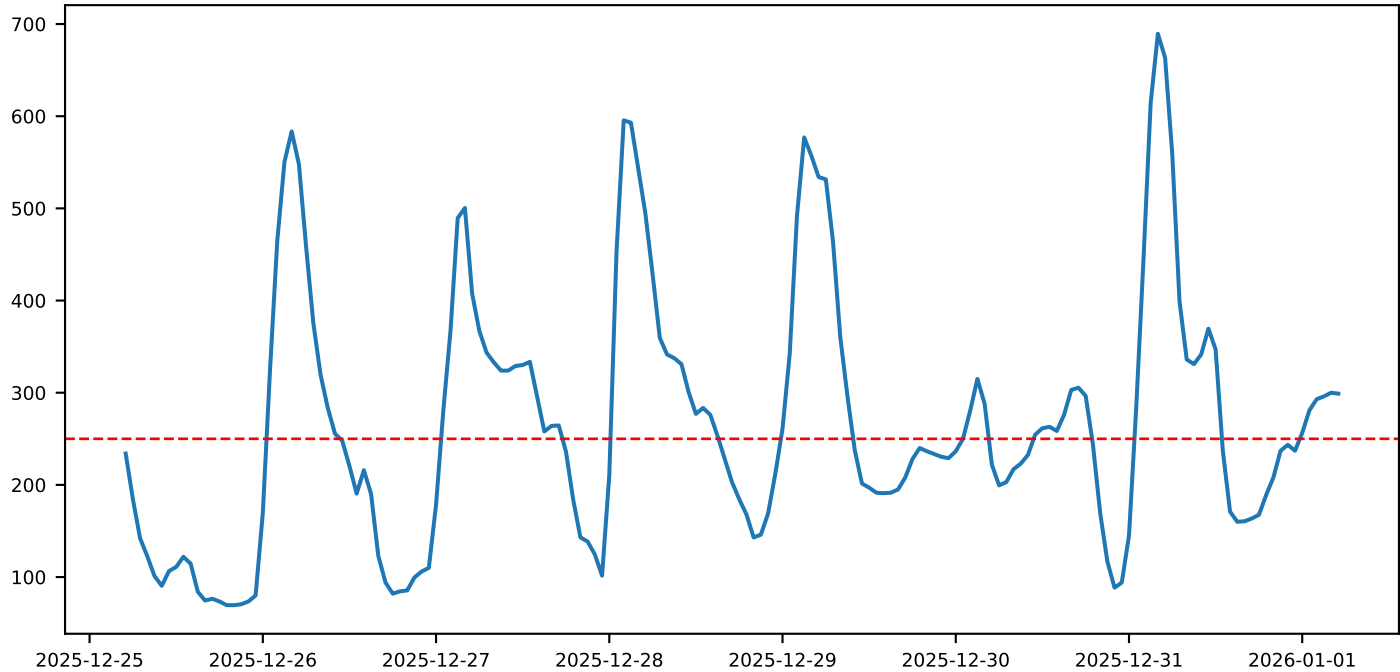

Pollution rose (mean PM2.5 by wind dir)

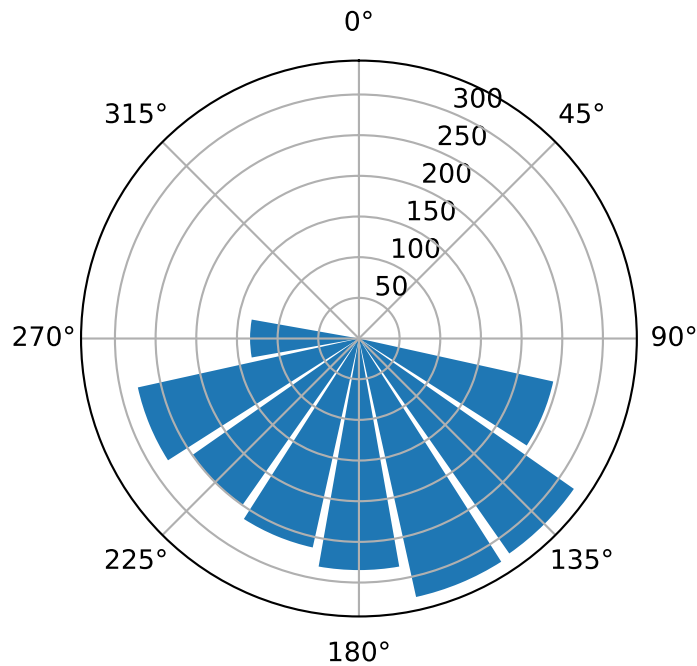

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.76 > 0.65 — combustion-dominated aerosol
- CO 6 above station's 75th percentile (4)
- NH3 39 above station's 75th percentile (36)
- Event at 23:00 — late-night window (burning/fireworks typical)
- Calm winds (0.3 m/s) — accumulation/inversion conditions
- VIIRS fire activity 1.4x the period average within ~50 km (3 detections vs 2/day baseline, NASA FIRMS)