

VAYU-NET Enforcement Evidence Pack

Ward: I.P EXTENTION (Delhi) Source: burning_fireworks Confidence: 61%

At-risk facilities in ward: 9 schools, 1 hospitals


Priority score: 8.115 Events: 12 Mean PM2.5: 523 ug/m3 (max 621)

Window: 2025-12-26 05:30:00 to 2025-12-31 20:30:00


RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points

LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

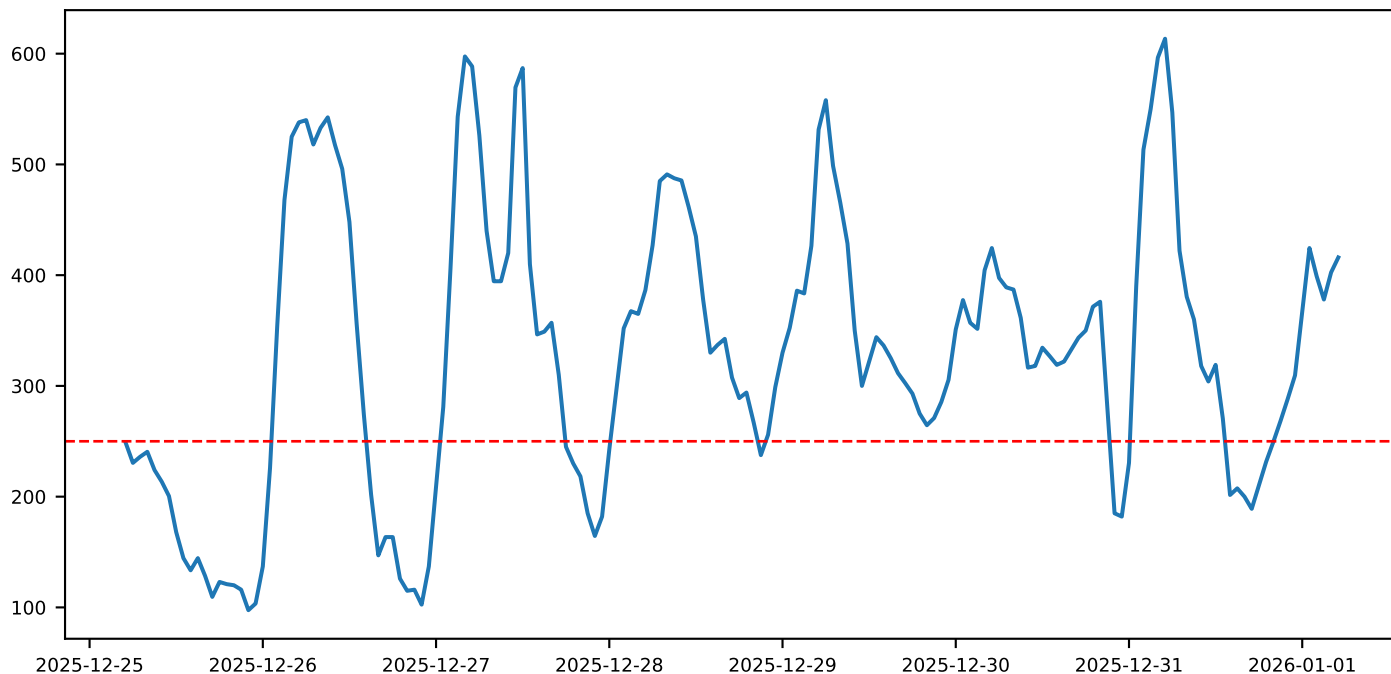

Pollution rose (mean PM2.5 by wind dir)

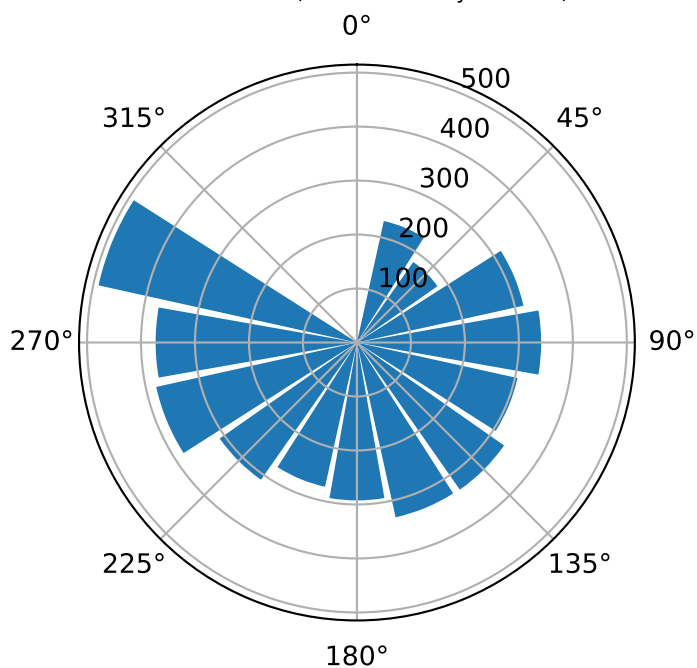

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio 0.73 > 0.65 — combustion-dominated aerosol
- NO2 207 above station's 75th percentile (72)
- CO 5 above station's 75th percentile (4)
- NH3 130 above station's 75th percentile (64)
- Event at 00:00 — late-night window (burning/fireworks typical)
- New Year period — fireworks prior
- Calm winds (0.4 m/s) — accumulation/inversion conditions