


VAYU-NET Enforcement Evidence Pack


Ward: F/N (Mumbai) Source: burning_fireworks Confidence: 53%
At-risk facilities in ward: 36 schools, 25 hospitals
Priority score: 0.945 Events: 2 Mean PM2.5: 127 ug/m3 (max 131)
Window: 2025-12-29 07:30:00 to 2026-01-01 04:30:00

RECOMMENDED ACTION: Anti-burning patrol during evening/night hours; locate and extinguish open burning points
LEGAL BASIS: Air Act 1981 s.19(5) & applicable court orders on fireworks; open burning ban (NGT)

Ward PM2.5 (hourly mean, station data)

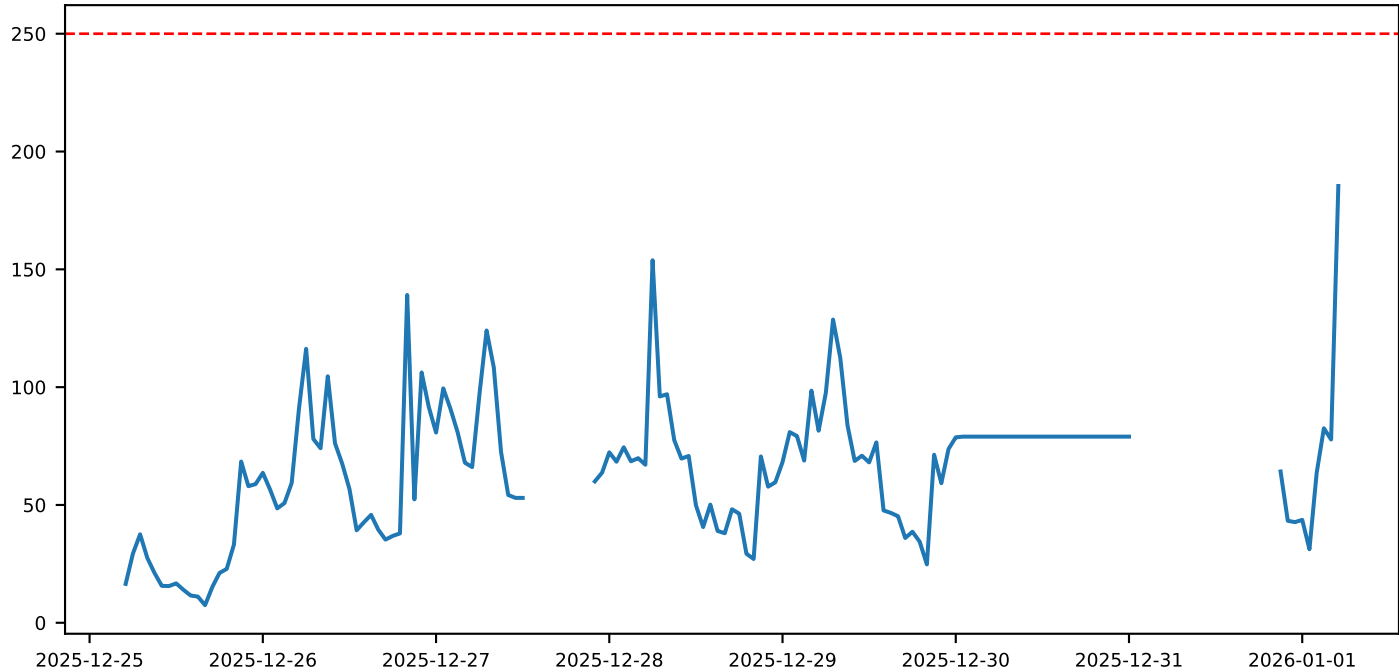

Pollution rose (mean PM2.5 by wind dir)

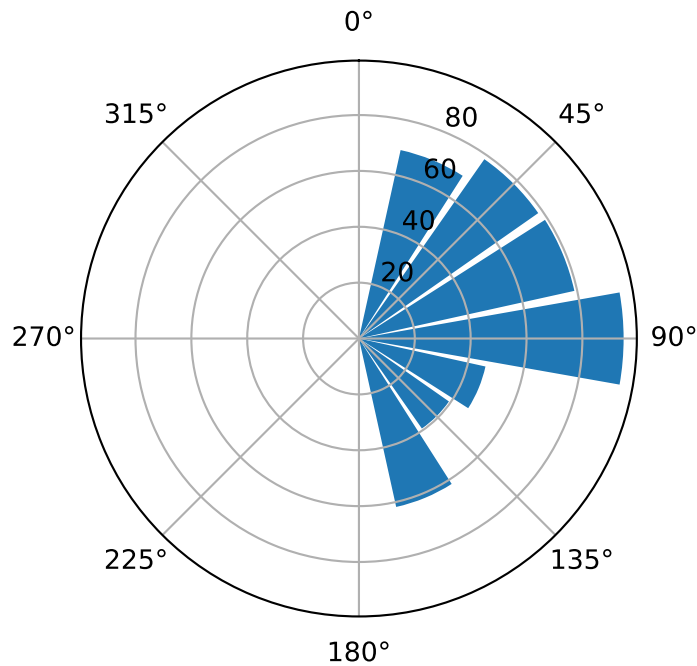

EVIDENCE (auto-generated, traceable):

- PM2.5/PM10 ratio $0.28 < 0.45$ — coarse-particle (dust) signature
- NO2 62 above station's 75th percentile (61)
- CO 0 above station's 75th percentile (0)
- Event at 23:00 — late-night window (burning/fireworks typical)
- New Year period — fireworks prior
- Calm winds (0.6 m/s) — accumulation/inversion conditions